

## Document Title

Owner	Reviewers		Approver
Role	Head of Asset Management	Head of Technical	Director of Operations
DD-MM-YY	22 August 2024	22 August 2024	22 August 2024

Document Number	LENL/OPS/POL/001
Current Version	1.3

Version	Date	Revision Description
V1.0	04/18	First version of document
V1.1	04/23	Minor amends completed
V1.2	01/24	Transferred to new document format
V1.3	08/24	Minor amends during document review / sign off

This document forms part of the Leep Utilities Integrated Management System and compliance with its requirements is mandatory. Departure from these requirements may only be taken with the written approval of the above authorisers.

The electronic version of this document is the latest revision. It is the responsibility of the individual to ensure that any paper material is the current revision by referring to the document library on SharePoint. The printed version of this document is uncontrolled.

## Statement of Methodology and Charges for Connection to the Electricity Distribution Systems of:

Registered Office  
Leep Electricity Networks Ltd  
The Metro, 2nd Floor  
33 Trafford Road  
Salford  
M5 3NN  
Company Number: 06684589

### Important Note

This document comprises the Connection Charging Methodology and the Connection Charging Statement of Leep Electricity Networks Limited (LENL).

The Connection Charging Methodology describes the methodology that LENL will use to determine the charges for making a connection to their electricity distribution systems. The Connection Charging Statement sets out the basis on which charges will be made for the provision of connections to LENLs distribution system.

This document has been prepared in accordance with the requirements of our License issued under the Electricity Act 1989 (as amended).

At our discretion, we may charge a fee of £10 (plus VAT) for each hard copy of this document provided in accordance with a request. An electronic copy of this document is available free of charge from the Leep website at: <https://www.leeputilities.co.uk/>**Error! Reference source not found.**

## Contents

1.1.	SECTION 1. GENERAL INFORMATION .....	6
1.1.1.	Competition in Connections.....	6
1.1.2.	Contractual Framework.....	8
1.1.3.	Offer to Connect Premises and to Construct the Connection (Connection Offer) .....	8
1.1.4.	Offer to undertake Non-Contestable Work only (Point of Connection Offer) .....	8
1.1.5.	Adoption Agreement.....	8
1.1.6.	Connection Agreement.....	9
1.1.7.	Appointment of a Supplier .....	9
1.1.8.	Structure of this Document and Further Information .....	10
1.1.9.	.....	11
1.2.	SECTION 2. APPLYING FOR A CONNECTION TO OUR DISTRIBUTION SYSTEM .....	12
1.2.1.	Persons Entitled to Apply for a Connection .....	12
1.2.2.	Procedure for getting a connection .....	12
1.2.3.	Information We Require from You.....	13
1.2.4.	Budget Estimates.....	13
1.2.5.	Feasibility Studies .....	14
1.2.6.	Cost Breakdown .....	14
1.2.7.	Interactive Connection Applications .....	14
1.2.8.	Transitional Arrangements.....	15
1.2.9.	Connection Offers - How is your formal application handled?.....	16
1.2.10.	Stage 1 – Your application .....	16
1.2.11.	Stage 2 – Our design .....	16
1.2.12.	.....	16
1.2.13.	Stage 3 – Our Connection Offer .....	16
1.2.14.	Stage 4 – Acceptance of our Connection Offer .....	16
1.2.15.	Stage 5 – Construction of the required works by us .....	17
1.2.16.	APPLYING FOR A CONNECTION WHERE AN ICP UNDERTAKES THE CONTESTABLE WORKS .....	17
1.2.17.	Stage 1 – Your Application .....	17
1.2.18.	.....	17
1.2.19.	Stage 2 – Our Design .....	18
1.2.20.	Stage 3 – Our Point of Connection Offer and the Adoption Agreement.....	18
1.2.21.	Stage 4 – Acceptance of our Point of Connection Offer .....	18
1.2.22.	Stage 5 – Construction by us and the ICP .....	18
1.2.23.	Stage 6 – Adoption of the Contestable Works by us .....	19
1.2.24.	Standards of Performance for Point of Connection Applications .....	19
1.2.25.	Small Scale Embedded Generation.....	20
1.2.26.	Embedded Networks .....	20
1.3.	.....	20
1.4.	SECTION 3. Further Information on Connection Applications .....	21
1.4.1.	Connection Offer and Point of Connection Offer Validity Periods .....	21

1.4.2.	Contestable Work.....	21
1.4.3.	Non-Contestable Work.....	23
1.4.4.	.....	23
1.4.5.	Contestable Reinforcement and Diversionary Work .....	23
1.4.6.	Contestable Reinforcement and Diversionary Work .....	24
1.4.7.	.....	24
1.4.8.	Capacity of Domestic Connections.....	24
1.4.9.	Large Low Voltage Connections .....	24
1.4.10.	.....	24
1.4.11.	Available Capacity .....	25
1.4.12.	.....	25
1.4.13.	Helpful Advice for Reducing Your Connection Charge .....	25
1.5.	SECTION 4. CONNECTION CHARGING METHODOLOGY .....	25
1.5.1.	Payment Terms.....	25
1.5.2.	Minimum Scheme .....	26
1.5.3.	Enhanced Scheme .....	26
1.5.4.	Costs .....	26
1.5.5.	Cost Allocation.....	27
1.5.6.	Costs To Be Paid In Full By You.....	27
1.5.7.	Costs To Be Apportioned Between You And Us.....	28
1.5.8.	Recovery of Costs For Previous Works.....	32
1.5.9.	Costs To Be Paid In Full By Us.....	32
1.5.10.	Recovered Equipment and Deferment of Asset Replacement.....	34
1.5.11.	Rebates .....	34
1.5.12.	Speculative Developments .....	34
1.5.13.	Connection Alterations .....	35
1.5.14.	National Grid Electricity Transmission (NGET) Charges.....	35
1.5.15.	Land Rights.....	36
1.5.16.	Unmetered Supplies .....	36
1.5.17.	Capacity Ramping for LDNOs .....	37
1.5.18.	Disconnection and De-Energisation.....	37
1.5.19.	Adoption Payments.....	38
1.5.20.	Competition in Connection Charges .....	38
1.6.	SECTION 5. WORKED EXAMPLES ILLUSTRATING THE APPLICATION OF THE CONNECTION CHARGING METHODOLOGY .....	39
1.6.1.	.....	40
1.6.2.	.....	40
1.6.3.	Key to Illustrations.....	40
1.6.4.	Example 1: A new connection to a domestic premise .....	41
1.6.5.	Example 2A: New connections on a domestic housing development .....	42
1.6.6.	Example 2B: New connections on a domestic housing development with interconnection. ....	43
1.6.7.	Example 3: A new connection to commercial Premises .....	47

1.6.8.	Example 4: Additional load application for commercial Premises (requiring a new connection from the HV network) .....	51
1.6.9.	Example 5: Connection of a new embedded generator that requires Reinforcement involving Security and Fault Level CAFs. 53	
1.6.10.	Example 6: Connection of Mixed Housing and Commercial Development.....	55
1.6.11.	Example 7A: New 3MVA Generation Connection, Fault Level Triggered Reinforcement.....	57
1.6.12.	Example 7B: New 3MVA Generation Connection, Switchgear Extension Not Possible .....	59
1.6.13.	Example 8A: Connection of Housing Development with Network Reinforcement.....	61
1.6.14.	Example 8B: Connection of Housing Development .....	64
1.6.15.	Example 8C: Connection of Housing Development with Remote Network Reinforcement .....	66
1.6.16.	.....	70
1.6.17.	Example 8D: Connection of Housing Development with Load Transfer .....	70
1.6.18.	Example 9: Minimum Scheme .....	72
1.6.19.	Example 10: A New Connection Application for Commercial Premises on a Meshed 11kV Distribution System requiring Reinforcement.....	76
1.6.20.	Example 11: Non-Secure Connection with Non-Secure Reinforcement .....	78
1.6.21.	Example 12: Non-Secure Connection with Secure Reinforcement .....	80
1.6.22.	Example 13: Secure Connection with Secure Reinforcement .....	82
1.6.23.	Example 14: Reinforcement on another LDNO's network .....	84
1.6.24.	Example 15: New 2MVA Generation Connection, Voltage Rise Triggered Reinforcement .....	86
1.6.25.	Example 16: New 250kVA Generation Connection, Voltage Rise Triggered Reinforcement .....	88
1.7.	SECTION 6. OUR SPECIFIC CONNECTION CHARGING METHODOLOGY .....	90
1.7.1.	Introduction.....	90
1.7.2.	Competition in Connections.....	90
1.7.3.	Non-Contestable Work.....	90
1.7.4.	Inspection and Monitoring.....	91
1.7.5.	Factors influencing Competition in Connection (CIC) Charges .....	92
1.7.6.	Contestable Work.....	92
1.7.7.	Contestable Reinforcement & Diversionary Work.....	94
1.7.8.	Table of Contestable/Non-Contestable Work.....	95
1.7.9.	Payment Terms.....	96
1.7.10.	Connection Offer and POC Offer Terms and Conditions .....	96
1.7.11.	Land Rights .....	97
1.7.12.	Capitalised Operation and Maintenance Charges .....	99
1.7.13.	Projects .....	99
1.7.14.	Non-Standard Substation Buildings .....	99
1.7.15.	Charges for Assessment and Design .....	99
1.7.16.	Reservation of Import Capacity .....	99
1.7.17.	Contestable and Non-Contestable Works .....	100
1.8.	SECTION 7. OUR CONNECTION CHARGING STATEMENT .....	100
1.8.1.	Introduction.....	100
1.8.2.	Quotation Accuracy Scheme .....	103
2.	PART A Feasibility Studies .....	105

3.	PART B Assessment and Design for all relevant work.....	107
4.	PART C Budget Estimates .....	109
4.1.	PART D CIC Assessment and Design of the Non-Contestable Work.....	110
4.2.	PART E CIC Design Approval of the Contestable Work.....	111
4.3.	PART F CONSTRUCTION .....	112
4.3.1.	F1 Small Services covered by the Quotation Accuracy Scheme .....	112
4.3.2.	F4 Unmetered Supplies.....	124
4.3.3.	F5 Mains Cables .....	126
4.3.4.	F7 Substations .....	130
4.4.	PART G CIC Final Works and Phased Energisation.....	132
4.5.	PART I Land Rights .....	134
4.6.	PART J Other .....	135
5.	SECTION 8. GLOSSARY OF TERMS .....	136

## 1.1. GENERAL INFORMATION

We are Leep Electricity Networks Limited (here on described as LENL). As a Licensed Distribution Network Operator (LDNO) we own and operate electricity distribution networks throughout Great Britain. Typically, our electricity networks connect to the distribution systems of licensed Distribution Network Operators (DNOs) operating within their defined distribution services area.

The provision of a connection to either of LENL's respective Distribution Systems may be undertaken by us, or by one of our agents. Alternatively, certain connection activities may be undertaken by an Independent Connections Provider (ICP), which you may appoint.

This document describes the Connection Charging Methodology that we will apply in determining the charges we will make where we provide connections to LENL's respective Distribution Systems and provides details of illustrative costs. The document also describes how you can obtain a new or altered connection to LENL's DistributionSystem.

We will review this document at least once a year to ensure that the information continues to be accurate in all respects. Any changes we make to this document will be made in accordance with our license obligations. Costs shown in the Connection Charging Statement are current at the time of publication and are subject to change without notice except as otherwise provided.

Certain words in this document are capitalised, e.g. Distribution System. These words have a specific meaning, which is set out in the Glossary of Terms (Section 8). The words "you", "your" and "yourself" refer to the Customer, the person requesting a connection, his company or agent and "we", "us", "our" and "ourselves" refer to LENL or our appointed agents.

### 1.1.1. Competition in Connections

You may choose to have some of the connections' work (described as Contestable Work) carried out by an Independent Connections Provider (ICP). The elements of work that an ICP may undertake include the design, procurement and installation of new assets necessary to provide the electricity connection.

Section 3 of this document contains details of the elements of work, which are Contestable and Non-Contestable, and the arrangements, which apply if you choose to appoint an ICP to carry out Contestable Work.

Non-Contestable Work can only be carried out by us or by our appointed agents.

If you wish to appoint an ICP to carry out Contestable Work, and for us to adopt the Contestable Work after they are completed, you and/or your ICP must enter into an Adoption Agreement before your ICP commences any of the Contestable Works.

Contestable Works undertaken by an ICP and subsequently adopted by LENL pursuant to an Adoption Agreement are outside the scope of this document.

Unless we agree otherwise in writing, where you choose to appoint an ICP to undertake Contestable Works, the ICP must be accredited through Lloyds Register.

Further information describing the process and options available is provided in Section 2 of this document.

### 1.1.2. Contractual Framework

Depending on the size and type of the connection and whether you wish us or an ICP to undertake any Contestable Work you will need to enter into a set of contractual arrangements with us. Unless you are another licensed distributor, you will also need to appoint a Supplier who must also be a party to various industry agreements and codes.

### 1.1.3. Offer to Connect Premises and to Construct the Connection (Connection Offer)

A Connection Offer is the offer that we make to you where you have asked us to carry out the connection works (both Non-Contestable and Contestable Work) to our Distribution System and which will, if accepted by you, create a legally binding contract between you and us. The terms of the Connection Offer will depend, amongst other things, on the complexity and value of the work to be carried out.

### 1.1.4. Offer to undertake Non-Contestable Work only (Point of Connection Offer)

A Point of Connection Offer is the offer that we make to you where you have asked us to carry out the Non-Contestable Work to provide a Point of Connection to our Distribution System that the Contestable Work provided by an ICP can connect. The terms of the Point of Connection Offer, if accepted by you, will create a legally binding contract between you and us. The terms of the Connection Offer will depend, amongst other things, on the complexity and value of the work to be carried out.

### 1.1.5. Adoption Agreement

As set out above, if an ICP is to undertake Contestable Works and you want us to adopt the Contestable Works after they have been completed an Adoption Agreement must be completed prior to the commencement of Contestable Works. The agreement will set out the terms under which we will take ownership of, and responsibility for, the assets provided in the Contestable Works. The agreement will include, among other things:

- The transfer of title from the asset owner (normally the Customer or the ICP) to us;
- The quality and safety requirements of the asset to be adopted;
- Any required sureties.
- The transfer of Land Rights;
- The procedure for us to energise the assets installed by the ICP during the works.
- The payment of any residual Connection Charges or fees.
- Planning permissions and compliance with street works legislation; and,
- Defect correction processes, where applicable.

The parties to the Adoption Agreement may vary depending on the circumstances and the Adoption Agreement may be between:

- us and you.
- us and your appointed ICP
- us, you and your appointed ICP



### 1.1.6. Connection Agreement

The owner/occupier of the Premises to which the connection is to be provided or the LDNO or the License Exempt System operator will be required to enter into a Connection Agreement with us. The Connection Agreement will set out the terms upon which the premises can be, and remain, connected to our Distribution System. The Connection Agreement will normally be provided on our behalf by the owner/occupier's chosen Supplier for the Premises as part of their application for a supply of electricity.

For most sites the Connection Agreement will comprise the National Terms of Connection put in place on our behalf by your appointed Supplier. In some circumstances, we may require you to enter into a separate Connection Agreement covering the specific connection characteristics of your site. This will only take effect upon completion of the connection and will set out, in more detail, the respective rights and obligations of us and of the owner/ occupier. Additionally, the Connection Agreement may contain technical details of the installation being connected to the Distribution System and will require the owner/occupier of the Premises to comply to the provisions of the Distribution Code.

The Distribution Code covers, amongst other matters, all material technical aspects relating to:

- Connection to, and the operation and use of an LDNO's Distribution System; and
- The operation of electrical lines and electrical plan or apparatus connected to an LDNO's Distribution System.

A copy of the Distribution Code can be downloaded from the Distribution Code website at [www.dcode.org.uk](http://www.dcode.org.uk)

### 1.1.7. Appointment of a Supplier

To receive a supply of electricity you must appoint and enter into an agreement with a Supplier. Unless we agree that your connection qualifies to be treated as an Unmetered Supply (UMS), your Supplier must also arrange for the installation of metering equipment appropriate to the connection that is being provided for you. Alternatively, you may agree with your supplier arrangements where you install the metering equipment. Where it is required, the metering equipment must be installed before a supply of electricity can be provided to a Premise.

To obtain a supply of electricity, you will need a Supply Number (also known as a Meter Point Administration Number or 'MPAN') for each connection. We will issue the MPAN shortly before installing the connection, but only upon receipt of the full postal address of the Premises.

**Please note that we are unable to give advice on a choice of Supplier.**

The Citizens Advice Bureau website maintains a list of Suppliers: [www.citizensadvice.org.uk](http://www.citizensadvice.org.uk)

Energisation of the connection to your Premises will not take place unless a Supply Number has been allocated and a Supplier has been appointed and the appropriate metering equipment, where this is required, has been installed.

Your Supplier will be a party to several industry codes and agreements which, will allow it to use the GB Transmission System, our Distribution System and also allow it to purchase and trade energy on behalf of its customers.

### 1.1.8. Structure of this Document and Further Information

The document is divided into several Sections.

Section 1 is this section and give general guidance to this document.

Section 2 outlines the high-level process for applying for a connection to our Distribution System when either we, or an appropriately accredited ICP, carry out the Contestable Works.

Section 3 provides further information specific to us regarding obtaining a connection.

Section 4 describes the elements of the Connection Charging Methodology that have analogous paragraphs in the Common Connection Charging Methodology, which we will use to calculate Connection Charges.

Section 5 contains worked examples of the Connection Charging Methodology and how it would be applied in particular circumstances.

Section 6 contains the parts of our specific Connection Charging Methodology, which do not have a counterpart paragraph in the Common Connection Charging methodology but will equally be used in calculating your Connection Charges.

Section 7 contains the Connection Charging Statement which, when used in conjunction with Section 4, enables reasonable estimates of the charges liable for connection to be made.

Section 8 provides a glossary of terms used throughout the document.

For further information about this document (or if you need advice about getting a connection), please contact:

Asset Management  
Leep Electricity Networks Limited  
The Metro, 2<sup>nd</sup> Floor  
33 Trafford Road  
Salford  
M5 3NN  
Tel: 0345 122 6780  
Email: [connections@leeputilities.co.uk](mailto:connections@leeputilities.co.uk)

## Disputes

If you are not satisfied with the terms we have offered, or with our handling of your application, please contact:

Asset Management Disputes  
Leep Electricity Networks Limited  
The Metro, 2<sup>nd</sup> Floor  
33 Trafford Road  
Salford  
M5 3NN  
Tel: 0345 122 6780  
Email: [connections@leeputilities.co.uk](mailto:connections@leeputilities.co.uk)

If you are still not satisfied with our actions and you have followed our complaints procedure, then domestic and small business customers have the right to contact the Energy Ombudsman. This is a free and independent dispute resolution service. They can be contacted at:

Phone: 0330 440 1624  
Fax: 0330 440 1625  
Textphone: 0330 440 1600  
Email: [osenquiries@os-energy.org](mailto:osenquiries@os-energy.org)  
Web: [www.ombudsman-services.org/energy](http://www.ombudsman-services.org/energy)

If the Energy Ombudsman is unable to deal with or resolve the dispute then either party may request a determination of the matter by the Gas and Electricity Markets Authority (the Authority), whose details are:

The Office of Gas and Electricity Markets (Ofgem)  
10 South Colonnade  
Canary Wharf  
E14 4PU

Email: [www.ofgem.gov.uk](http://www.ofgem.gov.uk)

## 2. APPLYING FOR A CONNECTION TO OUR DISTRIBUTION SYSTEM

This section sets out the process for applying for a connection to our Distribution System.

As detailed in Section 1 you can appoint an ICP to carry out the Contestable Works relating to the provision of your connection. The principles and processes contained in this section are relevant to all connections to our Distribution System.

### 2.1.1. Persons Entitled to Apply for a Connection

Any person may apply for a connection to our Distribution System.

Any person may appoint an agent to apply for a connection on their behalf, but the agent may be required to provide written evidence of their appointment on application.

Persons entitled to seek connection to our Distribution System for the purpose of generating, supplying or distributing electricity are those who are authorised by license or by exemption under the Act to generate, supply or distribute electricity.

### 2.1.2. Procedure for getting a connection

A person seeking a new, modified connection, single domestic connection or require an alteration to an existing connection should contact us as detailed below:

Asset Management  
Leep Electricity Networks Limited  
The Metro, 2<sup>nd</sup> Floor  
33 Trafford Road  
Salford  
M5 3NN  
Tel: 0345 122 6780  
Email: [connections@leeputilities.co.uk](mailto:connections@leeputilities.co.uk)

Once we have received your completed application, we will process your request and provide you with a Connection Offer as soon as reasonably practicable. This will (subject to us receiving any information we may require to prepare the offer from the distributor to whose Distribution System our network connects) be no longer than three months.

The connection offer will specify the proposed Point of Connection to our Distribution System; the location of the Entry/Exit Point to the Premises or distribution system to be connected; details of the work to be carried out by us; and the terms under which we will provide the connection.

The link below will take you to our website where further information is available: [www.leeputilities.co.uk](http://www.leeputilities.co.uk)

### 2.1.3. Information We Require from You

When you make your application to us you will need to provide the information set out below. In some cases, it is possible that additional information will be required, we will notify you if this is the case when we have assessed your requirements.

If you do not provide the information we require it will prevent us from dealing with your enquiry in a prompt manner. Please provide the information indicated on our application form. The information we require will vary depending on the nature of your connection request. Typically, we require the following details:

- Your name and correspondence address and other contact details.
- The Premises address where the connection is required.
- Whether you require a Budget Estimate or a formal Connection Offer. A formal Connection Offer is a contractual document and more appropriate once you are in a position to decide whether the project can proceed to the construction phase.
- A site location plan showing the site boundary and proposed meter locations.
- The Required Capacity (your maximum power requirement).
- The date by which you require the connection to be made.
- Whether the connection is required for a fixed period or indefinitely.
- The type of connection(s) required, e.g. demand, generator or for a licensed, embedded network.
- Any information you have in respect of equipment you may install and which may interfere with our Distribution System or the supply of Electricity to others (e.g. apparatus which can cause voltage fluctuations, such as large motors associated with air conditioning system, lifts, cranes, hoists and other similar plant; or apparatus which can produce harmonics, such as uninterruptible power supplies or electronic control systems).

An application form can be obtained by emailing: [connections@leeputilities.co.uk](mailto:connections@leeputilities.co.uk)

### 2.1.4. Budget Estimates

If you make an enquiry that is of a provisional nature, we will provide a Budget Estimate to give you an indication of what we believe the charge for providing the connection may be. In providing this estimate we will only carry out a desk top exercise using broad base assumptions to assess the likely works we will need to undertake; we will not carry out

any detailed analysis specific to the site. Therefore, you should note that the estimate we provide at this stage may vary considerably from any further Budget Estimates or the price in any formal Connection Offer. A Budget Estimate is not a formal offer for connection and cannot be accepted by you. See Section 7, Part A for charges associated with the provision of Budget Estimates.

### 2.1.5. Feasibility Studies

At your request, we will undertake a Feasibility Study to consider of the options for connection and provide estimated costs for each option as appropriate. Generally, this will be for more complex connections. A Feasibility Study is not a formal offer for connection and cannot be accepted by you. Any estimated cost in such study will be purely indicative and not binding. The price in any subsequent Connection Offer to you may differ from it. See Section 7, Part B for charges associated with the provision of Feasibility Studies.

### 2.1.6. Cost Breakdown

For Connection Offers that include Contestable Work with a Connection Charge in excess of £20,000, we will provide a breakdown of costs, which can be referenced to the tables in Section 7. As a minimum this breakdown will include:

- A description of the works to be undertaken, including whether it is an Enhanced Scheme;
- The length of underground cable/overhead line required
- The number of substations required
- Information on any Reinforcement works that are required; and
- Legal and professional charges associated with the securing of Land Rights (if needed).

Our Connection Offer to you will normally be based on the Minimum Scheme required to provide the connection. Sometimes we may undertake works that are in addition to those required by the Minimum Scheme (i.e., an Enhanced Scheme). This may be:

- where we propose to undertake works that are over and above those required by the Minimum Scheme; or
- where you require us to undertake additional work, (for example, to provide enhanced system security).

Where the additional works in the Enhanced Scheme are at our request the Connection Charge to you will be based on the Minimum Scheme. We will provide you with a breakdown of the costs for both the Minimum Scheme and the Enhanced Scheme. Where the Enhanced Scheme comprises of additional works requested by you the Connection Charge to you will be based on the Enhanced Scheme and we will provide you with a cost breakdown for the Enhanced Scheme

### 2.1.7. Interactive Connection Applications

We may receive connection applications from more than one party for connections to the same part of the Distribution System, and whilst each connection application could be accommodated on an individual basis, there may be insufficient spare capacity or other network constraints to accommodate more than one of the connection applications. Where we receive multiple applications for connection to the same part of our Distribution System, we will apply an Interactive Connection Application process in order to prioritise connection applications fairly. We will apply this process for all applications for connection to our Distribution System.

The Application Date will be used to sequence Connection Offers in time order such that the first Connection Offer will be made to the first applicant to reach the 'application' stage of the process, and so on. All parties will be notified in writing if their application is Interactive or becomes Interactive with others. Where a current Connection Offer is open for acceptance, the Validity Period set out in the terms of such Connection Offer will be reduced to thirty (30) days from the date of any such notification, where more than thirty (30) days are still outstanding.

### 2.1.8. Transitional Arrangements

The Connection Charge quoted in a Connection Offer will be calculated in accordance with our Connection Charging Methodology that is current at the time the offer is provided. If you accept our Connection Offer, and the connection works are carried out within the prescribed time set out in it, the Connection Charge will be the charge that shall apply even if there is a subsequent change to our Connection Charging Methodology.

We will identify where the making of a new Connection Offer(s)/ POC Offer(s) would (if accepted) affect the terms of other unaccepted Connection Offer(s)/ POC Offer(s). We will notify all Affected Parties at the same time that their Connection Offer/ POC Offer is or has become interactive.

At the time of making any Connection Offer(s)/ POC Offer(s) that trigger interactivity all Affected Parties will receive a "Notice of Interactivity". The Notice of Interactivity shall:

- a) Inform the Affected Parties in writing:
  - That there is another Connection Offer(s)/ POC Offer(s) outstanding, the acceptance of which might affect the terms of any Connection Offers/POC Offers made;
  - That their Connection Offers/ POC Offers are interactive;
  - Their respective positions in the Interactive Queue, determined by the Application Date; and
  - The process for accepting Interactive Connection Offers.
- b) Make all Interactive Connection Offers conditional upon the other(s) not having been accepted; and
- c) Suspend the Affected Parties' right to accept their Interactive Connection Offers until 9:00am on the next Business Day following the end of the Moratorium Period. Where a Moratorium Period applies due to interactivity, we will where necessary extend the acceptance period of all Interactive Connection Offers for the same duration as the Moratorium Period.

The Interactive Queue shall be comprised of the Affected Parties, and the Application Date will determine an Affected Party's position in the Interactive Queue. The Affected Party with the earliest Application Date amongst the Affected Parties will be first, the Affected Party with the next earliest Application Date will be second, and so on. If two or more Affected Parties have the same Application Date, they will be given the same (joint) position in the Interactive Queue.

The Affected Parties will only be able to accept their Connection Offers at the end of the Moratorium Period. Any acceptance of an Interactive Connection Offer received by us prior to 9:00am on the first Business Day following the end of the Moratorium Period will be deemed to have been received at 9:00am on the first Business Day following the end of Moratorium Period. Following the end of the Moratorium Period, any interactive Connection

Offer acceptance received after 5:00pm will be deemed to have been received at 9:00am on the following Business Day.

If more than one Interactive Construction Offer acceptance is received on any given day, the Affected Party who has the earliest position in the Interactive Queue will be considered to be a valid acceptance. If two or more Affected Parties have the same Application Date, and therefore hold the same position in the Interactive Queue, the first of such Affected Parties to submit their acceptance to us will be considered to be a valid acceptance.

Upon receipt of an Interactive Connection Offer acceptance, we will notify all other Affected Parties that their Connection Offer(s) are withdrawn. Following the withdrawal of an interactive Connection Offer, the Applicant shall have the option to re-apply, or advise they wish their original application to continue to be considered, in which case we will issue a new Connection Offer to the Applicant. They will remain in the same existing order within the Interactive Queue.

### **2.1.9. Connection Offers - How is your formal application handled?**

You do not need to have requested a Budget Estimate or Feasibility Study before you request a formal Connection Offer. When you request a connection to our Distribution System, your request is dealt with in five key stages.

#### **2.1.10. Stage 1 – Your application**

We will only be able to progress your application once you have provided us with the information we require. We will notify you if we require any additional information in order to process your application.

#### **2.1.11. Stage 2 – Our design**

We will design the connection for you, taking into account the location of the Premises for which the connection is required, its proximity to the existing Distribution System and the available capacity in the Distribution System to provide the connection that you require. Additionally our design will specify any reinforcement that is required on our existing Distribution System (or on the distribution system to which our Distribution System connects) in order to accommodate your connection.

#### **2.1.12. Stage 3 – Our Connection Offer**

This is our formal written offer to you to provide the connection to the Distribution System. This offer will set out the terms and the Connection Charge for making the connection. The Connection Offer may be accepted by you in accordance with its terms at any time within the Validity Period set out in our Connection Offer, providing it is not, or does not become an Interactive Connection Offer. You should note that the price provided by us at this stage may vary considerably from any previous Budget Estimates or Connection Offers.

#### **2.1.13. Stage 4 – Acceptance of our Connection Offer**



If you wish to accept our Connection Offer to the Distribution System you must:

- accept that offer in accordance with its terms within the Validity Period; and
- make any required payment due on acceptance by the means specified in our Connection Offer.

A valid acceptance of our Connection Offer will create a legally binding agreement between us.

#### **2.1.14. Stage 5 – Construction of the required works by us**

At this stage we will carry out the construction work, subject to the terms of the accepted Connection Offer, to provide the new connection. We, and our appointed agents, will maintain appropriate liaison with you during the planning and execution of the works.

Supply Numbers (Metering Point Administration Numbers or 'MPANs') will be issued before the connection works are completed, so that you can make arrangements with your Supplier for the supply of electricity to the Premises. On completion of this stage, the work required to provide the connection will have been installed and will be available for your Supplier to arrange for the installation of metering equipment, or where agreed with us, for use as an Unmetered Supply.

#### **2.1.15. APPLYING FOR A CONNECTION WHERE AN ICP UNDERTAKES THE CONTESTABLE WORKS**

You may appoint an ICP to undertake some or all of the Contestable Work. You can ask us to adopt the Contestable Work or may choose to have the Contestable work adopted by someone else. If you decide to have the Contestable Work adopted by someone else, this will constitute an Embedded Network requiring a Bilateral Connection Agreement. If, however, you wish to appoint us to adopt Contestable Work constructed by an ICP, the ICP may make an application on your behalf and your request for a Point of Connection Offer will be processed in the following way:

#### **2.1.16. Stage 1 – Your Application**

#### **2.1.17.**

We will only be able to progress your connection application once you have provided us with the information we require. We will notify you within five Working Days if we require any additional information in order to process your application.

If you choose to appoint an ICP to carry out the Contestable Work then the Point of Connection will be determined by us based on the information provided to us by the ICP and taking into account the ICP's requirements and our wider obligations.

For larger demand and generator connections, more than one Point of Connection may need to be assessed. A table showing our indicative charges for assessing the Point of Connection is given in Section 6. These charges will be included within the Point of Connection Offer. If you wish to undertake assessment of the Point of Connection, then we will provide you with all the necessary information in order for your ICP to undertake the assessment. Your ICP will need to be suitably accredited to undertake this assessment.

#### **2.1.18. Stage 2 – Our Design**

Our design of the Non-Contestable Work and the identification of the Point of Connection will take into account the location of the Premises for which a connection is required, its proximity to our Distribution System, and the available capacity in our Distribution System to provide the connection you require. Additionally, our design will specify any reinforcement that is required on our existing Distribution System and/or on the Distribution System to which our Distribution System connects in order to accommodate your connection.

#### **2.1.19. Stage 3 – Our Point of Connection Offer and the Adoption Agreement**

This is our formal written offer to you to provide the connection to our Distribution System. The Point of Connection Offer will set out the terms and the price upon which we will make that connection, whilst the Adoption Agreement will set out the terms under which we will adopt assets installed by your ICP. The Point of Connection Offer that we make to you may be accepted by you in accordance with its terms at any time within the Validity Period set out in our Point of Connection Offer. The price in our Point of Connection Offer may be different from any previous Budget Estimates.

#### **2.1.20. Stage 4 – Acceptance of our Point of Connection Offer**

If you wish to accept our Point of Connection Offer, you must:

- accept the Point of Connection Offer in accordance with its terms within the Validity Period;
- obtain design approval from us for the Contestable Work in the timescales specified;
- make any required payment by the date and means specified in our Point of Connection Offer; and
- return the signed Adoption Agreement within the timescale specified.

A valid acceptance of our Point of Connection Offer will create a legally binding agreement between us. Where the terms of the Adoption Agreement have been unaltered, we will sign the Adoption Agreement and return a copy to the relevant parties.

#### **2.1.21. Stage 5 – Construction by us and the ICP**

At this stage we (and/or our appointed agents) will carry out construction of the Non-Contestable Works and the ICP will carry out construction of the Contestable Works. We may carry out routine inspections of the Contestable Works as it is installed. Such inspections will be on the same basis as those we carry out in respect of our own connections

work. Shortly before the Contestable Works is ready for connection to our Distribution System your ICP must contact us so that we can arrange a date for connection. Subject to the provision of any required documentation and the satisfactory completion of any required tests we will connect the Contestable Works to our Distribution System and, where agreed, adopt the assets. Supply Numbers (Metering Point Administration Numbers or 'MPANs') will be issued before the Connection Works are completed, so that arrangements can be made with your Supplier. On completion of this stage, the Extension Assets and Entry/ Exit Point(s), as appropriate, will have been commissioned and will be available for meters to be installed or, in the case of Unmetered Supplies, be ready for use.

#### 2.1.22. Stage 6 – Adoption of the Contestable Works by us

Adoption will be in accordance with the provisions of the Adoption Agreement described in Section 1.

#### 2.1.23. Standards of Performance for Point of Connection Applications

Appendix 1 of Standard License Condition 15 of our Electricity Distribution License details the standards of performance and that we must take all reasonable steps to comply with this when providing the POC Offer, design approval, connection and Energisation of the connection. These standards apply where you have provided Leep with the necessary information we need to undertake the work and, where relevant we receive the required information from the relevant distributor (to whose distribution system our Distribution System connects). These standards are set out in the table below:

Provision of POC Offers	Performance Level
<b>(a) Low voltage demand:</b> for a new demand connection to our Distribution System where the highest voltage of the assets at the POC and any associated works is not more than one kilovolt.	Within fifteen Working Days of receiving the request
<b>(b) Low voltage generation:</b> for a new generation connection to our Distribution System where the highest voltage of the assets at the POC and any associated works is not more than one kilovolt.	Within thirty Working Days of receiving the request
<b>(c) High voltage demand:</b> for a new demand connection to our Distribution System where the highest voltage of the assets at the POC and any associated works is more than one kilovolt but not more than 22 kilovolts.	Within twenty Working Days of receiving the request
<b>(d) High voltage generation:</b> for a new generation connection to our Distribution System where the highest voltage of the assets at the POC and any associated works is more than one kilovolt but not more than 22 kilovolts.	Within fifty Working Days of receiving the request

(e) <b>Extra high voltage demand:</b> for a new demand connection to our Distribution System where the highest voltage of the assets at the POC and associated works is more than 22 kilovolts but not more than 72 kilovolts.	Within fifty Working Days of receiving the request
(f) Other connections: for a new demand connection or generation connection to our Distribution System that is not included within the preceding sub-paragraphs.	Within sixty-five Working Days of receiving the request

#### 2.1.24. Small Scale Embedded Generation

Small Scale Embedded Generation (SSEG) is defined as a source of electrical energy with a rating up to and including 16 Amperes per phase, single or multi-phase LV, and designed to operate in parallel with our Distribution System. If you install a SSEG unit (typically domestic combined heat and power units, domestic photovoltaic and domestic wind turbines), you must, in accordance with statutory requirements, advise us of your intention to utilise the SSEG installation no later than 28 days (inclusive of the day of commissioning), after its commissioning.

Engineering Recommendation G98 entitled “Recommendations for the Connection of Type Tested Small-Scale Embedded Generators (Up to 16A per phase) in Parallel with Low-Voltage Distribution Systems” is published by the Energy Networks Association (ENA). It sets out the technical requirements for the connection of SSEG units. For further information visit the ENA website. ([www.energynetworks.org](http://www.energynetworks.org)).

For the connections of other types of generators please follow the process above so we can make an offer to connect your generator.

#### 2.1.25. Embedded Networks

Any person wishing to build a distribution network requiring a connection to our Distribution System should apply to us using the processes set out in this Section 2.

We accept and shall work to Engineering Recommendation G88 entitled; “Principles for the planning, connection and operation of electricity distribution networks at the interface between Distribution Network Operators (DNOs) and Independent Distribution Network Operators (IDNOs)”, published by the ENA. For further information visit the ENA website: [www.energynetworks.org](http://www.energynetworks.org)

A Bilateral Connection Agreement will be required between us and the connected party, setting down the specific terms and conditions that will govern the connection of the distribution network to our Distribution System once the connection works are completed. While such terms and conditions will be consistent with our Connection Charging Methodology, the Bilateral Connection Agreement will take precedence.

### 3. Further Information on Connection Applications

This section sets out further information with regards to obtaining a connection to our Distribution System.

#### 3.1.1. Connection Offer and Point of Connection Offer Validity Periods

Any Connection Offer given will normally be open for acceptance for ninety days from the date on the letter. This is the Validity Period. After that period the Connection Offer will expire and will no longer be open for acceptance. The Connection Offer is also provided on the understanding that the connection works are started and completed within a determined period of time. This period will vary depending on the type and complexity of the connection works required. If, following acceptance of the Connection Offer, the connection works are not:

- completed within the determined period of time,
- progressed in accordance with agreed milestones

and such failure to complete or progress the connection works is due to any act of default or omission by you or your agents, we reserve the right to withdraw the Connection/Point of Connection Offer and make a new Connection/Point of Connection Offer under such terms and conditions as are appropriate at the time.

#### 3.1.2. Contestable Work

We consider the following work to be Contestable with regards to our Distribution System and as such the work may be carried out in its entirety by a suitably accredited ICP:

- assessment of a point of connection;
- design of the Contestable Work;
- the procurement and provision of equipment and materials to our current specification for the Contestable Work;
- trenching and other preparation of the site, including the circuit routes between the development and the Point of Connection;
- construction of the Contestable Work; determining the Point of Connection to our Distribution System at LV and HV unless expressly considered non-contestable;
- connection of Contestable Works to the Distribution System and their Energisation (at LV and HV only);
- recording of work done and of the location of cable routes and other equipment on site or elsewhere (where those assets are installed by the ICP), and the provision of this information by us;
- provision and installation of HV switchgear, including any plant or equipment required for the automation of our networks, in accordance with our technical specifications;
- reinstatement (both temporary, if appropriate, and permanent);
- making provision for the installation of metering equipment; and
- Land Rights negotiations to our standard terms.

Under certain circumstances and at our sole discretion, we may agree that you undertake part of the Contestable Works whilst we carry out the remainder where it is practical to do so.

The Contestable design element must comply with the appropriate part of Engineering Recommendation G81 and any of our specific requirements. Following receipt of the design of the Contestable Work we shall either provide written confirmation of approval or explanation for rejection. Such approval shall not be unreasonably withheld. A charge will not be made for approval of any design work undertaken by an ICP. Where the Contestable design has been undertaken by a suitably accredited ICP we shall not be required to approve the design.

We may, on occasion, request the ICP to include additional features in the design. Such requests shall be made in writing and as soon as is reasonably practicable. Where the ICP accepts this request we will meet the agreed additional cost.

The specification for design, materials, installation and recording, is governed by Engineering Recommendation G81, a seven part national framework document administered by the Energy Networks Association that is designed to be supplemented by our specific appendices. Any ICP carrying out such Contestable Work must comply with the specification. The seven parts comprise:

For green field and brown field housing estates:

Part 1: Framework for Design and Planning

Part 2: Framework for Materials Specification

Part 3: Framework for Installation and Records

For industrial and commercial connections:

Part 4: Framework for Design and Planning

Part 5: Framework for Materials Specification

Part 6: Framework for Installation and Records

All of the above must be read in conjunction with our corresponding suite of appendices that supplement Engineering Recommendation G81.

For diversionary and Reinforcement works:

Part 7: Framework for contestable diversionary and Reinforcement underground and overhead works not exceeding 33kV.

These documents are available to view on the ENA website at: [www.energynetworks.org](http://www.energynetworks.org)

### 3.1.3. Non-Contestable Work

We consider that the following works in respect of our Distribution System are deemed to be Non Contestable and, as such, can only be carried out by us or our appointed agents:

- Processing your application and Distribution System planning for the connection;
- Deciding upon the Point of Connection to the Distribution System in exceptional circumstances as may be published from time to time (Only available to ICP's authorized to self determine POC's)
- Connection of the Contestable Work to the Distribution System other than at LV or HV;
- Design, planning and specification of any works for Reinforcement of our Distribution System;
- Carrying out of any works for Reinforcement of our Distribution System where the conditions for such work being Contestable Work are not met. Reinforcement (other than design and specification) and diversionary works may be contested when associated with the provision of a connection and subject to the circumstances in paragraph 3.9;
- Design, planning and specification of any works for the diversion of the Distribution System, where the conditions for such activity being Contestable Work are not met (the design of diversionary works may be Contestable when associated with the provision of a connection and subject to the circumstances described in paragraph 3.9);
- Removal and/or the diversion of existing Electrical Plant and Electric Lines when they are not related to the contestable works.

The following works in respect of Contestable Works are deemed to be Non-Contestable:

- Specification of the design and installation criteria and materials to be used for Contestable Works;
- Concluding any Land Rights and consents that we require;
- Approval of the ICP's design where the ICP does not have the necessary accreditation or does not wish to self-approve the design;
- Operational activity associated with the connection of Extension Assets or diverted assets to the Distribution System;
- Operation, repair and maintenance of the Electrical Plant and the Electric Lines following adoption by us;
- Inspection, monitoring and testing of any contestable work.

### 3.1.4. Contestable Reinforcement and Diversionary Work

Certain types of Reinforcement and diversionary work on our Distribution System may also be carried out by suitably accredited ICPs for adoption by us. The scope of such work is limited to Reinforcement and diversionary works, associated with a connection, which:

- are new works that are physically and electrically separate from our existing Distribution System;
- do not require access to our existing operational areas;
- are fully funded by the single third party who is seeking the connection; and
- are restricted to works to install underground cables at voltage levels not exceeding 33kV and works to install HV/LV distribution substations.

In the circumstances above, a suitably accredited ICP may also carry out the connection of diverted assets to the Distribution System and their Energisation where the connection is made at LV or HV by live jointing to an underground cable section of the Distribution System (in areas where the LV Distribution System is operated on an interconnected basis we will need to carry out operational activity before the live jointing may commence).

The design of Reinforcement works can require a large volume of information that would need to be made available to allow the ICP to carry out such design works which is likely to outweigh the benefits of including design work within the scope of contestability. The design of connection Reinforcement therefore remains Non-Contestable.

Where Reinforcement or diversionary work is required on the Distribution System of another LDNO then you or your ICP will be required to liaise directly with the relevant LDNO.

If you wish to increase or decrease the Required Capacity of an existing connection you can make a request by submitting an Application to us at the address given in Section 1.

Any request to increase the Required Capacity will be considered by us and you will be informed whether the additional load is immediately available or whether Reinforcement work must first be carried out. Any costs for reinforcing our Distribution System will be charged for in accordance with this document.

Any increase or decrease in Required Capacity shall normally be formally agreed by the implementation or variation of a Connection Agreement.

No decrease in Required Capacity for import shall take effect earlier than twelve months from the date of original connection, or twelve months from the last variation made to the Required Capacity.

### **3.1.5. Contestable Reinforcement and Diversionary Work**

An electrical installer may request we temporarily De-energise and subsequently Re-energise our Distribution System to enable that person to work on your own wiring and equipment safely. We typically require notice of at least 10 working days to provide this service and a charge may apply.

### **3.1.6. Capacity of Domestic Connections**

All new domestic connections for non-electrically heated dwellings will have the ability to deliver a maximum demand capacity of 15kW, unless agreed otherwise with the applicant. (This does not imply that a generator with a rated output of 15kW can be accepted on that connection).

### **3.1.7. Large Low Voltage Connections**



We will normally provide connections with a maximum demand capacity of up to 1000kVA at low voltage. However, we will take into account your particular requirements for a connection at high voltage and any disturbing loads (such as large motors or welding equipment) you wish to connect, together with the possibility of any future load increase in determining the voltage at which the connection is given.

### 3.1.8. Available Capacity

The capacity available on our existing Distribution System will be determined on the basis of capacity that is currently available and which is not currently covered under any existing Connection Agreement, Adoption Agreement or other commercial contract or agreement as may be considered to have reserved capacity.

### 3.1.9. Helpful Advice for Reducing Your Connection Charge

Your Connection Charge will, normally, be based on the estimated costs of the Minimum Scheme. However, we are happy to discuss with you ways of reducing your connection charge. The list below identifies some of these which you may wish to consider.

If you can provide full details of your maximum power requirements when you make your application this will keep the time to a minimum in designing and producing a Connection Offer. Please remember that you have a legal obligation to provide all relevant information regarding your existing and/or proposed load details.

Connection Offers are provided subject to the availability of any necessary legal consents, however, if you are able to provide assistance in these matters, this may help to reduce your connection charge. Legal consents may be easier to obtain if all the equipment required for your connection will be situated within your land.

You may wish to consider carrying out the excavation works on your land, for instance the provision and installation of suitable ducts together with any road crossing ducts as necessary. Accepting a service position as close to the distribution system as possible will result in the service cable length being kept to a minimum which in turn will reduce the amount charged by us.

If a substation is required for your connection(s) you may wish to consider the following:

- Can the substation site/land be provided at no cost to us? Is the substation site to be provided in the optimum position? (this will be in agreement with us)
- Can you construct a substation base and building? (these will be in accordance with our specifications)
- Can you provide suitable routes for any cables across your property?

## 4. SECTION 4. CONNECTION CHARGING METHODOLOGY

This section sets out the common connection charging methodology that is implemented to ensure a consistent approach in the way your connection charge is calculated.

### 4.1.1. Payment Terms

The Connection Charge is normally payable in full in advance of Energisation of the Connection Works. For simple service connections, where work is minimal, we recommend that payment is made at the same time as you accept our Connection/Point of Connection Offer as this will expedite the programming of the work. The Connection Charge will be payable in stages in the case of a phased development, or connections requiring major electrical infrastructure, e.g. a

housing estate, large commercial development, or large generator. An initial payment may be required at the time you accept the Connection/Point of Connection Offer and further payment will be required by instalment to coincide with our incidences of expenditure.

#### 4.1.2. Minimum Scheme

The Minimum Scheme is the scheme with the lowest overall capital cost (as estimated by us), solely to provide the Required Capacity. The Minimum Scheme will be subject to:

- Accepted industry standards, including the requirements of the Distribution Code;
- The status and configuration of the Relevant Section of the Network (RSN);
- The standard sizes and types of equipment currently used by us On our Distribution System which shall be reasonable in all circumstances;
- Maintaining our ability to minimise regulatory penalties associated with the Guaranteed Standards of Performance; and
- Where the Customer is an LDNO, maintaining the Customer's ability to minimise regulatory penalties associated with the Guaranteed Standards of Performance.

The Minimum Scheme shall also be consistent with our statutory and license obligations including the requirement to develop, maintain and operate efficient, co-ordinated and economical electricity Distribution Systems.

We will make available our design policies and standards as appropriate.

Subject to Section 5 below, we will calculate the Connection Charge based on the estimated costs of the Minimum Scheme.

#### 4.1.3. Enhanced Scheme

In certain circumstances we may decide to design an Enhanced Scheme. This may include one or more of the following:

- Additional assets not required as part of the Minimum Scheme;
- Assets of a larger capacity than required by the Minimum Scheme;
- Assets of a different specification than required by the Minimum Scheme.

If we decide to design an Enhanced Scheme, the Connection Charge that we apply will be the lower of the Connection Charge associated with the Minimum Scheme and those associated with the Enhanced Scheme.

There may be certain circumstances, such as where you require us to undertake work that is over and above that of the Minimum Scheme, where we may require you to contribute to, or pay in full, the costs of the Enhanced Scheme.

#### 4.1.4. Costs

We may recover the reasonable costs incurred, both directly and indirectly in providing a connection and may, where permitted by our license, apply a reasonable margin. The factors taken into account by us to calculate the Connection Charge will include, but are not limited to:

- Industry standards governing the Distribution System;
- The Required Capacity;
- Available capacity of the existing Distribution System;
- Whether any necessary extension or reinforcement of the existing Distribution System is by underground cable.
- Whether any diversionary works are required as a result of the developments and required disconnection of any assets;
- The length of cable required;
- Type of ground requiring excavation, the type and extent of the reinstatement necessary (including New Roads and Street Works Act (NRSWA) requirements and any other relevant legislation), and the need for road, bridge crossings etc.;
- Any Electrical Plant and civil costs required, allowing for any civil works undertaken by you with our agreement;
- The requirement to work outside of normal working hours;
- The cost of undertaking the design, if applicable
- The costs of securing wayleaves/easements for plant and cable including any consents;
- The costs of securing suitable substation sites including any necessary Land Rights;
- The costs of public enquiries and environmental impact studies;
- Charges for any other costs associated with the work on Sites of Special Scientific Interest (SSSI), railway lines etc.;
- Any variations in respect of the actual costs that were reasonably incurred as specified in the Connection Offer;
- Costs associated with NRSWA noticing

#### 4.1.5. Cost Allocation

The costs charged to you as a connection charge may be split into three categories:

- Costs for providing the connection, which is to be paid in full by you.
- Costs for providing the connection which are to be apportioned between you and us.
- Cost to be paid by you in respect of works that have been previously constructed or are committed and are used to provide the connection, namely ECCR charges as detailed on page 33.

Some costs may be borne in full by us and will not be included in your Connection Charge (see Section 4).

#### 4.1.6. Costs To Be Paid In Full By You

The costs of providing Extension Assets will be charged in full to you.

Where you have requirements for additional security or the characteristics of your load requires us to install assets in excess of the Minimum Scheme then you will be required to pay in full the costs that are in excess of the Minimum Scheme. Where you have requested a three-phase connection and/or a supply voltage that is not necessary to meet the Required Capacity and the local Distribution System is not of the requested number of phases and/or voltage, then

you will be required to pay in full the cost of Reinforcement of the Distribution System to your specified number of phases/and/or voltage.

The costs of the future operation and maintenance of any additional assets requested by you (i.e., assets provided over and above those associated with the Minimum Scheme) will be payable in full by you. This will normally be levied as a one-off charge representing the net present value of the future operation and maintenance costs as calculated as a percentage (specified in Section 6) of the additional capital cost of the Scheme.

Work required to reconfigure the Distribution System to meet your requirements where no additional Network or Fault Level Capacity is made available shall be charged in full to you. See Example 8D.

Where the Extension Assets would normally require the extension of existing switchgear equipment and this is not possible, the costs of the full replacement of the switchgear (using the nearest standard size) will be charged to you, provided that there is no Reinforcement of the Distribution System (see Section 5).

For generation connections only, Reinforcement costs in excess of the high-cost project threshold of £200/kW shall be charged to you in full as a connection charge.

To facilitate the Maximum Capacity requested by you in your connection application, we may be required to pay additional charges to the operator of the Distribution System to which our network connects. The upstream network operator will be required to calculate these charges in accordance with their connection charging methodology. Where we receive charges from the upstream network operator, we will pass such charges on to you as part of the overall Connection Charge. The rules for apportionment described below will not apply. See Example 14 further within this document.

At the time of publication of this document, we do not have any connections to the Transmission System. However, should your connection result in any works being undertaken on the Transmission System then these costs will be calculated according to their methodology and included in your Connection Charge.

#### 4.1.7. Costs To Be Apportioned Between You And Us

Reinforcement is defined as assets installed that add capacity (network or fault level) to the existing shared use Distribution System. The costs of Reinforcement shall be apportioned between you and us. There are five exceptions to this rule. Where an exception applies Reinforcement will be treated as Extension Assets and costs will not be apportioned. These exceptions are described below and the application of exceptions 1, 2, 4, and 5 is demonstrated in the Examples.

Exception 1: Where the Reinforcement is:

- Downstream of the POC; and
- Over and above the Minimum Scheme; and
- Provided at our request; and
- Provided by connecting two points on the existing Distribution System; and
- There is little or no prospect of the capacity created being required within the next five years.

then the apportionment rules will not apply. You will be required to pay the costs associated with the Minimum Scheme and we will pay the costs over and above the Minimum Scheme. See Example 2B.

Exception 2: Where the Reinforcement is in excess of the Minimum Scheme and is at your request, the Reinforcement will be treated as Extension Assets and the apportionment rules will not apply. The costs in excess of the Minimum Scheme will be borne in full by you.

Exception 3: Where the Reinforcement is provided to accommodate a Temporary Connection, the Reinforcement will be treated as Extension Assets and the apportionment rules will not apply. The costs associated with the Temporary Connection will be borne in full by you. Temporary Connections are defined as connections that are only required for a period of up to five years but exclude connections to provide the initial connection to a development, where the Reinforcement will subsequently be required for the permanent connection.

Exception 4: Where the replacement of switchgear results in an increase in fault level capacity and:

- That increase is solely as a result of the fault level rating of the standard switchgear equipment used by us being higher than that of the existing switchgear; and
- That increase in fault level capacity is not needed to accommodate your connection.

then, unless the switchgear adds network capacity and the Security Cost Apportionment Factor (CAF) applies, the switchgear replacement will be treated as Extension Assets and the apportionment rules will not apply. You will be required to pay the full cost of the switchgear replacement. See Example 7B.

Exception 5: Where the Reinforcement:

- Is provided by connecting two points on the existing distribution system; and
- Is providing connection is to a development with a number of Entry/ Exit Points,

then the additional network length (measured from suitable points close to the site boundaries which would allow for a clear demarcation of Contestable and Non- Contestable Work) required to provide connectivity within the development will be considered to be Extension Assets and the apportionment rules will not apply. You will pay the full cost of the additional network length. See Example 8A.

For avoidance of doubt, where Reinforcement costs are borne by you and any capacity created is used to accommodate new or increased connections within the Electricity Connections Charges Regulations (ECCR) Prescribed Period, then the provisions of the ECCR will apply.

The costs of Reinforcement will be apportioned using one of two Cost Apportionment Factors (CAFs), dependent upon which factor is driving the requirement for Reinforcement:

- The 'Security CAF'; and
- The 'Fault Level CAF'

The following definitions are used in the application of the CAFs:

Existing Capacity	<p>For existing Customers their Existing Capacity will be either: -</p> <p>a) The Chargeable Capacity used in the calculation of their use of system charges; or</p> <p>b) For Customers who are not charged for use of system on the basis of their Chargeable Capacity the lower of:</p> <ul style="list-style-type: none"> <li>• No. of phases x nominal phase-neutral voltage (kV) x fuse rating (A); and</li> <li>• The rating of the service equipment.</li> </ul>
-------------------	--

Fault Level Contribution from Connection	is the assessment of the Fault Level contribution from the equipment to be connected taking account of its impact at the appropriate point on the Distribution System. Where an existing Customer requests a change to a connection then the “Fault Level Contribution from Connection” is defined as the incremental increase in Fault Level caused by the Customer.
New Fault Level Capacity	is the Fault Level rating, following Reinforcement, of the equipment installed after taking account of any restrictions imposed by the local network Fault Level capacity. For the avoidance of doubt this rule will be used for all equipment types and voltages.
New Network Capacity	<p>is either the secure or non-secure capacity of the Relevant Section of Network (RSN) following Reinforcement. Whether secure or non-secure capacity is applicable depends upon the type of capacity that can be provided from the RSN. For example, if the capacity provided to the Customer by the RSN is secure, but the capacity requested by the Customer at the point of connection is non-secure, the secure capacity will be used. See Example 12.</p> <p>The capacity to be used will be based on our assessment of the thermal ratings, voltage drop and upstream restrictions and compliance with our relevant design, planning and security of supply policies. The equipment ratings to be used are the appropriate operational rating at the time of the most onerous operational conditions taking account of seasonal ratings and demand.</p>

Relevant Section of Network (RSN)	<p>is that part or parts of the Distribution System which require(s) Reinforcement. Normally this will comprise:</p> <ul style="list-style-type: none"> <li>the existing assets, at the voltage level that is being reinforced, that would have been used to supply you (so far as they have not been replaced) had sufficient capacity been available to connect you without Reinforcement; and/or</li> <li>the new assets, at the same voltage level, that are to be provided by way of Reinforcement.</li> </ul> <p>Where it is unclear what assets would have supplied the Customer in the event that sufficient capacity had been available, the existing individual assets with the closest rating to the new assets will be used. See Example 13.</p> <p>There may be more than one RSN (e.g., at different voltage levels).</p>
Required Capacity	<p>is the Maximum Capacity agreed with the customer. In the case of multiple connections (e.g. a housing development) it may be adjusted after consideration of the effects of diversity. Where an existing Customer requests an increase in capacity then it is the increase above their Existing Capacity.</p>

The 'Security CAF' is applied, where the costs are driven by either thermal capacity or voltage (or both) as assessed against the relevant standard. This rule determines the proportion of the Reinforcement costs that should be paid by you as detailed below.

$$\text{Security CAF} = \frac{\text{Required Capacity}}{\text{New Network Capacity}} \times 100\% \quad (\text{max } 100\%)$$

The 'Fault Level CAF' is applied, where the costs are driven by Fault Level restrictions. This rule determines the proportion of the Reinforcement costs that should be paid by you as detailed below.

$$\text{Fault Level CAF} = 3 \times \frac{\text{Fault Level Contribution from Connection}}{\text{Fault Level Capacity}} \times 100\% \quad (\text{max } 100\%)$$

For clarity, where you require an augmentation to an existing connection, both the Security and Fault Level CAFs will be based on the increase in Required Capacity and increase in Fault Level Contribution from the connection respectively. Any related increases within the previous three-year period will be taken into account in determining the increase in the Required Capacity or increase in the Fault Level Contribution from the connection to be applied within the CAF.

On some Schemes there may be interaction between the two rules. In such cases, the 'Security' CAF will be applied to costs that are driven by the security requirement. The 'Fault Level CAF' will be applied to costs that are driven by Fault Level requirements. See the Examples for illustrations on the application of the CAFs.

#### 4.1.8. Recovery of Costs For Previous Works

Where, in order to provide your connection:

- We propose to utilise existing Distribution System assets that were previously installed to provide a connection to another Customer; and
- The other Customer has paid us (either in part or in full) a Connection Charge for those assets or paid an ICP for those assets which were then adopted by us; then,

you may be required to make a payment towards them. The ECCR prescribes the circumstances where such payment is required. Charges for such works only apply where the new connection is provided within the ECCR Prescribed Period.

#### 4.1.9. Costs To Be Paid In Full By Us

Where assets are installed at our request that are above the cost of the Minimum Scheme then you will be required pay the costs associated with the Minimum Scheme and we will pay the costs over and above the Minimum Scheme.

We will fully fund Reinforcement carried out greater than one voltage level above the voltage at the POC to the existing Distribution System.

We will fully fund Reinforcement carried out to allow the installation of all equipment at an existing premise which remain connected via an existing low-voltage single, two or three phase service fused at 100 amperes or less per phase which is metered with whole-current metering; provided that (to the extent relevant):

The Reinforcement is carried out to allow the installation of equipment as part of a single application for a single or multiple installations;

Any and all electricity generation equipment installed has a rated output not greater than 16 amperes per phase (or not greater than 16 amperes per phase at any single premises if a single application for multiple installations);

Any and all equipment installed which does not constitute a modification to the existing service conforms with the technical requirements of the following standards (notwithstanding that the equipment may have an input current that is more than 16 amperes per phase):



- BS EN 61000-3-2 Electromagnetic compatibility (EMC). Limits. Limits for harmonic current emissions (equipment input current  $\leq 16$  A per phase); and
- BS EN 61000-3-3 Electromagnetic compatibility (EMC). Limits. Limitation of voltage changes, voltage fluctuations and flicker in public low-voltage supply systems, for equipment with rated current  $\leq 16$  A per phase and not subject to conditional connection

Where it is necessary to modify a low-voltage single phase looped service for an existing premise, this shall be considered to have remained connected.

Where another LDNO with a distribution network that is connected to our Distribution System requires an increase in capacity to its distribution network, the voltage at the POC for assessing the one voltage rule will be:

- In the case of a new extension to the network of the other LDNO, the voltage of connection at which the Extension Assets will connect to the other LDNO's network; or
- In the case of additional capacity required in respect of a Customer connected to the existing assets of the LDNO, the voltage at which the Customer connects to the LDNO's network; or
- In the case of additional capacity required to meet general load growth on the LDNO's network then the Reinforcement costs will be borne by us. The LDNO will be required to provide justification in such circumstances.

The table below illustrates the application of the one voltage rule in relation to Reinforcement. You will not be required to contribute towards the cost of any Reinforcement provided at one voltage level above the Point of Connection up to and including the cost of circuit breakers provided at that voltage.

Voltage at the Point of Connection				
Voltage of Scheme Assets	LV (below 1000V)	HV (above 1kV but less than 22kV)	EHV (above 22kV but less than 72kV)	132kV
132kV Network	We Fund	We fund <sup>1</sup>	Apportioned	Apportioned
132kV/EHV Substation	We Fund	EHV circuit breakers only Apportioned	Apportioned	Not applicable
EHV Network	We Fund	Apportioned	Apportioned	Not applicable
132kV/HV Substation	HV circuit breakers on Apportioned	Apportioned	Not applicable	Not applicable
EHV/HV Substation	HV circuit breakers on Apportioned	Apportioned	Not applicable	Not applicable
HV Network	Apportioned	Apportioned	Not applicable	Not applicable
HV/LV Substation	Apportioned	Not applicable	Not applicable	Not applicable
LV Network	Apportioned	Not applicable	Not applicable	Not applicable

<sup>1</sup> Except where there is direct transformation from 132kV to HV when the costs are apportioned

#### 4.1.10. Recovered Equipment and Deferment of Asset Replacement

Normally, you will not receive any credit for the value of any equipment recovered by us as a result of the connection unless agreed otherwise.

You will not receive any credit for the value of any deferment of asset renewal expenditure by us.

#### 4.1.11. Rebates

For Distribution System assets where you have paid in full, then you may be entitled to a future rebate of charges should another Customer connect to those assets. These circumstances are detailed in the ECCR.

For Distribution System assets where you have paid in proportion to your Required Capacity, then you are not entitled to a future rebate of charges should another Customer connect to those assets.

Your entitlement to receive payments under the ECCR only applies to connections made within the ECCR Prescribed Period from the first provision of the connection.

These provisions do not apply where your connection was made before 1 Jan 2018 and we have adopted the assets from an ICP. However, for connections made on or after 1 Jan 2018 these provisions do apply to assets we have adopted from an ICP (as further described in the ECCR).

#### 4.1.12. Speculative Developments

In the majority of cases, parties will be able to provide information that gives us certainty that the capacity requested will be largely utilised once the development has matured. We use the term 'Speculative Development' to describe those types of developments where we have significant uncertainty about:

- the nature or size of the development
- the type of premises to be connected (e.g., manufacturing, office/business use, warehousing, generation, domestic)
- the expected timescales over which the development will utilise the capacity requested.

More specifically, we may consider developments which have one or more of the following characteristics as speculative where:

- limited or no information is provided in respect of the detailed electrical load requirements for individual premises making up the development and as a consequence for the development as a whole;
- the proposed phasing and /or timing of the phasing of the development is unknown or unclear;

- a significant proportion of the capacity requested caters for future expansion rather than the immediate requirements of (an) end user(s);
- the capacity requested caters for future speculative phases of a development rather than the initial known phase(s) of the development; or
- only infrastructure is provided and where limited or no connections are provided to the premises of end users (e.g. high or low voltage mains being provided along a spine road).

In determining whether a development is considered as speculative we will take a holistic view of the development in relation to the load requested, the timing of the development and the scope of the development.

As an example, we may treat a connection request for ten large commercial units as speculative where the end users or types of end users are not yet known and therefore the load requirements for each of the premises is uncertain. In contrast a mixed development of residential plots, shops and a school is unlikely to be considered as speculative as there is a greater degree of certainty about what the overall electrical load of the development will be.

In considering the timing of the development we will consider, among other things, whether planning permission exists, the likelihood of the development progressing and any projected buildout phasing of the development that you provide us.

We will provide an explanation if we consider your development to be speculative. If you disagree with our decision, then we will be willing to consider any additional information you provide to us with more certainty about the requirements for your development.

Where we are asked to provide a connection to a speculative development then the cost of the work is charged in full. Additional charges to reflect ongoing operation, repair and maintenance costs may also be levied.

We may, at our sole discretion, allow capacity to be reserved on the infrastructure provided to service the speculative development on commercial terms agreed between you and us in respect of the development.

#### 4.1.13. Connection Alterations

When you request an alteration to your connection arrangements, including a change in the supply voltage, the costs will be charged in full to you. For the avoidance of doubt increases in the Required Capacity are dealt with in accordance with previous sections.

#### 4.1.14. National Grid Electricity Transmission (NGET) Charges

We have an obligation under the CUSC to discuss certain requests for connection or changes in connection with NGET. Such requests are typically for large electrical demand or generation projects. Under certain circumstances, as determined by NGET, they may apply charges to assess the potential impact on the transmission system of a request or the combined effect of a number of requests and these will be included in the Connection Charge, or through a separate mechanism agreed between you and us.

Subsequent to such assessment NGET may also require works to be undertaken on the GB Transmission System as a condition of the connection being permitted. In the event of NGET applying charges for these works, we will reflect these charges in our charges to you.

Should GB Transmission System works be required, NGET may apply a cancellation charge in the event that your project is cancelled or the capacity of your project reduces. NGET also calculates a secured amount in respect of this cancellation charge (being a percentage of the cancellation charge, which reduces at certain trigger points). We may ask you for security in respect of this cancellation charge, but we will not ask you for more than the secured amount calculated by NGET.

#### **4.1.15. Land Rights**

Where Land Rights are required from a third party, the cost of acquiring those rights will be included in either the Connection Charge to you or through a separate mechanism agreed between you and us.

If the Land Rights that we require cannot be obtained by negotiation, we may, following discussion with you, exercise our powers of compulsory purchase (Section 10 and Schedule 3 of the Act) or apply to the Secretary of State or the Scottish Government in Scotland for a 'necessary wayleave' (paragraphs 6-8 of Schedule 4 of the Act). If we do so, the costs that we incur, including those of the Lands Tribunal/ Lands Tribunal for Scotland (which determine issues of compensation) will be charged to you. The Lands Tribunal may award compensation to the landowner and/or anyone who holds an interest in the land and this will be included in the Connection Charge or through a separate mechanism agreed between you and us.

We require the transfer of the freehold or alternatively the grant of long leasehold of any substation site which forms part of the Contestable or Non-Contestable Works.

We require the grant of a permanent easement (deed of grant) for any Electric Line cable that forms part of the Contestable or Non-Contestable Works which does not fall within land deemed adopted highway.

#### **4.1.16. Unmetered Supplies**

For some street lighting and other installations, we may allow items of equipment to be connected to our Distribution System without a meter. This is subject to the equipment having a low and predictable pattern of consumption and meeting the requirements of The Electricity (Unmetered Supply) Regulations 2001.

Where we agree that a meter is not required the provision of such a connection is dependent on the owner entering into an unmetered Connection Agreement and providing and maintaining an auditable inventory, in a format agreed with us, so that an accurate estimate of the consumption can be produced.

Where certain criteria are met the provision of services for unmetered connections may be made via a time-based connection service charge, e.g. Rent-a-Jointer Services. This is subject to us entering into a contract with you for the provision of such services.

You may elect to appoint an accredited ICP to carry out the Contestable Work for unmetered connections. The ICP will be allowed to carry out live jointing on low voltage, underground cables. Where you use an ICP, arrangements must first be established as follows:

#### **4.1.17. Capacity Ramping for LDNOs**

For an LDNO the Required Capacity (expressed in kVA) is the Maximum Capacity to be provided at the boundary between the LDNO's distribution network and our Distribution System. This value will be agreed with us and stated in the Bilateral Connection Agreement for the relevant embedded network.

When a connection is provided to an LDNO the take-up of capacity may grow over a period of time as the site develops and individual customers are connected. In such circumstances, the Bilateral Connection Agreement shall include a phased Required Capacity based on the Development Phase.

During the Development Phase a review may be undertaken annually on the anniversary of the Energisation of the embedded network. Any unused capacity identified in such review may be released for use by other customers and the Maximum Capacity reduced to an agreed level within the Bilateral Connection Agreement.

The Required Capacity agreed with us as being required at the end of the Development Phase shall be used to determine the Required Capacity for determination of the Cost Apportionment Factors where applicable.

Should additional capacity subsequently be required, the LDNO may incur additional Connection Charges for any Reinforcement based on the increase in capacity.

#### **4.1.18. Disconnection and De-Energisation**

If we either Disconnect or De-energise your Entry/ Exit Point

- At the request of your Supplier; or
- Due to a failure of your Supplier to comply with the terms of the DCUSA

then the cost of such disconnection or De-energisation will be borne by your Supplier.

If we either Disconnect or De-energise your Entry/ Exit Point

- At your request; or
- Due to a failure by you to comply with the terms of your Connection Agreement

then the cost of such disconnection or De-energisation will be borne by you.

On termination of your Connection Agreement, we retain the right to remove our Electrical Plant and Electric Lines and charge you if we do so. Apparatus which is not cost effective for us to recover (e.g., Electric Lines laid underground) will normally be made safe and left at the Premises, but if you require us to remove them, the cost of removal will be payable by you. All such apparatus will remain our property unless otherwise agreed in writing.

#### **4.1.19. Adoption Payments**

When we adopt assets installed by an ICP we will (at LENL's discretion) offer an adoption payment in respect of those assets subject to the information that is provided.

#### **4.1.20. Competition in Connection Charges**

Where you choose to have any Contestable Work undertaken by an ICP, we levy Competition in Connection (CIC) Charges associated with the design approval, inspection and adoption of the Contestable Works as set out in Section 6 and Section 7.

## 5. WORKED EXAMPLES ILLUSTRATING THE APPLICATION OF THE CONNECTION CHARGING METHODOLOGY

The following examples are to illustrate the application of the Connection Charging Methodology and are not intended to provide an accurate estimate of the charges a person would become liable for in respect of the provision of a connection. The Examples do not necessarily represent the Minimum Scheme for a specific connection application.













The figures quoted in the examples are illustrative. Section 7 of this statement provides our charges and indicative costs to undertake various activities.

The Examples illustrate where we undertake both the Contestable and Non-Contestable Work. These costs will include the determination of the Point of Connection and assessment and design costs, though these may not be explicitly identified in the examples.

Where Contestable Work is undertaken by an ICP, we will not apply CIC Charges for services associated with the Contestable Works which would cover activities including design approval, inspection, and monitoring. For the avoidance of doubt, in each example, where an ICP undertakes the Contestable Work, our Connection Charge will include the cost of the Non-Contestable Work but exclude the cost of Contestable Work.

The examples are generic and standard for all LDNOs, but they do not represent the network analysis and subsequent design solutions that would be completed for an actual connection scheme. The actual designs are subject to our design policies.


### 5.1.1. Key to Illustrations

	Circuit Breaker (any voltage)
	Switch
	Transformer
	Joint on cable
	High voltage ring main unit
	Existing cable
	Proposed cable
	Normal Open Point (NOP)
	Generator Customer
	Demand Customer
	Point of Connection (POC)
	Sub Station



### 5.1.2. Example 1: A new connection to a domestic premise

A Customer requests a LV single phase connection to a new house. The Premises can be connected to an existing LV main cable in the street.

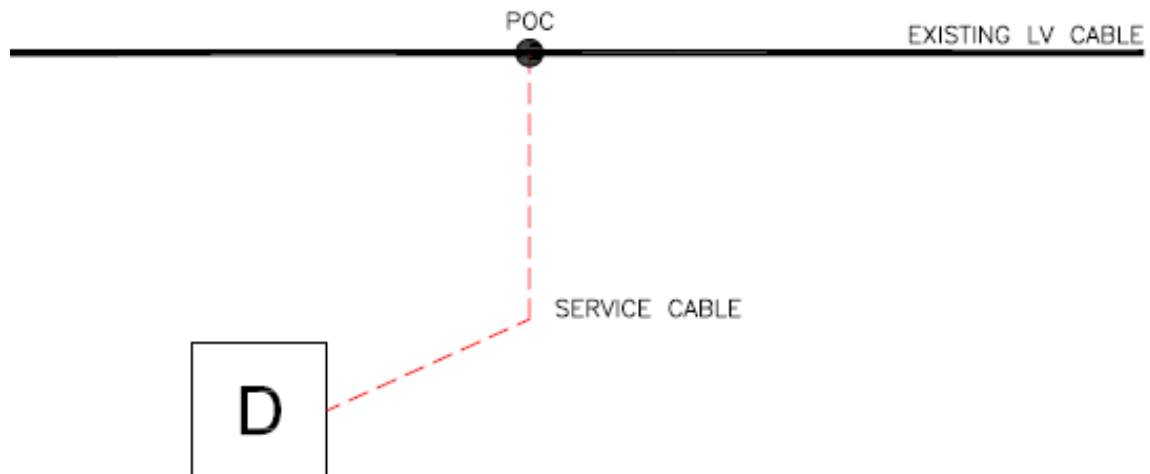

The Connection Charge for this Scheme is calculated as follows:


#### Extension Assets:

	Cost	Apportionment	Customer Contribution
<b>Contestable Work</b>			
15m service cable, excavation in footpath for joint hole to Customer laid duct, backfill and termination	£700	n/a	£700
<b>Non-Contestable Work</b>			
Single service breech joint	£400	n/a	£400
<b>Total Extension Asset Cost</b>			<b>£1,100</b>
CIC Charges			£100

**Total Connection Charges = £1,100**

5.1.3. Example 2A: New connections on a domestic housing development

A housing developer requests connections for 200 domestic Premises. The Required Capacity to supply the 200 homes is 250kVA. A new distribution substation will be established to provide the Required Capacity of the site. The Minimum Scheme requires the substation to be looped into the existing HV network.

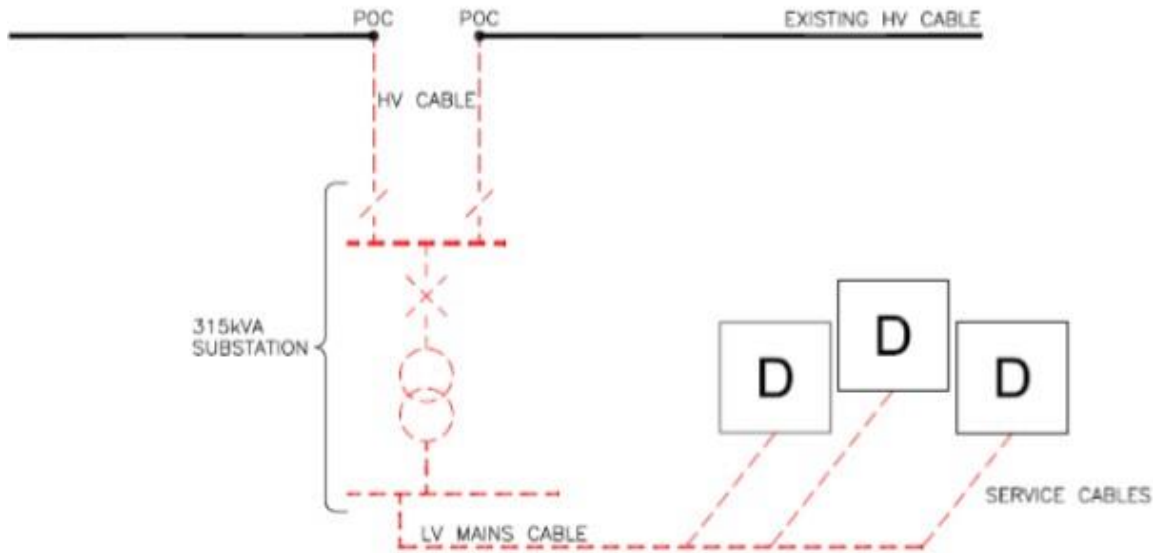

The Connection Charge for this Scheme is calculated as follows:


	Cost	Apportionment	Customer Contribution
<b>Contestable Work</b>			
Provision and installation 100m HV cable	£11,000	n/a	£11,000
315kVA substation	£24,000	n/a	£24,000
LV mains, service cables and terminations	£170,000	n/a	£170,000
<b>Non-Contestable Work</b>			
Two HV cable joints	£2,000	n/a	£2,000
<b>Total Extension Asset Cost</b>			<b>£207,000</b>
<b>CIC Charges</b>			£1,500

Total Connection Charge = £207,000

#### 5.1.4. Example 2B: New connections on a domestic housing development with interconnection.

This Example demonstrates the application of two of the exceptions to the apportionment rules, Exception 1 and Exception 2.

As in Example 2A, a housing developer requests connections for 200 domestic Premises. The Required Capacity to supply the 200 homes is 250kVA. A new distribution substation will be established to provide the Required Capacity of the site. The Minimum Scheme requires the substation to be looped into the existing HV network. However, in this Example there is an option to provide an additional LV cable to interconnect the distribution substation with the existing LV network. This option is over and above the Minimum Scheme.

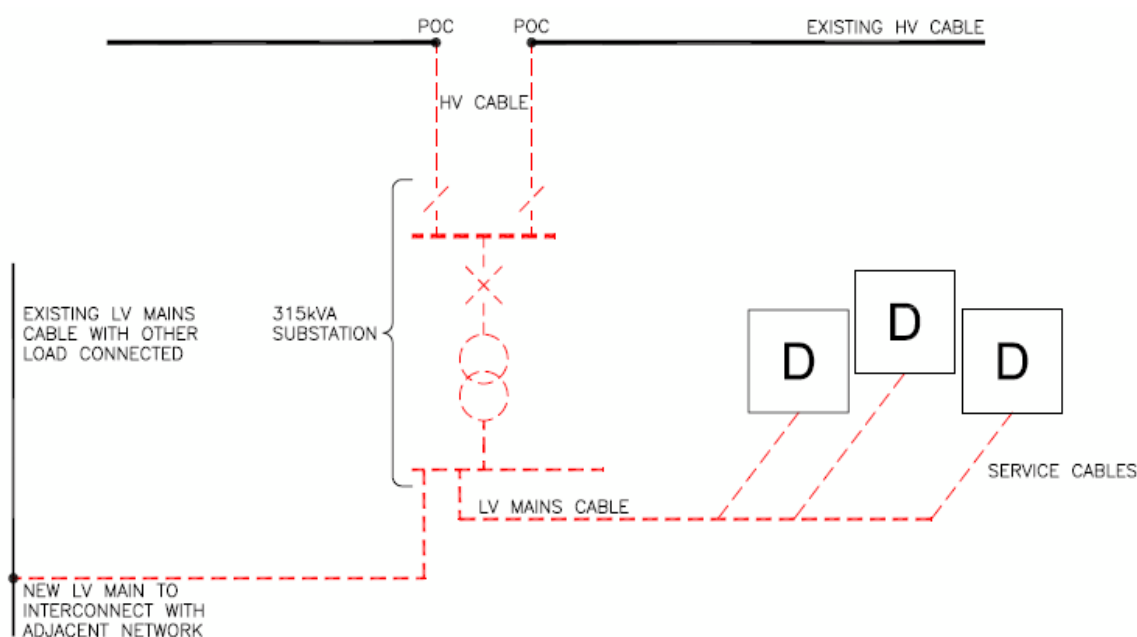

Interconnecting into the existing LV network will increase the capacity of the existing Distribution System. Therefore, the assets that connect the HV and LV network would normally be considered to be Reinforcement. These assets (as shown on the diagram above) include the HV cable, the 315kVA substation and the interconnecting LV main. They exclude the LV mains and service cables from the 315kVA substation to the Customer's development. However, whether these assets are to be considered Reinforcement or Extension Assets depends upon who requested the LV interconnection and whether any capacity created is likely to be used. One of three (a, b or c) scenarios will apply:

##### *a) The LV interconnection is requested by the Customer (Exception 2).*

In this case the Reinforcement is over and above the Minimum Scheme and requested by the Customer. Therefore, Exception 2 applies, and all assets (including the interconnecting LV cable) will be treated as Extension Assets and their costs will be borne in full by the Customer. As the interconnecting LV main and associated LV joint are over and above the Minimum Scheme, a charge for their future operation and maintenance will be made.

The Connection Charge for this Scheme is calculated as follows:

*Extension Assets:*

	Cost	Apportionment	Customer Contribution
<b>Contestable Works</b>			
Provision and installation 100m 11kV cable (from existing HV network to substation)	£11,000	n/a	£11,000
315kVA substation	£24,000	n/a	£24,000
LV mains, service cables and terminations (from substation to the Customer's development)	£170,000	n/a	£170,000
Interconnecting LV Cable (from substation to existing LV network)	£10,000	n/a	£10,000
<b>Non-Contestable Works</b>			
Two HV cable joints	£2,000	n/a	£2,000
LV cable joint	£1000	n/a	£1,000
Difference between Minimum and the actual Scheme is £11,000. Operation & Maintenance @20%* of £11,000		n/a	£2,200
<b>Total Extension Asset Cost</b>	£218,000		<b>£220,200</b>
CIC Charges			£1,500

**Total Connection Charge = £220,200**

\*Note, the 20% Operation and Maintenance figure is illustrative.

**b) The LV interconnection is requested by us to create additional network capacity (No exception).**

In this case, the assets connecting the existing HV and LV network add capacity to the existing network and none of the exceptions described will apply. Therefore, they will be treated as Reinforcement. The costs of the Reinforcement assets that form part of the Minimum Scheme (the HV cable and associated HV joints; the 315kVA substation) will be apportioned. The interconnecting LV cable and associated LV joint are considered to be Reinforcement but, as they are over and above the Minimum Scheme and requested by us, the costs will be borne in full by us.

### Reinforcement:

The RSN is that part or parts of the Distribution System that can be used to supply the Customer in both normal and abnormal running arrangements which, in this case, is the distribution substation and the HV Cables.

Security CAF calculation: the numerator in the CAF calculation is based upon the Required Capacity of the Customer, which is 250kVA. The denominator is based on the New Network Capacity following Reinforcement, which is 315kVA, i.e. the secure capacity of the distribution substation and HV cables.

The Connection Charge for this Scheme is calculated as follows:

### Reinforcement:

	Cost	Apportionment	Customer Contribution
<b>Non-Contestable Work</b>			
Provision and installation 100m 11kV cable (from existing HV network to substation)	£11,000	$250/315 \times 100\% = 79.4\%$	£8,730
315 kVA substation	£24,000	as above	£19,048
Two HV cable joints	£2,000	as above	£1,587
Interconnecting LV Cable (from substation to existing LV network)	£10,000	In excess of Minimum Scheme	£0
LV Cable Joint	£1,000	In excess of Minimum Scheme	£0
<b>Total Reinforcement Cost</b>	<b>£48,000</b>		<b>£29,365</b>

### Extension Assets:

	Cost	Apportionment	Customer Contribution
<b>Contestable Work</b>			
LV mains, service cables and terminations (from the substation to the Customer's development)	£170,000	n/a	£170,000
Total Extension Asset Cost	£170,000		£170,000
CIC Charges			£1,500

**Total Connection Charge = £29,365 + £170,000 = £199,365**

**c) The LV interconnection is requested by us but there is little prospect of the capacity created being used**

**(Exception 1).**

In this case all the requirements of Exception 1 are met so the assets that connect the existing HV and LV Distribution System will be treated as Extension Assets and their costs will not be apportioned. The Customer will pay the costs associated with the Minimum Scheme in full. The interconnecting LV cable and associated LV joint as they are over and above the Minimum Scheme and requested by us, therefore the costs will be borne in full by us.

The Connection Charge for this Scheme is calculated as follows:

*Extension Assets:*


	Cost	Apportionment	Customer Contribution
<b>Contestable Works</b>			
Provision and installation 100m 11kV cable (from existing HV network to substation)	£11,000	n/a	£11,000
315 kVA substation	£24,000	n/a	£24,000
LV mains, service cables and termination (from substation to the Customer's development)	£170,000	n/a	£170,000
<b>Non-Contestable Works</b>			
Two HV cable joints	£2,000	n/a	£2,000
Interconnecting LV Cable (from substation to existing LV network)	£10,000	In excess of Minimum Scheme	£0
LV Cable Joint	£1000	In excess of Minimum Scheme	£0
<b>Total Extension Asset Cost</b>	<b>£218,000</b>		<b>£207,000</b>
CIC Charges			£1,500

**Total Connection Charge = £207,000**

### 5.1.5. Example 3: A new connection to commercial Premises

A Customer requests a new LV three phase 600kVA connection to commercial Premises. Four scenarios for connection are considered below. The Minimum Scheme will be dependent on the specific circumstances as set out in Section 4.

*a) Where the Minimum Scheme is a new 800kVA substation teed onto the existing HV network.*

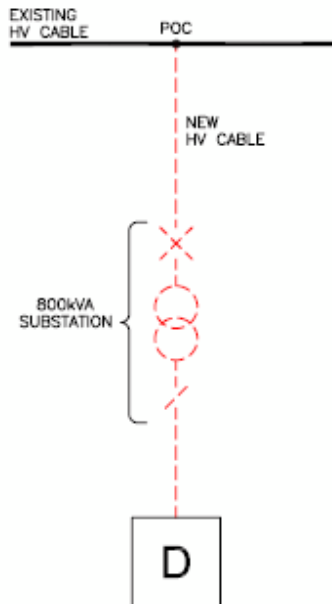

The Connection Charge for this Scheme is calculated as follows:


*Extension Assets:*

	Cost	Apportionment	Customer Contribution
<b>Contestable Work</b>			
Provision and installation of 150m of HV cable	£30,000	n/a	£30,000
800kVA substation	£17,000	n/a	£17,000
Provision and installation LV cabling	£4,400	n/a	£4,400
Metering panel	£800	n/a	£800
<b>Non-Contestable Work</b>			
HV joint to network	£1,900	n/a	£1,900
<b>Total Extension Asset Cost</b>	<b>£54,100</b>		<b>£54,100</b>
CIC Charges			£1,500

**Total Connection Charge = £54,100**

In each of the following scenarios the Customer is connected with a looped connection, as illustrated in the following diagram.

*b) The Minimum Scheme is as for scenario a) above but the Customer requests an enhanced connection arrangement where the substation is looped into existing HV network.*

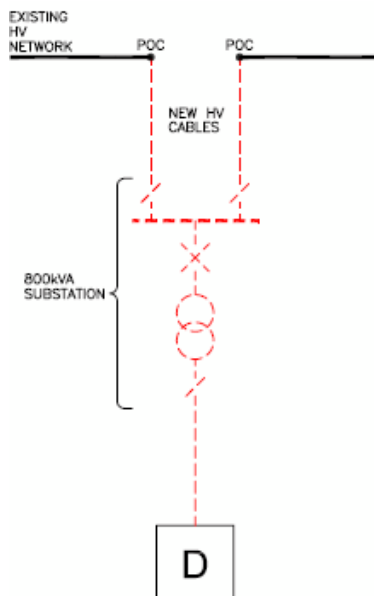

The Connection Charge for this Scheme is calculated as follows:

Extension Assets:

	Cost	Apportionment	Customer Contribution
<b>Contestable Work</b>			
Provision and installation of 300m of HV cable	£35,000	n/a	£35,000
800kVA substation	£20,000	n/a	£20,000
Provision and installation LV cabling	£4,400	n/a	£4,400
Metering panel	£800	n/a	£800
<b>Non-Contestable Work</b>			
HV joints to network	£2,900	n/a	£2,900
<b>Total Extension Asset Cost</b>	<b>£63,100</b>		<b>£63,100</b>
Difference between Minimum and the actual Scheme is £9,000. Operation & Maintenance @20%* of £9,000			£1,800
<b>Total Extension Asset Cost</b>			<b>£64,900</b>
CIC Charges			£1,500

**Total Connection Charge = £64,900**

*\*Note, the 20% Operation and Maintenance figure is illustrative.*



c) The Minimum Scheme is as for scenario a) above but we request an Enhanced Scheme where the substation is looped into the existing HV network.

The Connection Charge for this Scheme is calculated as follows:

Extension Assets:

	Cost	Apportionment	Customer Contribution
<b>Contestable Work</b>			
Provision and installation of 300m of HV cable looped to network, HV Ring Main Unit, 800kVA transformer	£35,000	Minimum Scheme	£30,000
800kVA substation	£20,000	Minimum Scheme	£17,000
Provision and installation LV cabling	£4,400	n/a	£4,400
Metering panel	£800	n/a	£800
<b>Non-Contestable Work</b>			
HV joints to network	£2,900	Minimum Scheme	£1,900
<b>Total Extension Asset Cost</b>	£63,100		£54,100
CIC Charges			£1,500

**Total Connection Charge = £54,100**

d) The Minimum Scheme is a new 800kVA substation looped into existing HV network.

The Connection Charge for this Scheme is calculated as follows:

Extension Assets:

	Cost	Apportionment	Customer Contribution
<b>Contestable Work</b>			
Provision and installation of 300m of HV cable looped to network, HV Ring Main Unit, 800kVA	£35,000	n/a	£35,000
800kVA substation	£20,000	n/a	£20,000
Provision and installation LV cabling	£4,400	n/a	£4,400
Metering panel	£800	n/a	£800
<b>Non-Contestable Work</b>			
HV joints to network	£2,900	n/a	£2,900

<b>Total Extension Asset Cost</b>	<b>£63,100</b>		<b>£63,100</b>
CIC Charges			£1,500


**Total Connection Charge = £63,100**

#### 5.1.6. Example 4: Additional load application for commercial Premises (requiring a new connection from the HV network)

A Customer requests to increase the Maximum Capacity of their existing LV connection from 200kVA to 850kVA; an increase of 650kVA (the Required Capacity).

As the Customer's existing LV connection is unable to deliver the Required Capacity a new connection will be required from the local HV network. This will be a non- secure connection to a secure network. The Minimum Scheme is to overlay part of the nearest HV circuit (Feeder 2) which only has spare capacity of 200kVA. The Reinforcement to make the capacity available requires 1200m of existing HV cable to be overlaid with a larger capacity cable.

Following the Reinforcement, the New Network Capacity will be 8000kVA (i.e. after Reinforcement, in this particular case, the section of cable with the lowest rating in the ring represented by Feeder 1 and Feeder 2 is rated at 8000kVA).

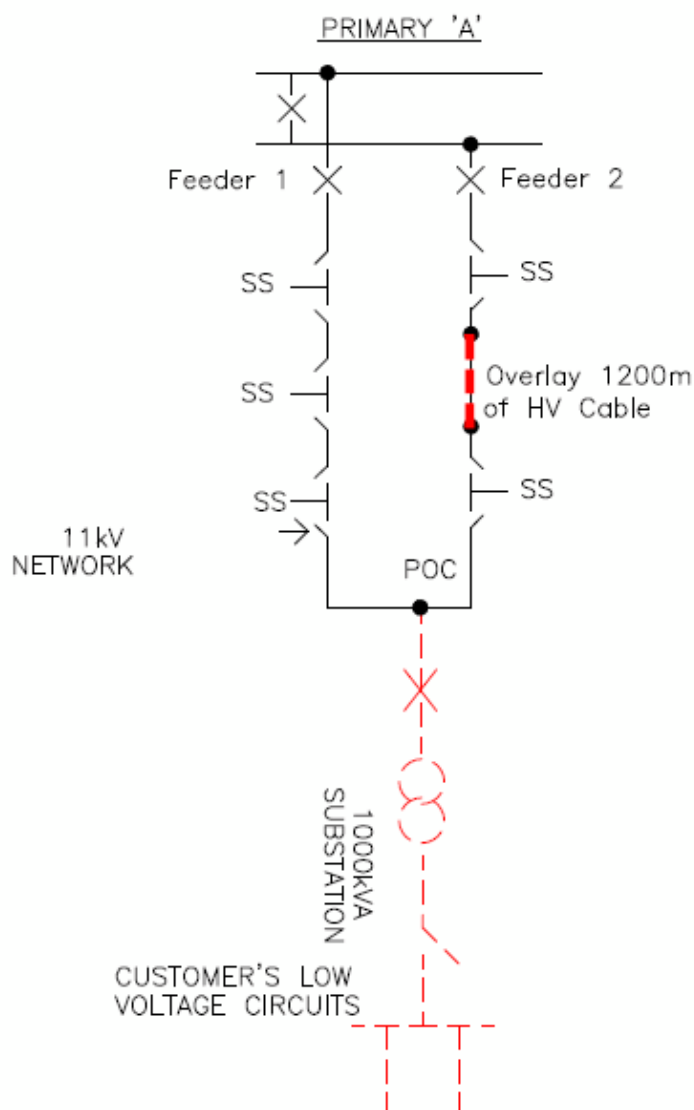

## Reinforcement

The RSN is the two-feeder ring comprising Feeder 1 and Feeder 2.

Security CAF calculation: As this request is from an existing customer the numerator in the CAF calculation is based upon the increment of capacity requested, i.e., 650kVA (850kVA – 200kVA). The denominator is based upon the New Network Capacity following the Reinforcement.

Fault Level CAF calculation: This Scheme does not have any significant Fault Level contribution to the existing shared use distribution network and the Fault Level CAF is therefore not applicable here.

The Connection Charge for this Scheme is calculated as follows:

### Reinforcement Costs:

	Cost	Apportionment	Customer Contribution
<b>Non-Contestable Work</b>			
Overlay 1200m of HV cable	£120,000	650/ 8000 X 100% = 8.1%	£9,750
HV Jointing	£4,800	As above	£390
<b>Total Reinforcement Cost</b>	<b>£124,800</b>		<b>£10,140</b>

### Extension Assets:

	Cost	Apportionment	Customer Contribution
<b>Contestable Work</b>			
Provision and installation HV cable	£29,000	n/a	£29,000
1000kVA substation	£20,000	n/a	£20,000
Termination of Customer's LV cables	£1,400	n/a	£1,400
LV Metering panel	£800	n/a	£800
<b>Non-Contestable Work</b>			
HV Jointing	£1,600	n/a	£1,600
<b>Total Extension Asset Cost</b>	<b>£52,800</b>		<b>£52,800</b>
CIC Charges			£1,100


**Total Connection Charge = £10,140 + £52,800 = £62,940**

### 5.1.7. Example 5: Connection of a new embedded generator that requires Reinforcement involving Security and Fault Level CAFs.

A Customer requests a connection to a generator with a Required Capacity for export purposes of 3MVA. The Fault Level contribution at the primary substation from the generation connection is 10MVA.

The Point of Connection is to the existing HV network at point B and it is proposed to install 500m of HV underground cable from the Point of Connection to the Customer's installation. This is a non-secure connection that requires reinforcement of a non-secure network.

The connection requires the Reinforcement of 500m of HV overhead line between points A and B for a thermal capacity requirement and replacement of the existing 11 panel HV switchboard at the primary substation in order to increase its fault level rating from 150MVA to 350MVA. However, the new fault level will be limited by the fault level rating of the local network of 250MVA.

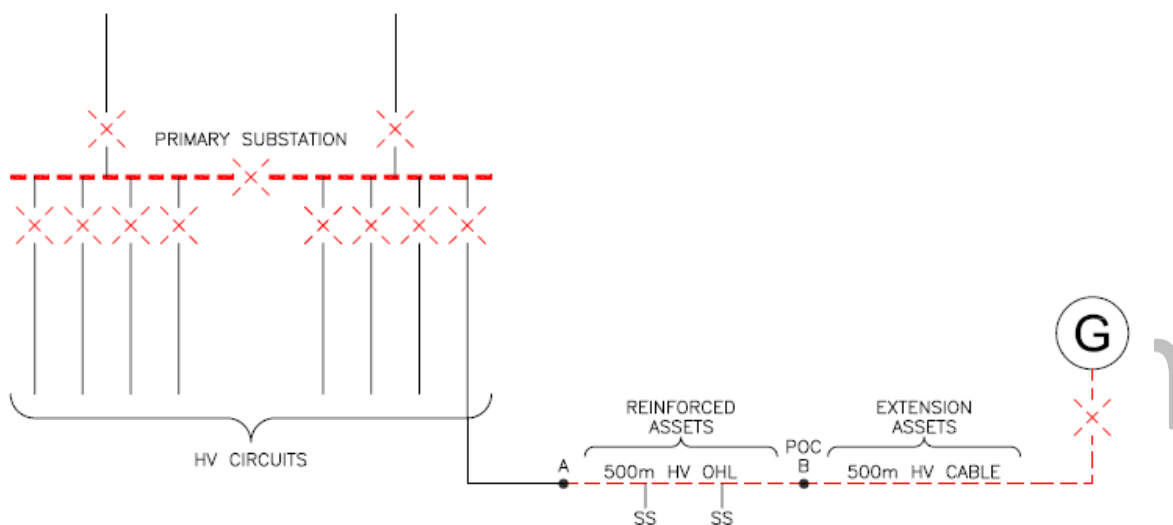

#### Reinforcement:

The RSN is the HV network from the primary substation to Point B.

Security CAF calculation: the numerator in the CAF calculation is based upon the Required Capacity of the Customer, i.e., 3MVA. The denominator is based on the New Network Capacity following Reinforcement, which is 7.6MVA, i.e. after Reinforcement, in this particular case, the section of cable with the lowest rating.

The RSN is the 11kV switchboard at the primary substation.

Fault Level CAF calculation: The numerator in the CAF calculation is based upon the Fault Level contribution from the Customer's new generator connection, in this Example 10MVA. The denominator is based upon the New Fault Level Capacity, which is the lower of the Fault Level capacity of the new HV switchboard, 350MVA or of the local system, 250MVA in this example.

The Connection Charge for this Scheme is calculated as follows:

#### Reinforcement

	Cost	Apportionment	Customer Contribution
<b>Non-Contestable Work</b>			
Re-conductor of 500m of HV overhead line	£49,000	$3/7.6 \times 100\% = 39.5\%$ Security CAF	£19,342
Replacement of existing 11 panel 11kV switchgear	£540,000	$3 \times (10/250) \times 100\% = 12.0\%$ Fault Level CAF	£64,800
<b>Total Reinforcement Cost</b>	<b>£589,000</b>		<b>£84,142</b>


#### Extension Assets

	Cost	Apportionment	Customer Contribution
<b>Contestable Work</b>			
Installation of 500m HV cable	£47,000	n/a	£47,000
HV circuit breaker at Customer's substation	£10,000	n/a	£10,000
<b>Non-Contestable Work</b>			
HV pole top termination	£1,400	n/a	£1,400
<b>Total Extension Asset Cost</b>	<b>£58,400</b>		<b>£58,400</b>
CIC Charges			£1,100

**Total Connection Charge = £84,142 + £58,400 = £142,542**

### 5.1.8. Example 6: Connection of Mixed Housing and Commercial Development

The Customer requests 18MVA for a new mixed housing & commercial development site which comprises of 7,000 plots and a mixture of small commercial Premises. The Point of Connection on the network will be at the two existing 33kV circuit breakers located at the 132/33kV substation approximately 600m from the site boundary. In order to accommodate the Required Capacity, it will be necessary to reinforce the two 60MVA, 132/33kV, transformers with 90MVA transformers. It will then be necessary to extend the network and establish a 2 by 24MVA transformer 33/11kV substation on site with an extendable HV board in this new substation. The HV board will comprise of 2 incomer, 1 bus section and 8 outgoing circuit breakers. From this substation there will be 3km of HV cable required to supply 24 substations. From each of these 24 substations there will be associated LV cable and services as required.

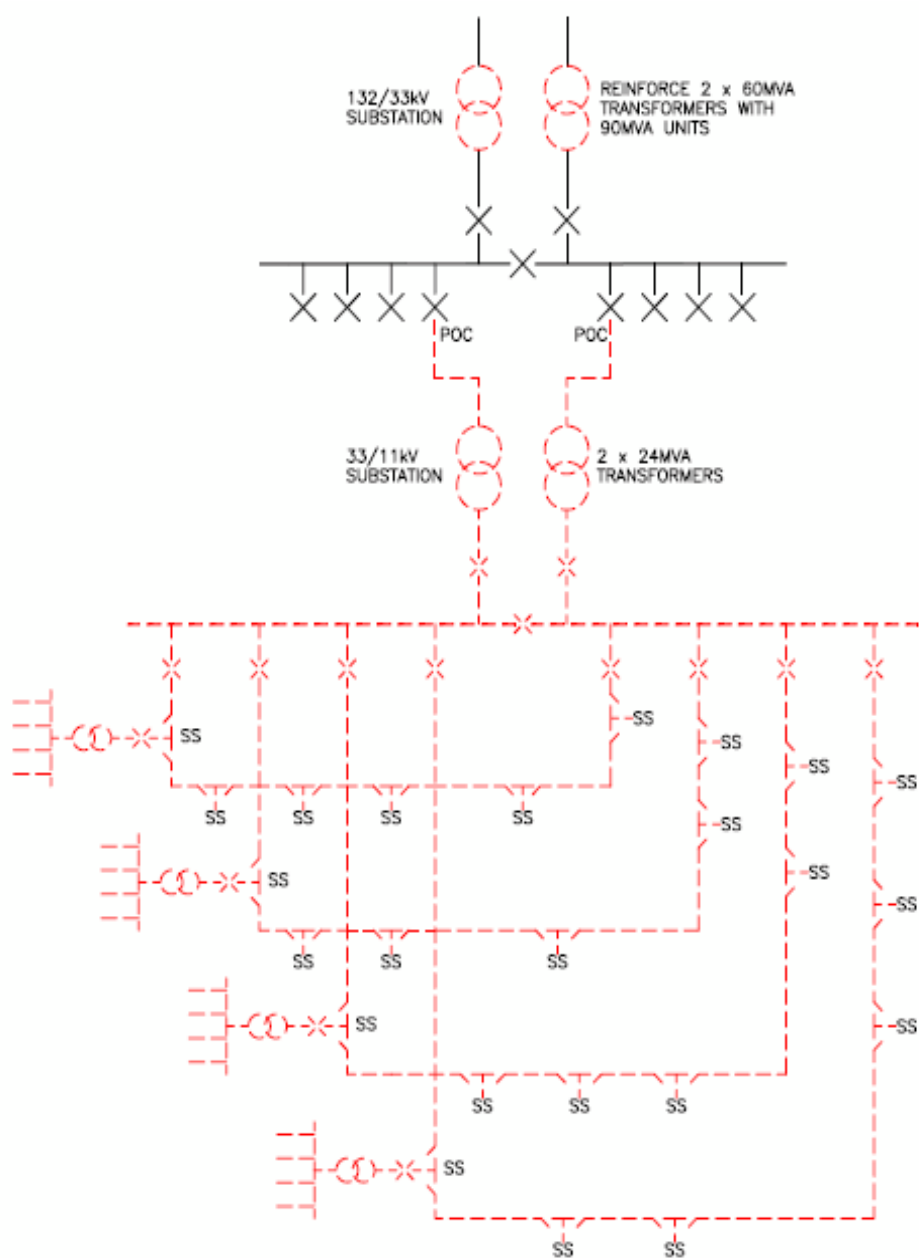

## Reinforcement

The RSN for the Reinforcement is the transformers at the existing 132/33kV substation.

Security CAF calculation: the numerator in the CAF calculation is based upon the Required Capacity of the Customer, i.e., 18MVA. The denominator is based on the secure New Network Capacity following Reinforcement, i.e., 90MVA.

Fault Level CAF calculation: This Scheme does not have any significant Fault Level contribution to the existing shared use distribution network and Fault Level CAF is therefore not applicable here.

The Connection Charge for this Scheme is calculated as follows:

## Reinforcement Costs

	Cost	Apportionment	Customer Contribution
<b>Non-Contestable Work</b>			
Replace two 60MVA, 132/33kV transformers with two 90MVA transformers.	£1,500,000	18/90 X 100% 20.0%	£300,000
<b>Total Reinforcement Cost</b>			£300,000


	Cost	Apportionment	Customer Contribution
<b>Contestable Work</b>			
600m of 2 by 33kV cable	£180,000	n/a	£180,000
3000m of HV circuits, 24 HV/LV substations, LV cable and services.	£7,000,000	n/a	£7,000,000
2 by 24MVA transformer substation	£2,000,000	n/a	£2,000,000
<b>Non-Contestable Work</b>			
Terminate two 33kV cables on to two existing 33kV circuit breakers.	£25,000	n/a	£25,000
<b>Total Extension Asset Cost</b>	£9,205,000		<b>£9,205,000</b>
<b>CIC Charges</b>			£15,000

**Total Connection Charge = £9,205,000 + £300,000 = £9,505,000**



### 5.1.9. Example 7A: New 3MVA Generation Connection, Fault Level Triggered Reinforcement

A Customer wishes to connect a new generator with a Required Capacity for export purposes of 3MVA. The connection of the generator requires the installation of 500m of 11kV cable and 1500m of overhead line between a new circuit breaker, added to the 11kV extensible switchgear panel at an existing primary substation and a new substation at the Customer's Premises. The 24MVA Fault Level contribution from the generator necessitates Reinforcement works to replace the 11kV switchgear at the existing primary substation with switchgear of a higher fault level rating.

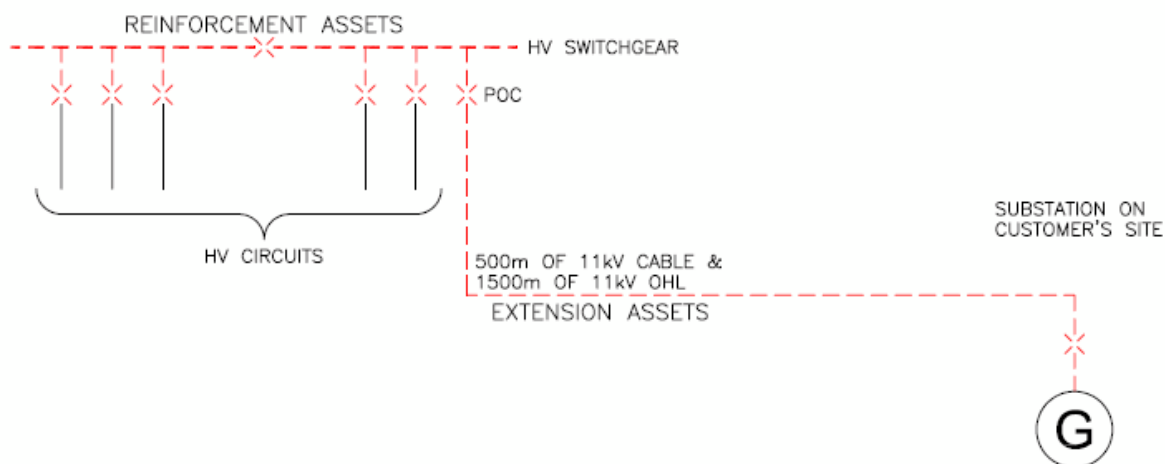

#### Reinforcement

Fault Level CAF calculation: The numerator in the CAF calculation is based upon the Fault Level contribution from the Customer's new generator connection, in this Example 24MVA. The denominator is based upon the New Fault Level Capacity, in this Example the Fault Level capacity of the new 11kV switchboard, 315MVA.

The Connection Charge for this Scheme is calculated as follows:

#### Reinforcement:

	Cost	Apportionment	Customer Contribution
<b>Non Contestable Work</b>			
Replacement HV switchboard (excluding Customer's sole use circuit breaker)	£450,000	$3 \times (24/315) \times 100\% = 22.9\%$	£102,857
<b>Total Reinforcement Cost</b>	£450,000		<b>£102,857</b>

Extension Assets:


	Cost	Apportionment	Customer Contribution
<b>Non-Contestable Work</b>			
HV circuit breaker at primary substation	£25,000	n/a	£25,000
<b>Contestable Work</b>			
Installation of a 500m HV cable	£40,000	n/a	£40,000
Installation of a 1500m HV overhead line	£35,000	n/a	£35,000
HV circuit breaker at Customer substation	£25,000	n/a	£25,000
<b>Total Extension Asset Cost</b>	£125,000		<b>£125,000</b>
<b>CIC Charges</b>			£1,100

**Total Connection Charge = £102,857 + £125,000 = £227,857**

### 5.1.10. Example 7B: New 3MVA Generation Connection, Switchgear Extension Not Possible

This example demonstrates the application of Exception 4.

A Customer requests to connect a new generator with a Required Capacity for export purposes of 3MVA. The connection of the generator requires the installation of the works as provided in Example 7A above. In this scenario, however, there is no Fault Level issue but, as the connection cannot be facilitated by an extension of the existing switchgear equipment in our primary substation, a full replacement of the existing switchgear installation is required. As no capacity is added to the existing shared use distribution network, the Customer will be required to fund the full cost of the switchgear installation replacement.

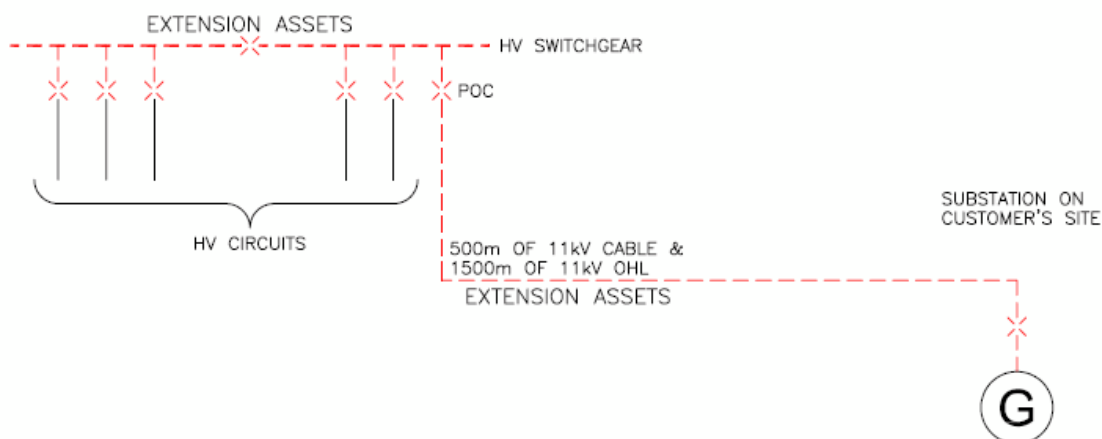

The existing switchgear had fault level rating of 250MVA. The company no longer uses switchgear with a fault level rating of 250MVA, so uses the closest equivalent switchgear used by it as standard, which has a slightly higher rating. Whilst the replacement switchgear increases the fault level capacity and could be considered Reinforcement, in this case this is due solely to the fault level rating of the standard equipment used by the company being higher than the fault level rating of the existing switchgear. The increase in fault level capacity is not required to connect the customer. Therefore, Exception 4 applies and the switchgear will be considered to be Extension Assets and its costs will be charged in full to the customer.

The Connection Charge for this Scheme is calculated as follows:

#### Extension Assets:

	Cost	Apportionment	Customer Contribution
<b>Contestable Work</b>			
Installation of a 500m HV cable	£40,000	n/a	£40,000
Installation of a 1500m HV overhead line	£35,000	n/a	£35,000
HV circuit breaker at Customer substation	£25,000	n/a	£25,000
<b>Non-Contestable Work</b>			
Replacement 11kV switchboard	£450,000	n/a	450,000

New Extension Asset circuit breaker	£25,000	n/a	£25,000
<b>Total Extension Asset Cost</b>	£575,000		<b>£575,000</b>
CIC Charges			£1,100

**Total Connection Charge = £575,000**


#### 5.1.11. Example 8A: Connection of Housing Development with Network Reinforcement

A new housing development has a Required Capacity of 2MVA to serve 900 plots. The local 11kV feeder has a network capacity of 7.7MVA based upon the limitation of the existing 400 Amp circuit breakers at Primary Substation A. The existing load on the circuit is 7.6MVA. It is therefore not possible to connect the new load to this circuit without Reinforcement works. To reinforce the circuit, it is proposed to install a new circuit breaker at Primary Substation B and install a new 11kV feeder (also rated at 7.7MVA) to the local 11kV circuit. The new 11kV feeder is used to split the existing circuit from a secure two to a secure three feeder network. The newly installed cable between point A and B is 1300m long. The newly installed cable to connect the development from the Point of Connection is 1200m.

This Reinforcement will allow a Point of Connection to be taken from the local 11kV circuit to supply the new development. Three 800kVA distribution substations are established onsite. The above work represents the Minimum Scheme to provide services to the new site.

The figure below shows the proposed Reinforcement and Point of Connection to the 11kV network:

N

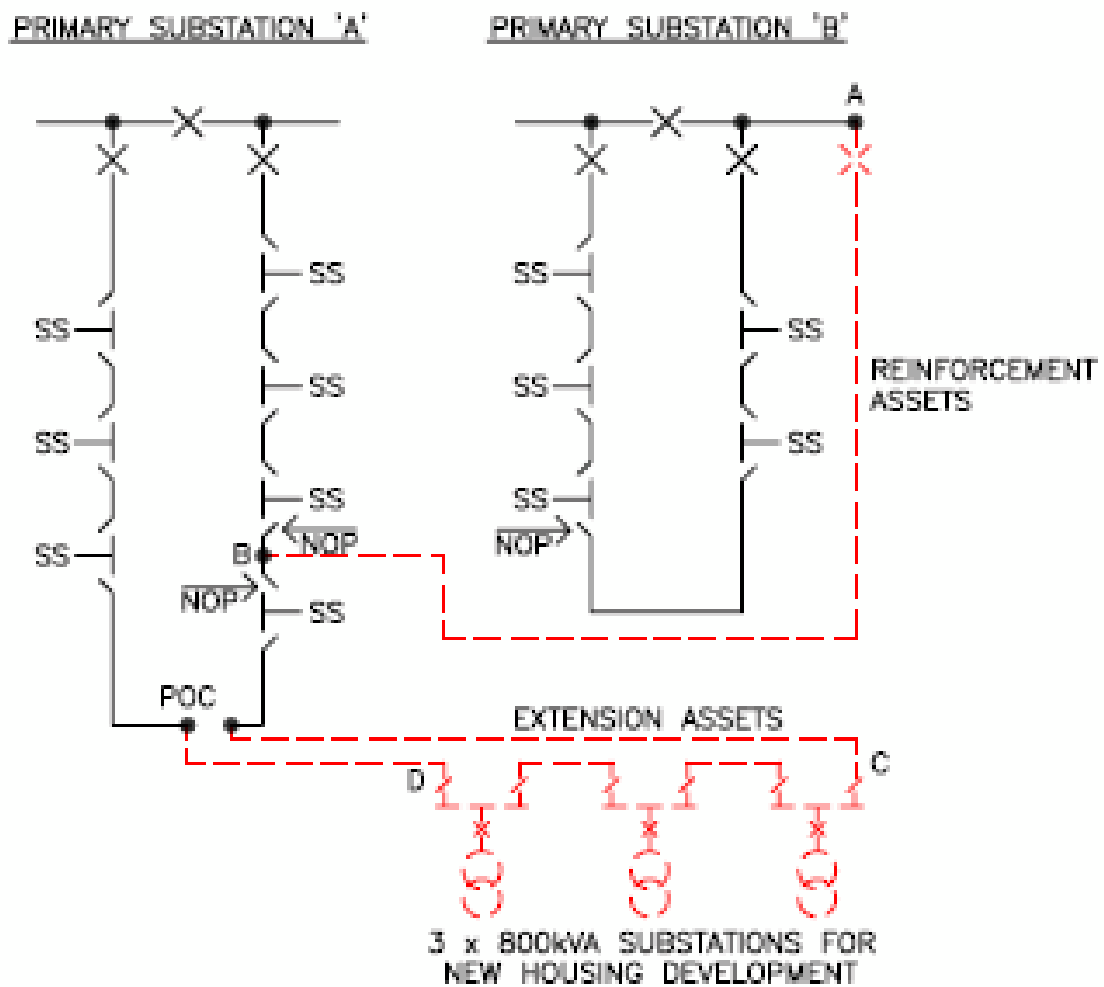

## Reinforcement

The RSN for the ReinforcementFor the Reinforcement CAF the RSN is considered to be the secure three feeder 11kV network comprising the two feeders from Primary Substation A and the new feeder from Primary Substation B as this new feeder is capable of feeding either of the existing circuits. The numerator in the CAF calculation is based upon the Required Capacity of the new development, i.e., 2MVA. In this case, the New Network Capacity (under secure N -1 conditions) following the Reinforcement works is equal to  $(3 - 1) \times 7.7\text{MVA} = 15.4\text{MVA}$ .

Fault Level CAF calculation: This Scheme does not have any significant Fault Level contribution to the existing shared use distribution network and Fault Level CAF is therefore not applicable here.

The Connection Charge for this Scheme is calculated as follows:

### Reinforcement:

	Cost	Apportionment	Customer Contribution
<b>Non-Contestable Work</b>			
1300m of 11kV Cable	£130,000	$2/15.4 \times 100\% = 13.0\%$	£16,883
11kV Circuit Breaker at Primary Substation B	£45,000	As above	£5,844
11kV jointing at Point B	£3,000	As above	£390
<b>Total Reinforcement Cost</b>	<b>£178,000</b>		<b>£23,117</b>

### Extension Assets

	Cost	Apportionment	Customer Contribution
<b>Contestable Work</b>			
1200m of 11kV Cable	£120,000	n/a	£120,000
3 by 800kVA distribution substations	£150,000	n/a	£150,000
On site LV mains and services	£330,000	n/a	£330,000
<b>Non-Contestable Work</b>			
2 by 11kV closing joints	£5,000	n/a	£5,000
<b>Total Extension Asset Cost</b>	<b>£605,000</b>		<b>£605,000</b>
CIC Charges			£3,500


**Total Connection Charge = £23,117 + £605,000 = £628,117**

### 5.1.12. Example 8B: Connection of Housing Development

This example demonstrates the application of Exception 5.

In this variation of the previous Example the site is closer to Primary Substation B and the Minimum Scheme is to connect the new load to the new 11kV feeder from Primary Substation B and provide interconnection to an existing secure 11kV feeder from Primary Substation A. In this Example 600m of 11kV cable on site (between Points C and D) is required to provide connectivity within the development and is considered to be Extension Assets.

The figure below shows the proposed network.

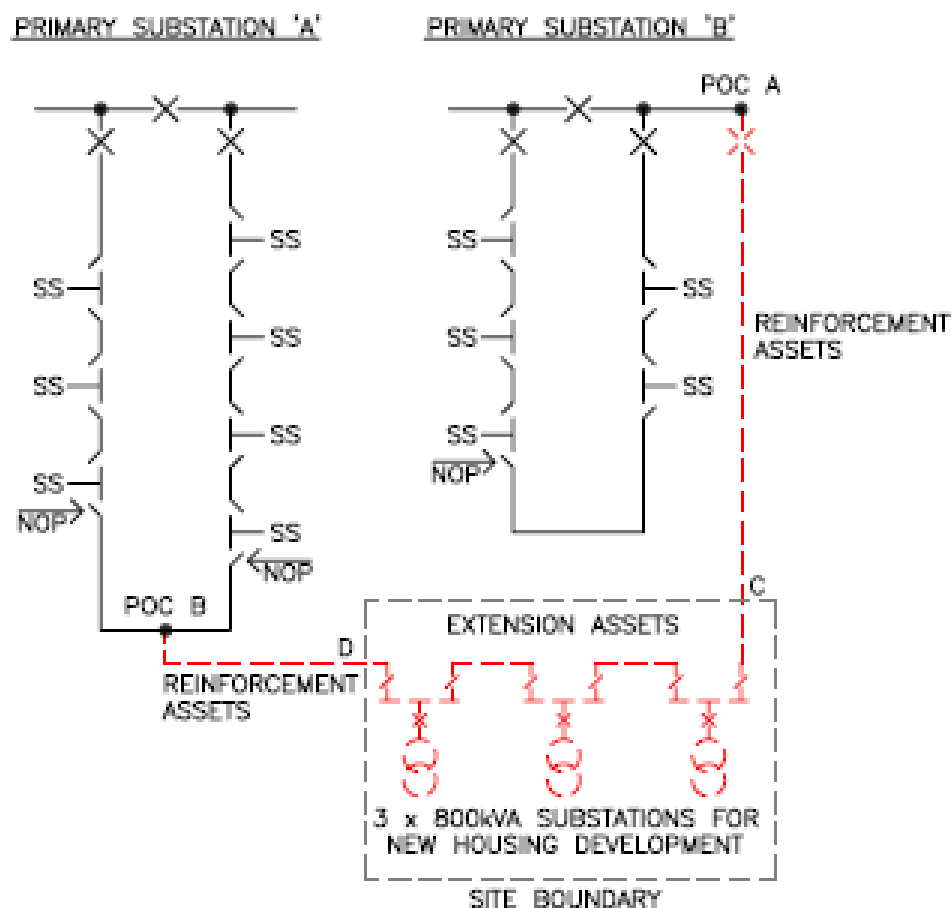

The assets connecting Point of Connection A and Point of Connection B add capacity to the existing network, so would normally be treated as Reinforcement. These comprise:

- The assets between the Customer's site and Point of Connection A (Point of Connection A to point C);
- The assets between the Customer's site and Point of Connection B (Point of Connection B to point D); and
- The 600m of 11kV cable on site.

The three 800kVA substations are not considered to provide connection between Point of Connection A and Point of Connection B. The 600m of 11kV cable on site is additional network length to provide connectivity between multiple exit points on the Customer's site. Therefore, Exception 5 applies and the 600m of 11kV



cable on site will be treated as Extension Assets and its costs will be charged in full to the customer. No exceptions apply to the assets between Point of Connection A and point C and Point of Connection B and point D. Therefore, these will be treated as Reinforcement and their costs will be apportioned.

### Reinforcement

The RSN for the Reinforcement

The RSN is considered to be the secure three feeder 11kV network comprising the two feeders from Primary Substation A and the new feeder from Primary Substation B. As in the above example the numerator in the CAF calculation is based upon the Required Capacity of the new development, i.e., 2MVA. In this case, however the work to provide the connection will increase the capacity of the existing shared use Distribution System from 7.7MVA to 15.4MVA. The New Network Capacity (under secure N -1 conditions) following the Reinforcement works is equal to  $(3 - 1) \times 7.7\text{MVA} = 15.4\text{MVA}$

Fault Level CAF calculation: This Scheme does not have any significant Fault Level contribution to the existing shared use Distribution System and Fault Level CAF is therefore not applicable here.

The Connection Charge for this Scheme is calculated as follows:

### Reinforcement:

	Cost	Apportionment	Customer Contribution
<b>Non-Contestable Works</b>			
1 new 11kV Circuit Breaker tailed out from primary substation A	£45,000	$2/15.4 \times 100\% = 13.0\%$	£5,844
2 by 11kV closing joints	£5,000	As above	£649
700m of 11kV cable from primary A to site	£70,000	As above	£9,091
600m of 11kV cable from Point of Connection B to site	£60,000	As above	£7,792
<b>Total Reinforcement Cost</b>	<b>£180,000</b>		<b>£23,376</b>

### Extension Assets:

	Cost	Apportionment	Customer Contribution
<b>Contestable Works</b>			
600m of 11kV cable on site	£60,00	n/a	£60,000

3 by 800KVA unit Substation	£150,000	n/a	£150,000
On site LV mains and services	£330,000	n/a	£330,000
<b>Non-Contestable Work</b>			
2 by 11kV cable box terminations	£2,000	n/a	£2,000
<b>Total Extension Asset Cost</b>	£542,000		<b>£542,000</b>
CIC Charges			£3,500

**Total Connection Charge = £23,376 + £542,000 = £565,376**

#### **5.1.13. Example 8C: Connection of Housing Development with Remote Network Reinforcement**

This further variation shows the arrangements that will apply where it is necessary to reinforce a different part of the Distribution System so that existing demand may be transferred in order to release capacity for the new connection.


A new housing development has a Required Capacity of 2MVA to serve 900 plots. The local 11kV feeder has a network capacity of 7.7MVA based upon the limitation of the existing 400 Amp circuit breakers at Primary Substation A. The existing load on the circuit is 7.6MVA. It is therefore not possible to connect the new load

to this circuit without Reinforcement works.


It is proposed to reinforce an adjacent network so that two existing substations may be transferred on to it, in order to release capacity so that the new connections can be made. Primary Substation B has sufficient spare capacity to accommodate the two existing substations. A new circuit breaker is to be installed at Primary Substation B and a new 11kV feeder (also rated at 7.7MVA) is to be installed between points A – B and between points E – F for connection to the local 11kV circuit at point F. The existing circuit will be cut at point BE so that the new joints can be made. This will convert the Primary Substation B network from a two-feeder to a three-feeder network. The total new cable length between points A – B and points E - F is 500m. The network will be reconfigured by the installation of two short straps C – D and G - H in order to maintain connectivity.

This Reinforcement will allow a Point of Connection to be taken from the local 11kV circuit to supply the new development. The newly installed cable to connect the development from the Point of Connection is 1200m long. Three 800kVA distribution substations are to be established onsite. The above work represents the Minimum Scheme to provide connections to the new site.

*Original network:*

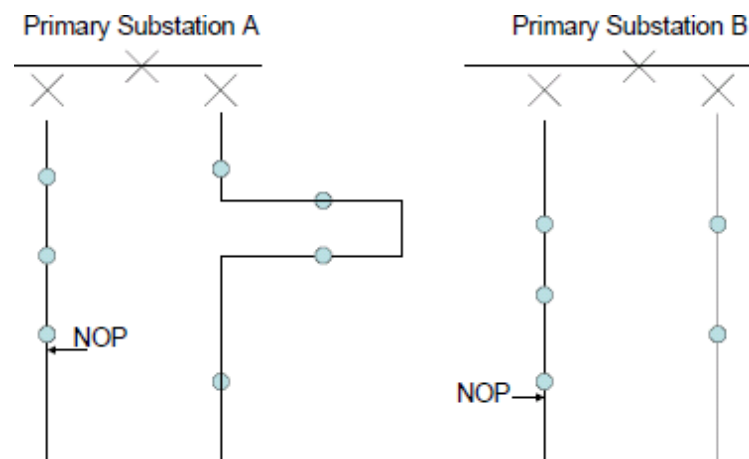

### Proposed network:

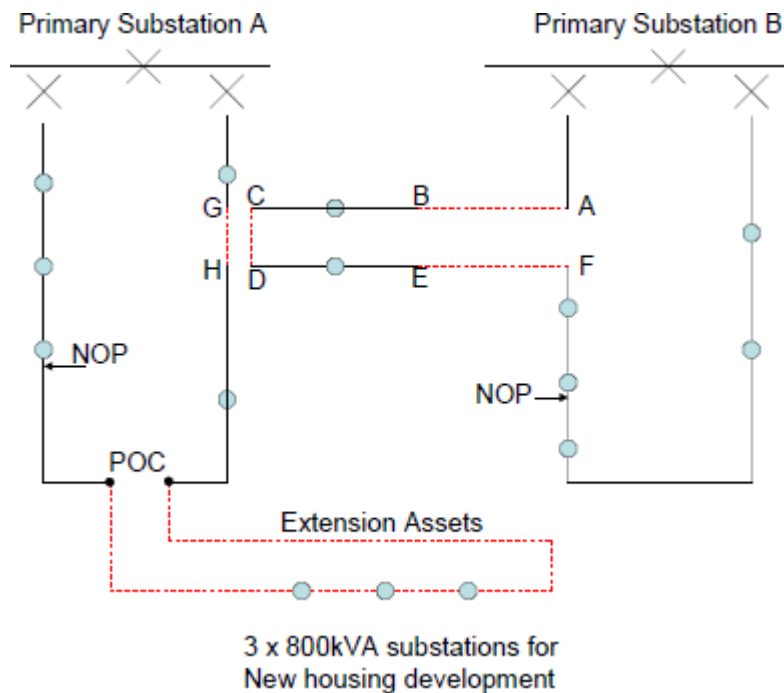

### Reinforcement

The RSN for the Reinforcement

For the Reinforcement CAF the RSN is the three-feeder network from Primary Substation B which supplies the loads on the existing two feeders from Primary Substation B as well as the loads at points C and D transferred from the network from the Primary Substation A. The Relevant Section of Network does not supply the new development in this case. The numerator in the CAF calculation is based upon the Required Capacity of the new development, i.e. 2MVA. In this case, the New Network Capacity (under N -1 conditions) following the Reinforcement works is equal to  $(3 - 1) \times 7.7\text{MVA} = 15.4\text{MVA}$ .

Fault Level CAF calculation: This Scheme does not have any significant Fault Level contribution to the existing shared use distribution network and Fault Level CAF is therefore not applicable here.

The Connection Charge for this Scheme is calculated as follows:

### Reinforcement:

	Cost	Apportionment	Customer Contribution
<b>Non-Contestable Work</b>			
500m of 11kV cable: A-B, C- D, E- F	£50,000	$2/15.4 \times 100\% = 13\%$	£6,500
11kV Circuit Breaker at Primary Substation B	£45,000	As above	£5,844
11kV jointing at Points A,B,C,D,E,F	£10,000	As above	£1,300

<b>Total reinforcement cost</b>	£105,000		<b>£13,644</b>
---------------------------------	----------	--	----------------

**Extension assets:**

	<b>Cost</b>	<b>Apportionment</b>	<b>Customer Contribution</b>
<b>Contestable Work</b>			
1200m of 11kV cable including strap at G - H	£120,000	n/a	£120,000
3 by 800kVA distribution substations	£150,000	n/a	£150,000
On site LV mains and services	£330,000	n/a	£330,000
<b>Non-Contestable Work</b>			
4 by 11kV closing joints at Point o Connection and at points G,H	£10,000	n/a	£10,000
<b>Total extension asset cost</b>	£610,000		<b>£610,000</b>
CIC charges			£3,500

**Total Connection Charge = £13,664 + £610,000 = £623,644**

#### 5.1.14. Example 8D: Connection of Housing Development with Load Transfer

An additional variation shows the arrangements that will apply where it is necessary to reconfigure the Distribution System so that existing demand may be transferred in order to release capacity for the new connection.


A new housing development has a Required Capacity of 2MVA to serve 900 plots. The local 11kV feeder has a network capacity of 7.7MVA based upon the limitation of the existing 400 Amp circuit breakers at Primary Substation A. The existing load on the circuit is 7.6MVA. It is therefore not possible to connect the new load to this circuit as presently configured.

It is proposed to reconfigure the Distribution System such that two existing substations may be transferred on to an adjacent network, in order to release capacity so that the new connections can be made. Primary Substation B has sufficient spare capacity to accommodate the two existing substations. New cables are to be installed between points A – B and between points E – F.


The existing circuit will be cut at point BE so that the new joints can be made. The total new cable length between points A – B and points E - F is 100m. The network will be reconfigured by installation of two short straps C – D and G - H in order to maintain connectivity.

This transfer of existing demand will allow a Point of Connection to be taken from the local 11kV circuit to supply the new development. The newly installed cable to connect the development from the Point of Connection is 1200m long. Three 800kVA distribution substations are to be established onsite. The above work represents the Minimum Scheme to provide connections to the new site.

#### Original network:

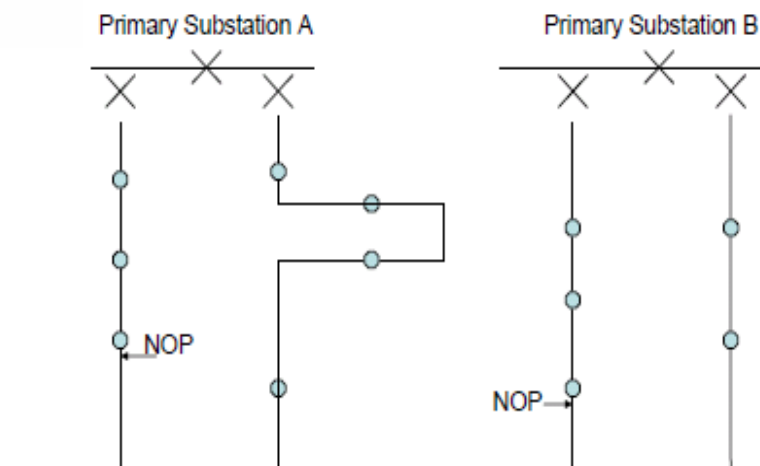

## Proposed Network

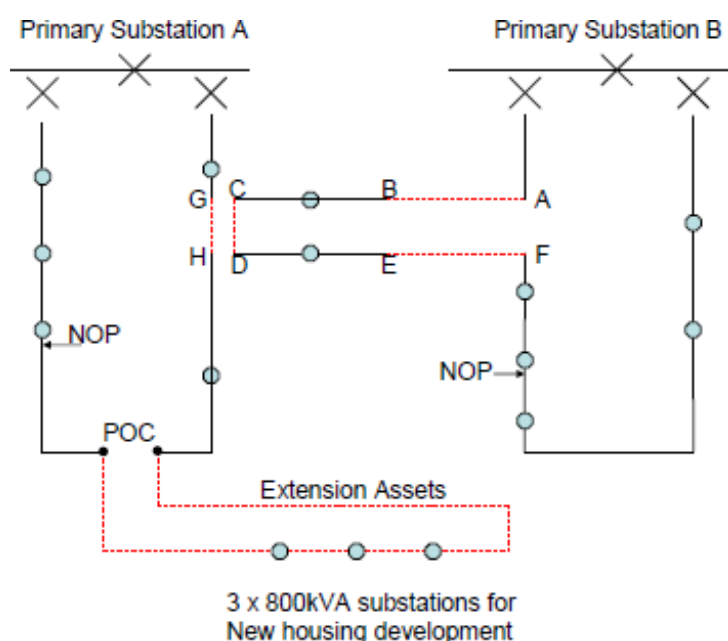

The Connection Charge for this Scheme is calculated as follows:

### Extension assets:


	Cost	Apportionment	Customer Contribution
<b>Contestable Work</b>			
1300m of 11kV cable including A- B, C-D, E-F, G-H and from Point of Connection to the development	£120,000	n/a	£120,000
3 by 800kVA distribution substations	£150,000	n/a	£150,000
On site LV mains and services	£330,000	n/a	£330,000
<b>Non-Contestable Work</b>			
10 by 11kV closing joints at Point of Connection and at points A,B,C,D,E,F,G,H	£25,000	n/a	£25,000
<b>Total extension asset cost</b>	<b>£625,000</b>		<b>£625,000</b>
CiC charges			£3,500

**Total Connection Charge = £625,000**

### 5.1.15. Example 9: Minimum Scheme

A Customer requests a new 100kVA connection. There is sufficient spare capacity on the adjacent LV main but the existing 300kVA transformer at the local 11kV/LV substation is fully loaded.

- a) *The Minimum Scheme is to provide a new service cable and to replace the 300kVA transformer at the local substation with a 500kVA transformer.*

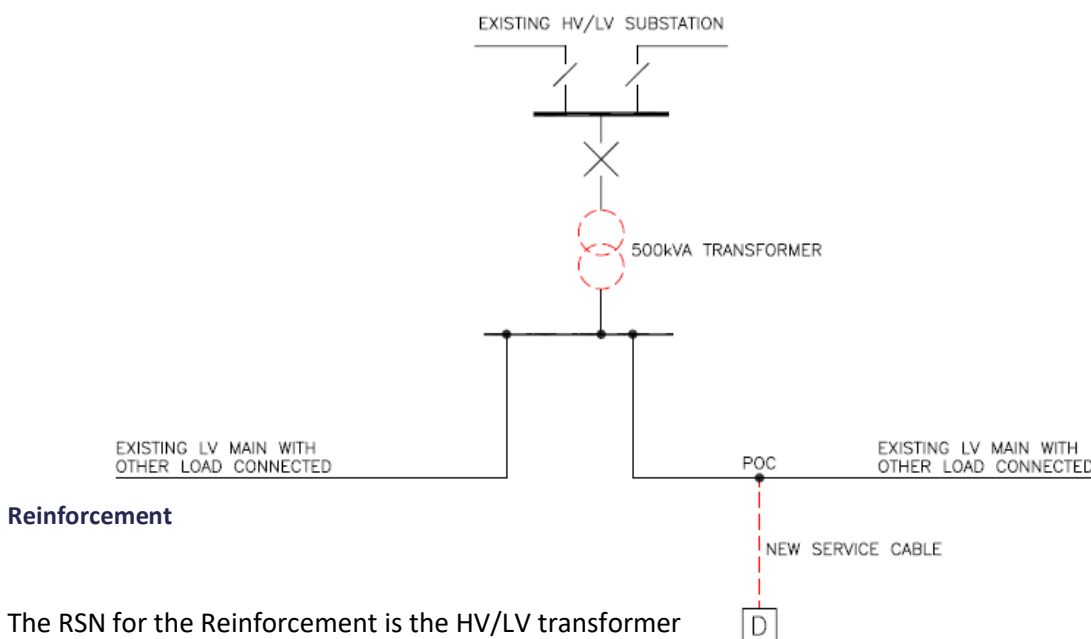

Security CAF calculation: the numerator in the CAF calculation is based upon the Required Capacity of the Customer, i.e., 100kVA. The denominator is based on the New Network Capacity following Reinforcement, i.e. 500kVA.

Fault Level CAF calculation: This scheme does not have any significant Fault Level contribution to the existing shared use distribution network and Fault Level CAF is therefore not applicable here.

The Connection Charge for this Scheme is calculated as follows:

#### Reinforcement Costs:

	Cost	Apportionment	Customer Contribution
<b>Non Contestable Work</b>			
Replacement 500kVA transformer	£10,000	$100/500 \times 100\% = 20.0\%$	£2,000
<b>Total Reinforcement Cost</b>	£10,000		<b>£2,000</b>



#### Extension Assets:

	Cost	Apportionment	Customer Contribution
<b>Contestable Work</b>			
Provision and installation of LV service cable	£1,500	n/a	£1,500
<b>Non-Contestable Work</b>			
LV joints to network	£500	n/a	£500
<b>Total Extension Asset Cost</b>	£2,000		£2,000
<b>CIC Charges</b>			£200


**Total Connection Charge = £2,000 + £2,000 = £4,000**

**b) However we wish to carry out an Enhanced Scheme to install a 1000kVA transformer at the local substation and install a new LV main that will connect to and pick up load from an adjacent LV network.**

The RSN for the Reinforcement is the HV/LV transformer

Security CAF calculation: the numerator in the CAF calculation is based upon the Required Capacity of the Customer, i.e., 100kVA. The denominator is based on the New Network Capacity following Reinforcement, i.e. 1000kVA.

Fault Level CAF calculation: This scheme does not have any significant Fault Level contribution to the existing shared use distribution network and Fault Level CAF is therefore not applicable here.

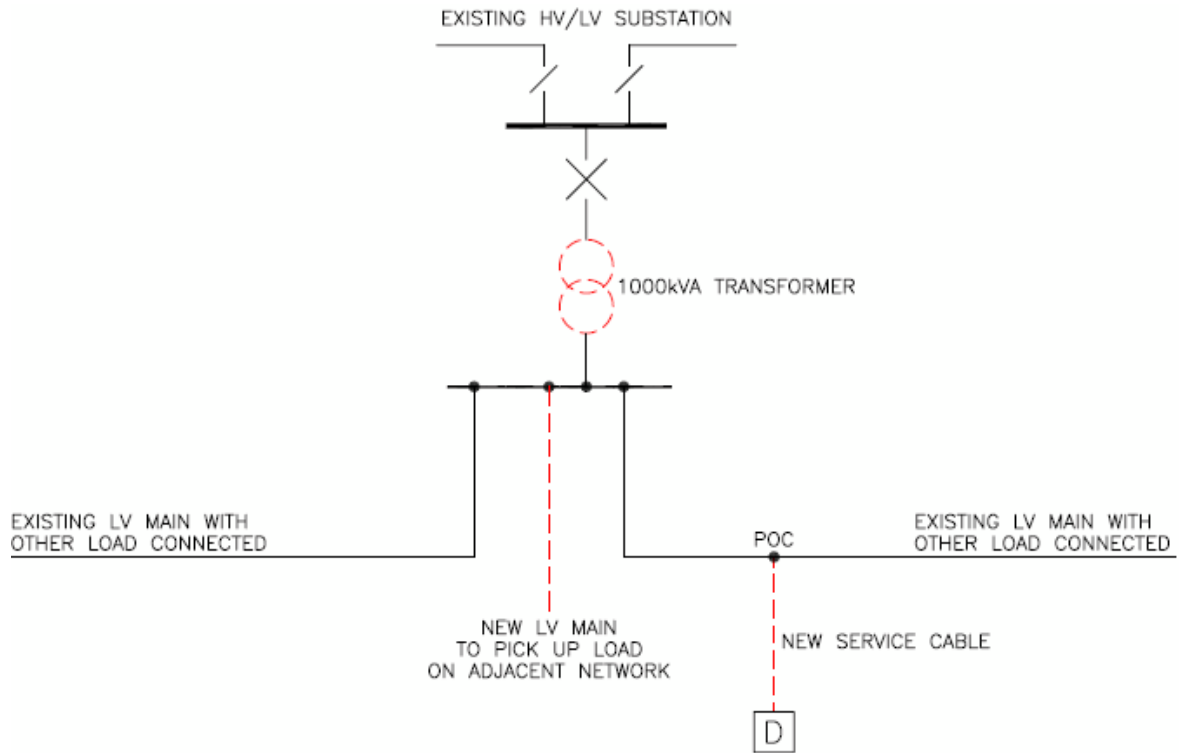

#### Reinforcement:

	Cost	Apportionment	Customer Contribution
Non-Contestable Work			
Replacement 1000kVA transformer	£15,000	$100/1000 \times 100\% = 10.0\%$	£1,500
<b>Total Reinforcement Cost</b>	<b>£15,000</b>		<b>£1,500</b>

#### Extension Assets:

	Cost	Apportionment	Customer Contribution
<b>Contestable Work</b>			
Provision and installation of LV service cable	£1,500	n/a	£1,500
<b>Non-Contestable Work</b>			
LV joints to network	£500	n/a	£500
<b>Total Extension Asset Cost</b>	<b>£2,000</b>		<b>£2,000</b>
CIC Charges			£200

**Total Connection Charge = £1,500 + £2,000 = £3,500**

The cost of the new LV mains will be met by us and does not form part of the Connection Charge.

- c) In this instance the Connection Charge resulting from the Enhanced Scheme is lower than that resulting from the Minimum Scheme and the Customer would benefit from the lower Connection Charge and pay £3,500.

If, however under the proposed DNO Scheme the transformer cost was £25,000 then the resultant Connection Charge would be considered as follows.

*Reinforcement:*

	Cost	Apportionment	Customer Contribution
<b>Non-Contestable Work</b>			
Replacement 1000kVA transformer	£25,000	$100/1000 \times 100\% = 10.0\%$	£2,500
<b>Total Reinforcement Cost</b>	£25,000		£2,500


**Extension Assets**

	Cost	Apportionment	Customer Contribution
<b>Contestable Work</b>			
Provision and installation of LV service cable	£1,500	n/a	£1,500
<b>Non-Contestable Work</b>			
LV joints to network	£500	n/a	£500
<b>Total Extension Asset Cost</b>	£2,000		£2,000
<b>CIC Charges</b>			£200

Total Connection Charge = £2,500 + £2,000 = £4,500 but in this instance the Customer contribution will be capped at the contribution that would have been due under the Minimum Scheme, i.e., £4,000.

### 5.1.16. Example 10: A New Connection Application for Commercial Premises on a Meshed 11kV Distribution System requiring Reinforcement.

A Customer requests a new connection to a commercial premise requiring a 4MVA HV metered connection. The local 11kV network is of a meshed design whereby the 11kV network is supplied from single 33/11kV primary transformers via 33kV radial feeds as shown below.

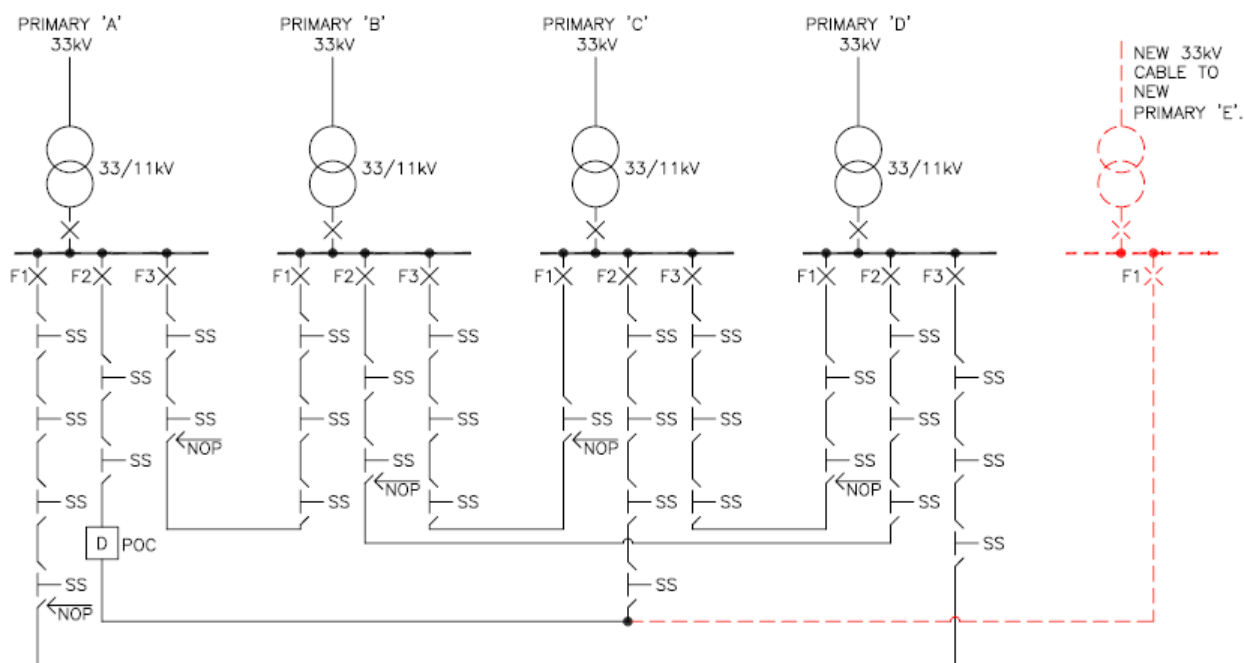

The existing network consists of four 10MVA primary transformer substations and associated 11kV switchgear. A new connection of 4MVA has been requested in the vicinity of F2 from Primary A.

The existing relevant primary transformer group is loaded to its secure capacity so the primary transformer group will require Reinforcement to enable the new connection to progress.

To provide the Required Capacity, the 11kV network will be reinforced by the installation of a new primary substation connected to the nearest 33kV circuit. The new primary substation (Primary E) will contain a 10MVA transformer, associated 11kV switchgear and a new 11kV (7.7 MVA) cable installed to interconnect into the existing 11kV network (from F2 at Primary A to F2 at Primary C).

#### Reinforcement:

Security CAF calculation: In this example there are two different security CAFs applied. This is because the RSN is different when considering the new network capacity in respect of different elements of the Reinforcement works.

The RSN for the Reinforcement comprising the 11kV Cable Works:

For the 11kV cable assets the RSN is considered to be the secure three feeder 11kV network from Primary A (Feeder 2), Primary C (Feeder 2) and Primary E (Feeder 1). In this case the New

Network Capacity (under secure N -1 conditions) following the Reinforcement works is equal to  $(3 - 1) \times 7.7\text{MVA} = 15.4\text{MVA}$

This is due to the fact that following the Reinforcement work both of the existing circuits; Primary A, Feeder 2 and Primary C, Feeder 2 can be loaded to their full capacity and will have the newly installed clean feeder from Primary E to act as a back feed to meet the requirements of P2/6.

The security CAF for these assets will therefore be  $4/15.4 \times 100\% = 26.0\%$  The

RSN for the Reinforcement comprising the Primary substation assets:

In this instance the RSN comprises Primary A, C and E within the group that can be used to supply the customer. The New Network Capacity of this RSN (under secure N -1 conditions) following the Reinforcement works is equal to 17.7MVA. (10MVA from either Primary A or Primary C and 7.7MVA from Primary E which is limited by the single 11kV cable connected to it.

The security CAF for these assets will therefore be  $4/17.7 \times 100\% = 22.6\%$

Fault Level CAF calculation: This Scheme does not have any significant Fault Level contribution to the existing shared use distribution network and Fault Level CAF is therefore not applicable here.

The Connection Charge for this Scheme is calculated as follows:

#### *Reinforcement:*

	Cost	Apportionment	Customer Contribution
<b>Non-Contestable Works</b>			
500m 11kV cable from new primary substation E	£50,000	$4/15.4 \times 100\% = 26.0\%$	£12,987
1 by 11kV closing joints	£4,000	As above	£1,039
11kV switchgear at new Primary E	£80,000	$4/17.7 \times 100\% = 22.6\%$	£18,079
Primary transformer	£600,000	As above	£135,593
2.5km of 33kV cable installation	£500,000	As above	£112,994
33kV Circuit Breaker	£70,000	As above	£15,819
33kV Terminations	£10,000	As above	£2,260
<b>Total Reinforcement Cost</b>	<b>£1,314,000</b>		<b>£298,771</b>

**Extension Assets:**

	Cost	Apportionment	Customer Contribution
<b>Contestable Work</b>			
HV ring main unit	£20,000	n/a	£20,000
HV metering unit	£10,000	n/a	£10,000
500m of 11kV cable	£100,000	n/a	£100,000
<b>Non-Contestable Work</b>			
2 by 11kV closing joints	£5,000	n/a	£5,000
<b>Total Extension Asset Cost</b>	£135,000		<b>£135,000</b>
CIC Charges			£3,500


**Total Customer Contribution = £298,771 + £135,000 = £433,771**

### 5.1.17. Example 11: Non-Secure Connection with Non-Secure Reinforcement

A Customer wishes to connect a new generator with a Required Capacity for export purposes of 5 MVA. The connection of the generator requires the installation of 1,000m of 33kV cable and a 33kV metering circuit breaker, these being Extension Assets. An existing spare circuit breaker at the substation is utilised which, in this case, is not chargeable to the Customer.

As there is insufficient capacity in the existing 24.0 MVA thermal capacity rated

33kV feeder for the new generation due to the presence of existing generation, the connection also requires the installation of a new 33kV feeder, which also has a thermal capacity of 24.0 MVA, as Reinforcement. This is the Minimum Scheme as it is cheaper to do this, to the extent as shown in the diagram below, rather than upgrade the existing 33kV feeder to the same point along it.

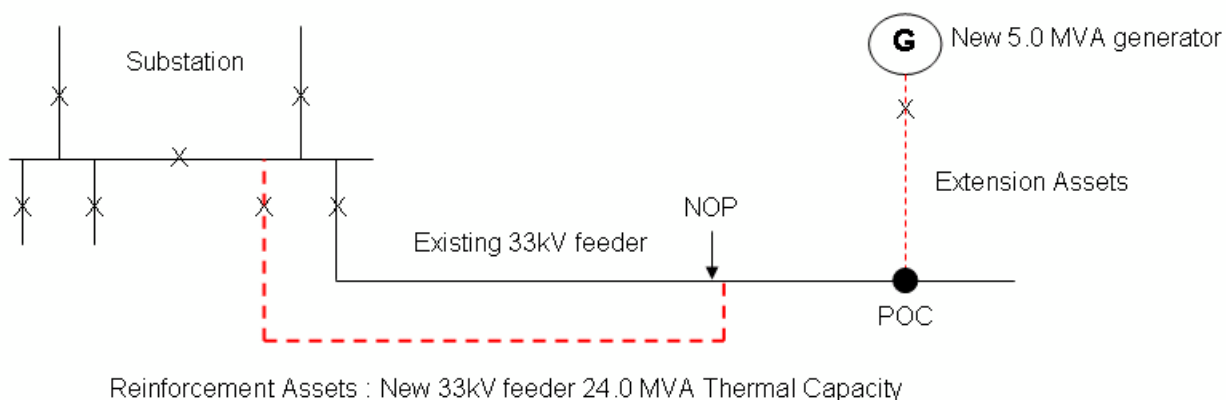

#### Reinforcement

The numerator in the CAF calculation is the Required Capacity of the new generator, which is 5.0 MVA.

The Relevant Section of Network in this case is the existing 33kV feeder and the new 33kV feeder. The New Network Capacity is calculated using the non-secure capacity and is therefore the sum of the thermal capacities of the two feeders, which is 48.0 MVA. This is the denominator in the CAF calculation.

The Connection Charge for this Scheme is calculated as follows:

## Reinforcement Costs

	Cost	Apportionment	Customer Contribution
<b>Contestable Work</b>			
Installation of new 33kV feeder	£ 500,000	$5.0 / 48.0 \times 100\% = 10.4\%$	£ 52,000
<b>Total Reinforcement Cost</b>	£ 500,000		£ 52,000

## Extension Assets:

	Cost	Apportionment	Customer Contribution
<b>Contestable Work</b>			
Installation of 1,000m 33kV cable	£ 200,000	n/a	£ 200,000
Installation of 33kV metering circuit breaker	£ 70,000	n/a	£ 70,000
<b>Non-Contestable Work</b>			
Joints to 33kV network	£ 10,000	n/a	£ 10,000
<b>Total Extension Asset Cost</b>	£ 280,000		£ 280,000
CIC Charges			£3,500


**Total Connection Charge = £ 52,000 + £ 280,000 = £ 332,000**



### 5.1.18. Example 12: Non-Secure Connection with Secure Reinforcement

A Customer requests a new connection to industrial premises requiring an 8 MVA metered demand connection. In this case, the Customer has exercised their option to request non-secure Extension Assets in the provision of the connection.

The existing network comprises a substation which has 2 x 15 MVA transformers. The Minimum Scheme to provide the connection is to install 750m of 11 kV cable from the substation to the industrial premises, as Extension Assets. As there is insufficient capacity available from the existing 2 x 15 MVA transformers to provide the new connection, it will be necessary to upgrade the transformers to 2 x 24 MVA units. Both transformers at the substation must be upgraded to ensure the 11kV network load can be maintained during planned or unplanned outages of one of the transformers. Although the Customer wishes to accept a non-secure connection, the substation must provide secure capacity to its group demand (which includes the Customer) to comply with the requirements of Engineering Recommendation P2/6. As the Extension Assets will be provided solely for the Customer, these can be provided on the basis of a single circuit to provide a non-secure connection, at the Customer's request.

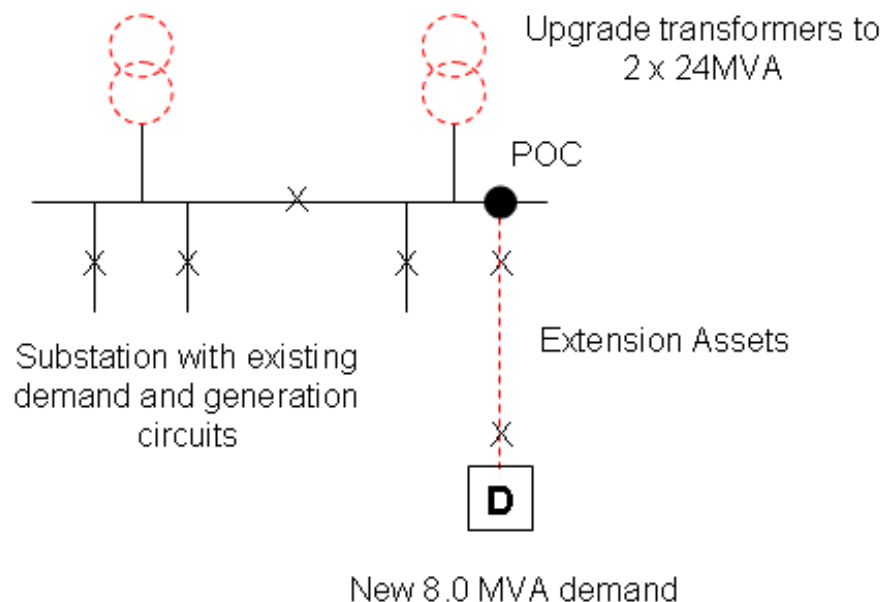

#### Reinforcement

The numerator in the CAF calculation is the Required Capacity of the new demand, which is 8.0 MVA.

The Relevant Section of Network in this case is the transformers at the substation. The New Network Capacity is the secure capacity of the transformers, which is 24MVA. This is the denominator in the CAF calculation.

The Connection Charge for this Scheme is calculated as follows:

#### Reinforcement Costs

	Cost	Apportionment	Customer Contribution
Non-Contestable Work			
Installation of 2 x 24 MVA 33/11 kV transformers	£ 1,500,000	8.0 / 24.0 x 100% = 33.3%	£ 500,000
Total Reinforcement Cost	£ 1,500,000		£ 500,000

#### Extension Assets:

	Cost	Apportionment	Customer Contribution
<b>Contestable Work</b>			
Installation of 750m 11kV cable	£ 75,000	n/a	£ 75,000
Installation of 11kV metering circuit breaker	£ 50,000	n/a	£ 50,000
<b>Non-Contestable Work</b>			
Joints to 11kV network	£ 5,000	n/a	£ 5,000
<b>Total Extension Asset Cost</b>	£ 130,000		£ 130,000
CIC Charges			£1,100


**Total Connection Charge = £ 500,000 + £ 130,000 = £ 630,000**

### 5.1.19. Example 13: Secure Connection with Secure Reinforcement

A Customer requests a new connection to commercial premises which has a Required Capacity of 2.5 MVA. The connection is to be provided on a secure basis and the Minimum Scheme is as shown.

On the existing network, only Feeder B1 has sufficient thermal capacity available to accommodate the additional demand. To comply with demand security requirements, it is necessary to install a new feeder (Feeder A1) with a thermal capacity of 7 MVA, as a Reinforcement of the network.

The Extension Assets in this case are two 11 kV cable circuits of 25m each.

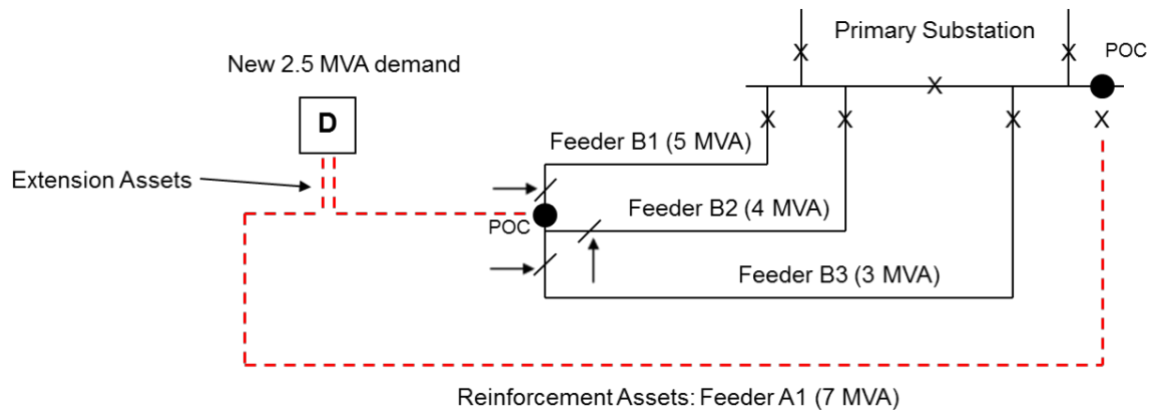

#### Reinforcement

If sufficient capacity had been available in the existing network, only two of the existing feeders would have been required to provide the required security. To determine which two feeders are relevant, the feeders with the closest ratings to the new feeder are considered.

In this case, Feeders B1 (5 MVA) and B2 (4 MVA) have the closest ratings to the new Feeder A1 (7 MVA). Therefore, the Relevant Section of Network is (B1 and B2) and A1. Note that the RSN will at most be limited to a 3 feeder ring.

The New Network Capacity is determined by applying  $(N - 1)$  security to the three- feeder RSN. This gives a secure NNC of  $(5 \text{ MVA} + 4 \text{ MVA}) = 9 \text{ MVA}$ . This recognises the possible loss of feeder A1 and supply through Feeder B1.

Therefore, the numerator in the CAF calculation is the Required Capacity of 2.5 MVA and the denominator is the New Network Capacity of 9.0 MVA.

The Connection Charge for this Scheme is calculated as follows:

#### Reinforcement Costs:

	Cost	Apportionment	Customer Contribution
<b>Contestable Work</b>			
Installation of new 11kV feeder	£ 250,000	$2.5 / 9.0 \times 100\% = 27.8\%$	£ 69,500
<b>Total Reinforcement Cost</b>	£ 250,000		£ 69,500

#### Extension Assets:

	Cost	Apportionment	Customer Contribution
<b>Contestable Work</b>			
Installation of 2 x 25m 11kV cable	£ 10,000	n/a	£ 10,000
Installation of 2 x 11kV metering circuit breakers	£ 100,000	n/a	£ 100,000
<b>Non-Contestable Work</b>			
Joints to 11kV network	£ 5,000	n/a	£ 5,000
<b>Total Extension Asset Cost</b>	£115,000		£115,000
CIC Charges			£1,100

**Total Connection Charge = £ 69,500 + £ 115,000 = £ 184,500**

### 5.1.20. Example 14: Reinforcement on another LDNO's network

A housing developer requests a connection for a development of 75 domestic Premises. The required capacity of the development is 100kVA. Our network is connected to the upstream distributor at LV.


There is sufficient capacity on our existing LV main but the existing 300kVA transformer at the HV/LV substation on the upstream distributor's network is fully loaded.

The Minimum Scheme is to provide new LV mains and service cables from a Point of Connection to our existing LV main and for the upstream distributor to replace their existing 300kVA transformer with a 500kVA transformer.

#### Reinforcement:

**The RSN for the Reinforcement is the HV/LV transformer.**

As the required reinforcement is not on our Distribution System, we will not be able to apportion the costs of this reinforcement. This will be calculated in accordance with the methodology of the upstream distributor and will be included as a cost passed through to you.

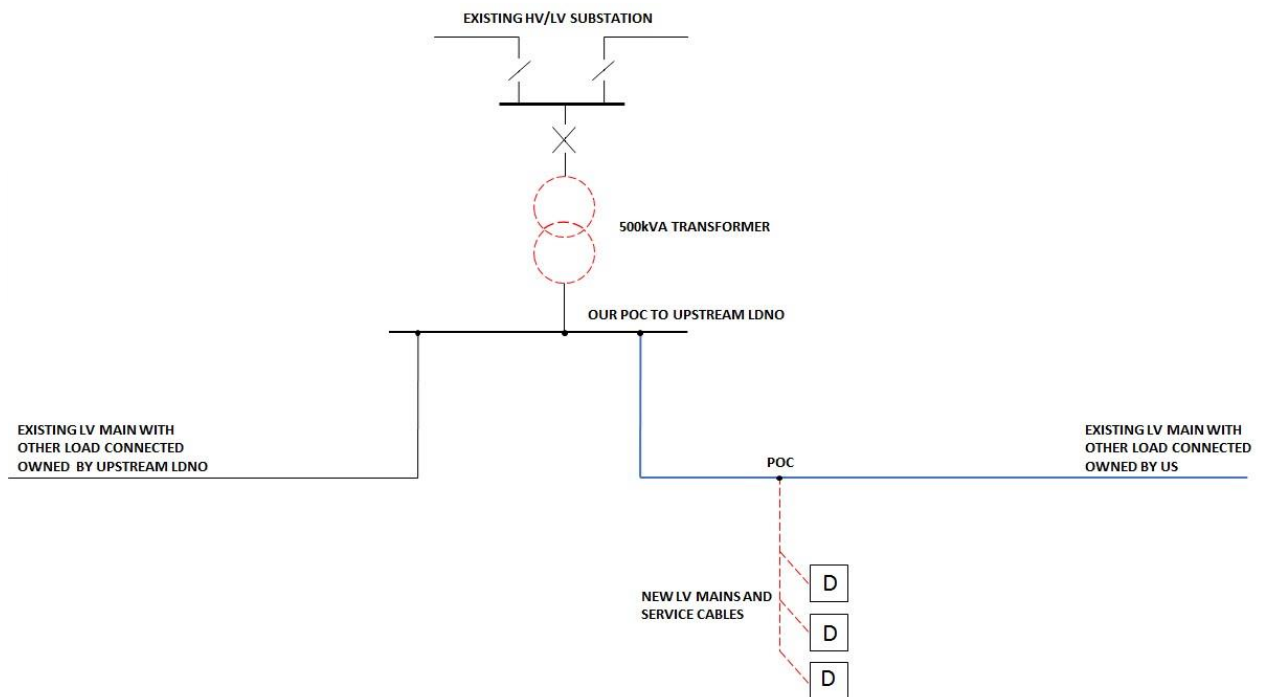

#### Reinforcement:

	Cost	Apportionment	Customer Contribution
<b>Non-Contestable Work</b>			
Installation of new 500kVA transformer	£ 10,000 <sup>1</sup>	n/a	£ 10,000
<b>Total Reinforcement Cost</b>	£ 10,000		£ 10,000

<sup>1</sup>This transformer figure is the cost provided to us by the upstream distributor and will be subject to their Connection Charging Methodology

#### Extension Assets:


	Cost	Apportionment	Customer Contribution
<b>Contestable Work</b>			
LV mains, service cables and terminations	£ 51,000	n/a	£ 51,000
LV joints to network	£500	n/a	£500
<b>Total Extension Asset Cost</b>	£ 51,500		£ 51,500
<b>CIC Charges</b>			£200

**Total Connection Charge £61,500**

(Note – for simplicity, the high-cost generation project threshold of £200/kW has been ignored in this example, but would apply in respect of the costs illustrated)

### 5.1.21. Example 15: New 2MVA Generation Connection, Voltage Rise Triggered Reinforcement

A Customer wishes to connect a new generator with a Required Capacity for export purposes of 2MVA. The local 11kV feeder has a large amount of generation already connected and will need to be reinforced in order to keep voltage rise within acceptable limits. The Minimum Scheme requires Reinforcement of the existing 185mm<sup>2</sup> 11kV underground cable with 300mm<sup>2</sup> underground cable and installation of a new substation for connection of the 2MVA export capacity. The total length of the reinforced cable is 2km. The thermal rating of the 300mm<sup>2</sup> underground cable is 8MVA. The 11kV underground cable on the other side of the normal open point is already 300mm<sup>2</sup> and does not require to be reinforced.

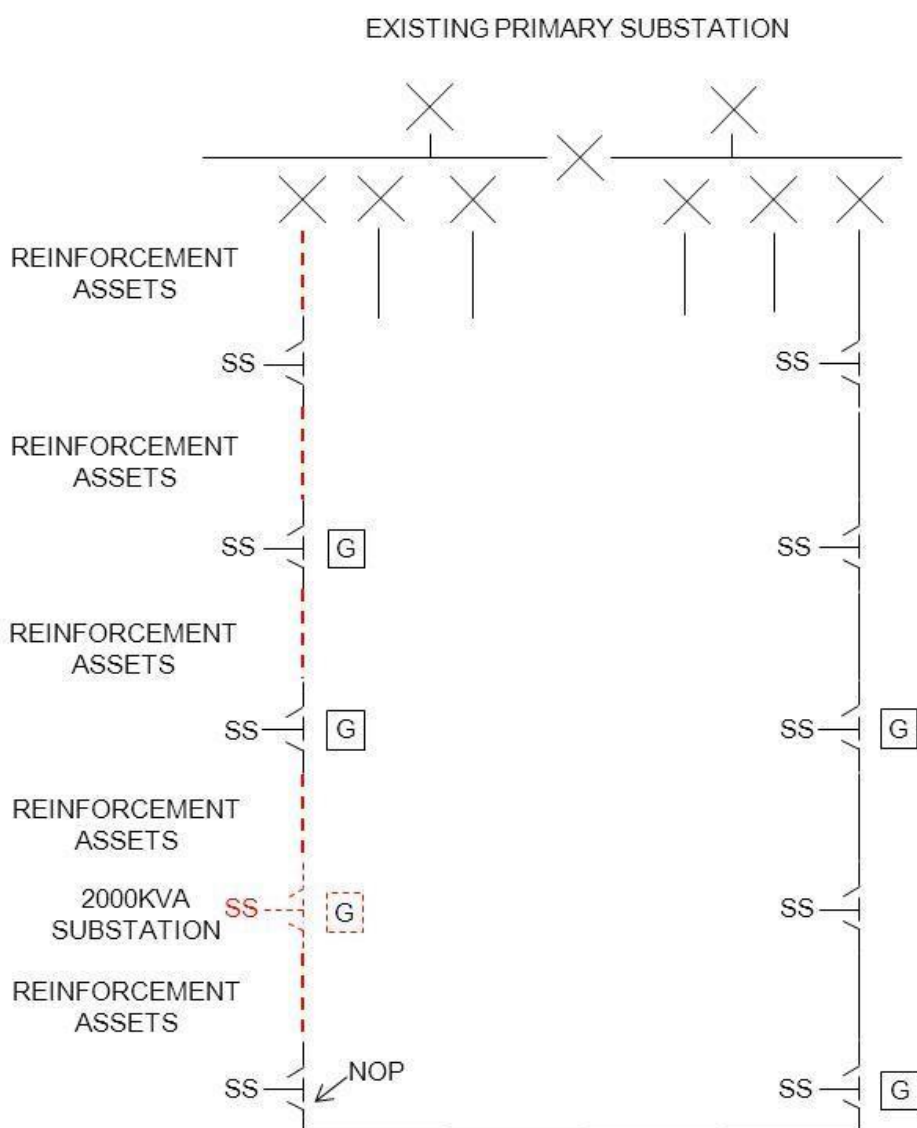

#### Reinforcement:

The RSN for the Reinforcement is the 11kV feeder.

Security CAF calculation: the numerator in the CAF calculation is the Required Capacity of the Customer, i.e. 2MVA. The denominator is the New Network Capacity following

Reinforcement, this being the maximum generation that could be connected whilst keeping the voltage rise within acceptable limits, i.e. 6MVA in this case.

Fault Level CAF calculation: this scheme does not have any significant Fault Level contribution to the existing shared use distribution network and Fault Level CAF is therefore not applicable here.

The Connection Charge for this Scheme is calculated as follows:

*Reinforcement Costs:*

	Cost	Apportionment	Customer Contribution
<b>Non-Contestable Work</b>			
2km of 300mm 11kV cable	£ 200,000	$2 / 6 \times 100\% = 33.3\%$	£ 66,666
<b>Total Reinforcement Cost</b>	£ 200,000		£ 66,666

**Extension Assets:**


	Cost	Apportionment	Customer Contribution
<b>Contestable Work</b>			
2 MVA 11kV Substation	£ 40,000	n/a	£ 40,000
<b>Non-Contestable Work</b>			
2 by 11kV Closing Joints	£ 5,000	n/a	£ 5,000
<b>Total Extension Asset Cost</b>	£45,000		<b>£45,000</b>
<b>CIC Charges</b>			£200

**Total Connection Charge = £ 66,666 + £ 45,000 = £ 111,666**



### 5.1.22. Example 16: New 250kVA Generation Connection, Voltage Rise Triggered Reinforcement

A Customer wishes to connect a new generator with a Required Capacity for export of 250kVA. The Minimum Scheme for connection of the generator requires the local 11kV overhead line to be reinforced with 100mm<sup>2</sup> conductor over part of its length in order to keep voltage rise within acceptable limits. The thermal capacity of the 100mm<sup>2</sup> overhead line is 5MVA. The thermal capacity of the original 50mm<sup>2</sup> overhead line is 3MVA. A new 315kVA ground mounted substation requires to be installed at the premises. The overhead line is 1km in length but only 500m is required to be reinforced in order to keep voltage rise within acceptable limits.

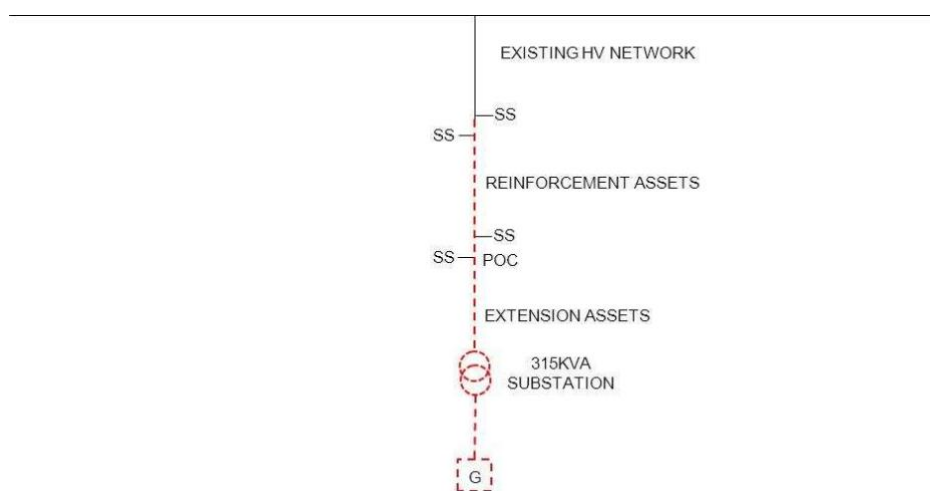

#### Reinforcement:

The RSN for the Reinforcement is the 11kV overhead line.

Security CAF calculation: the numerator in the CAF calculation is the Required Capacity of the Customer, i.e. 250kVA. The denominator is the New Network Capacity following Reinforcement, this being the maximum generation that could be connected whilst keeping the voltage rise within acceptable limits. As the length of overhead line to be reinforced has been determined to accommodate the 250kVA requirement only, then this is also 250kVA in this case.

Fault Level CAF calculation: this scheme does not have any significant Fault Level contribution to the existing shared use distribution network and Fault Level CAF is therefore not applicable here.

The Connection Charge for this Scheme is calculated as follows:

#### Reinforcement Costs:

	Cost	Apportionment	Customer Contribution
<b>Non-Contestable Work</b>			
Replacement of 11kV overhead line conductor	£ 25,000	$250 / 250 \times 100\% = 100\%$	£ 25,000
<b>Total Reinforcement Cost</b>	£ 25,000		£ 25,000

**Extension Assets:**

	Cost	Apportionment	Customer Contribution
<b>Contestable Work</b>			
Provision & Installation of 315kVA substation	£ 50,000	n/a	£ 50,000
<b>Non-Contestable Work</b>			
11kV Joint to network	£ 1,000	n/a	£ 1,000
<b>Total Extension Asset Cost</b>	£51,000		<b>£51,000</b>
<b>CIC Charges</b>			£200

**Total Connection Charge = £ 25,000 + £ 51,000 = £ 76,000**

## 6. OUR SPECIFIC CONNECTION CHARGING METHODOLOGY

### 6.1.1. Introduction

This Section sets out Our Specific Connection Charging Methodology.

Any changes to this Section must be in accordance with the provisions of Condition 13 of the License.

### 6.1.2. Competition in Connections

### 6.1.3. Non-Contestable Work

The following works in respect of the existing Distribution System are deemed to be Non-Contestable:

- Processing your application and Distribution System planning for the connection;
- Deciding upon the POC to the Distribution System;
- Connection of the Extension Assets or diverted assets to the Distribution System and their Energisation where the connection is made to an overhead line (An accredited ICP may, with our prior agreement, connect Extension Assets where the connection is made to that part of the Distribution System that falls within the development area and has previously been installed by the ICP and Adopted by us under the same Scheme);
- Design, planning and specification of any works for Reinforcement of our Distribution System;
- Carrying out of any works for Reinforcement of our Distribution System where the conditions for such activity being Contestable Work are not met. Reinforcement (other than design, and specification) and diversionary works may be contested when associated with the provision of a connection and subject to the circumstances described in Section 6);
- Design, planning, specification and carrying out of any works for diversion of the Distribution System where the conditions for such activity being Contestable Work are not met (the design of the diversionary works may be contested when associated with the provision of a connection and subject to the circumstances described in Section 6); and
- Removal of existing Electrical Plant and Electric Lines.

The following works in respect of the Contestable Work are deemed to be Non- Contestable:

- Specification of design and installation criteria and materials to be used for Contestable Works;
- Concluding any Land Rights and other consents that we require;
- Approval of the ICP's design;
- Operation, repair and maintenance of the Electrical Plant and the Electric Lines following adoption by us; and
- Inspection, monitoring and testing of any Contestable Work.

#### 6.1.4. Inspection and Monitoring

We will inspect and monitor some of the Contestable Work provided by the appointed ICP. The maximum number of visits charged will be determined based on a percentage of the number of days of activity notified by the ICP to us on daily whereabouts notifications.

Charges to ICPs will be made in arrears based on the actual number of audits carried out up to a maximum from the table below.

% of number of days notified	Level 1	Level 2	Level 3
Service work including street lighting	20%	5%	2%
Low Voltage mains work	50%	10%	5%
High Voltage mains work	100%	60%	20%
Extra High Voltage & 132kV work	Agreed per project		

ICPs will move between the different levels of audit quarterly based on the following criteria:

- Reducing levels of audit
  - 100% pass rate in quarter (based on a minimum of 5 audits)
- Increasing levels of audit
  - <100%pass rate in quarter

### 6.1.5. Factors influencing Competition in Connection (CIC) Charges

Illustrative costs for Competition in Connection (CIC) Charges are shown in Section 7. Such illustrative charges reflect normal cost situations. The actual charges associated with specific projects will be based on our estimate of the level of the work required. The factors, which influence the actual level of charges, include:

- The amount of network analysis required to determine the optimum means of providing connections. The amount of network analysis undertaken would be influenced by, amongst other factors, the number of connections and connection capacity requested by the applicant, characteristics of the load to be connected and the capacity of the existing Distribution System.
- The level of management and job scheduling required for the connection project. The management and job scheduling costs associated with projects that are completed over a long timescale would tend to be higher than those costs associated with projects that are completed over a short timescale.
- The number and complexity of Land Rights required. Some technically simple connections, such as the installation of an LV underground cable, could require more than one wayleave or consent.

### 6.1.6. Contestable Work

In contrast, the following work may, at your discretion, be carried out in its entirety either by us or by an ICP, in accordance with the approved design and specification:

- Design of the Contestable Work;
- The procurement and provision of equipment and materials to our current specification for the Contestable Work;
- Trenching and other preparation of the site, including the circuit routes between the development and the POC;
- Construction of the Contestable Work;
- Connection of the Extension Assets or diverted assets to the Distribution System and their Energisation where the connection is not made to an overhead line;
- Recording of work done and of the location of cable routes and other equipment on site or elsewhere (where those assets are installed by the ICP), and the provision of this information to us;
- Reinstatement (both temporary, if appropriate, and permanent); and
  - Making provision for the installation of metering equipment.

Under certain circumstances and at our sole discretion, we may agree with you to undertake part of the Contestable Work whilst we carry out the remainder where it is practical to do so.

The Contestable design element must comply with the appropriate part of Engineering Recommendation G81 and any of our specific requirements. Following receipt of the design of the Contestable Work, we shall either provide confirmation of approval or explanation for rejection. Such approval shall not be unreasonably withheld. A charge will be made for the approval of any design work undertaken by an ICP. A table showing charges for providing design approval is given in Section

7. Information regarding these charges will be included within the POC Offer.

We may, on occasion, request the ICP to include additional features in the design. Such request shall be made in writing and as soon as is reasonably practicable. Where the ICP accepts this request, we will meet the agreed additional cost.

The specification for design, materials, installation and recording, is governed by Engineering Recommendation G81, a seven part national framework document administered by the Energy Networks Association that is designed to be supplemented by our specific appendices. Any ICP carrying out such Contestable Work must comply with the specification.

The seven parts comprise:

For green field and brown field housing estates: Part 1:

Framework for Design and Planning Part 2:

Framework for Materials Specification Part 3:

Framework for Installation and Records

For industrial and commercial connections: Part 4:

Framework for Design and Planning

Part 5: Framework for Materials Specification Part 6:

Framework for Installation and Records

All of the above must be read in conjunction with our corresponding suite of Appendices that supplement Engineering Recommendation G81. For diversionary and Reinforcement works:

Part 7: Framework for contestable diversionary and Reinforcement underground and overhead works not exceeding 33kV and HV/LV distribution substations.

### 6.1.7. Contestable Reinforcement & Diversionary Work

Certain types of Reinforcement and Diversionary Work may also be carried out by Suitably accredited ICPs for adoption by us. The scope of such work is limited to: Reinforcement and diversionary works, associated with a connection, which:

- Are new works that are physically and electrically separate from our existing Distribution System;
- Do not require access to our existing operational areas;
- Are fully funded by the single third party who is seeking the connection; and
- Are restricted to works to install overhead lines and underground cables at voltage levels not exceeding 33kV and works to install HV/LV distribution substations. The design of Reinforcement works can require a large volume of information about the Distribution System. The level and complexity of information that would need to be made available to allow the ICP to carry out such design works is likely to outweigh the benefits of including design work within the scope of contestability. The design of connection Reinforcement therefore remains Non-contestable.

The design of the majority of diversion projects associated with connection projects is likely to be less complex than the design of Reinforcement Schemes. The design of diversionary works can be contestable for overhead lines and underground cables not exceeding 33kV and for HV/LV distribution substations.

The dismantlement and disposal of our existing assets remains Non-Contestable because it would require access to our existing assets and/or operational areas.

### 6.1.8. Table of Contestable/Non-Contestable Work

The following table summarises elements of the work as either Contestable or Non- Contestable and the types of company that can complete the works.

REF	Activity	C=Contestable N=Non- Contestable	LENL	ICP	Applicant or Developer
1	Determine POC to Distribution System	N	Yes	No	No
2	Design of Extension Assets	C	Yes	Yes	No
3	Design upstream Reinforcement works associated with new connections.	N	Yes	No	No
4	Design diversionary works associated with new connections	C	Yes	Yes	No
5	Design approval	N	Yes	No	No
6	Plant and materials specifications	N	Yes	No	No
7	Procure materials for own works	C	Yes	Yes	No
8	Land Rights negotiations with third party landowners	C	Yes	Yes	Yes
9	Produce wayleave/easement documentation and enter into agreements with third party landowners	N	Yes	No	No
10	Trench excavation and duct installation – on site	C	Yes	Yes	Yes
11	Trench excavation and duct installation – on public highway	C	Yes	Yes	No
12	Construction of substation buildings and other civil works – on site	C	Yes	Yes	Yes
13	Cable laying for own works	C	Yes	Yes	No
14	Substation plant installation for own works	C	Yes	Yes	No
15	Excavation for jointing bay – on site	C	Yes	Yes	Yes
16	Excavation for own works jointing bay – public highway	C	Yes	Yes	No
17	Jointing (dead) of cables within Extension Assets	C	Yes	Yes	No



18	Jointing (live at LV) to connect Contestable Works to Distribution System (closing joints) <sup>1</sup>	C	Yes	Yes	No
19	Excavation for joints to connect Contestable Works to Distribution System (closing joints)	C	Yes	Yes	No
20	Live LV jointing on newly adopted New Extension Assets <sup>2</sup>	C	Yes	Yes	No
21	Reinforcement/diversionary work on the existing Distribution System	N	Yes	<sup>3</sup> No	No
22	Quality assurance inspections	N	Yes	No	No
23	Testing of Extension Assets installed by ICP	C	Yes	Yes	No
24	Commissioning and connection of Extension Assets to the Distribution System	N	Yes	No	No
25	Recording of installed assets	C	Yes	<sup>4</sup> Yes	No
26	Operations, repairs and maintenance	N	Yes	No	No

<sup>1</sup> Where the connection is not to an overhead line.

<sup>2</sup> Live LV jointing may be carried out by a suitably accredited ICP subject to our prior agreement.

<sup>3</sup> Sole funded Reinforcement and diversionary works associated with the new connection carried out independently of the existing Distribution System will be treated as Contestable Work.

<sup>4</sup> Only for Contestable Works installed by the ICP

### 6.1.9. Payment Terms

In most circumstances we require payment in full on your acceptance of the Connection Offer or POC Offer. For large projects where the work is undertaken over an extended period of time payments may be phased, subject to our agreement. Where phased payments are agreed the payments will always be in advance of committed expenditure.

The exception is where single customers request many small value connections on an ongoing basis and where we believe there is minimal possibility of payment default. This typically relates to unmetered connections such as street lighting. In these circumstances we may agree to payment in arrears.

### 6.1.10. Connection Offer and POC Offer Terms and Conditions

Connection Offers and POC Offers are on our standard terms and conditions. Where you require alternative terms and conditions we will negotiate special terms with you as provided for in section 22 of the Electricity Act. Our costs incurred in the negotiation of the special terms, including where we appoint legal advisors, are recoverable from you.

### 6.1.11. Land Rights

We require the transfer of the freehold or alternatively the grant of long leasehold of any substation site which forms part of the Contestable or Non-Contestable Works.

We require the grant of a permanent easement (deed of grant) for any Electric Line that forms part of the Contestable or Non-Contestable Works which will not form part of an adopted or prospectively adopted highway. We may in some cases accept a wayleave as an alternative.

In instances we cannot obtain Land Rights by negotiation; we may exercise our powers of compulsory purchase under the Electricity Act 1989 or apply under the Act to the Secretary of State for a 'Necessary Wayleave'.

	Regulated Margin	Unregulated Margin
<b>In respect of metered premises owned or occupied by Demand Customers:</b>		
(i) <b>Single LV service demand Connections:</b> defined in Section 7	N/A	N/A
(ii) <b>Small Project Demand Connections:</b> defined in Section 7	N/A	N/A
(iii) <b>LV Work:</b> other low voltage connection activities involving only low voltage works	N/A	N/A
(iv) <b>HV work:</b> Low voltage or high voltage connection activities involving high voltage work	N/A	N/A
(v) <b>HV &amp; EHV work:</b> Low voltage or high voltage connection activities involving extra high voltage work	N/A	N/A
(vi) <b>EHV Work and Above:</b> extra high voltage and 132KV Connection activities	N/A	N/A

	Regulated Margin	Unregulated Margin
<b>In respect of metered premises in which Distributed Generation is Situated:</b>		
(vii) <b>LV Work:</b> other low voltage connection activities involving only low voltage works	N/A	N/A
(viii) <b>HV and EHV Work:</b> Any connection Activities involving work at high voltage or above	N/A	N/A

	Regulated Margin	Unregulated Margin
<b>In respect of Unmetered premises:</b>		
(ix) <b>LA Work:</b> New connection activities in respect of local authority premises.	N/A	N/A
(x) <b>PFI Work:</b> New connection activities under private finance initiatives.	N/A	N/A
(xi) <b>Other Work:</b> all other non-local authority and non-PFI unmetered connections work	N/A	N/A

### 6.1.12. Capitalised Operation and Maintenance Charges

The Operation and Maintenance Percentage is 24%

### 6.1.13. Projects

Where we have reason to believe that an application for connection forms part of a larger project then we will use the aggregate capacity of the projects to determine the appropriate Connection Charge.

### 6.1.14. Non-Standard Substation Buildings

Where you require us to locate substation plant and equipment within a non-standard building or enclosure e.g., where the substation is to form an integral part of a building also to be used for other purposes then other charges will normally apply for building and design work and on-site inspections. Charges for this type of work will be consistent with those we make where we adopt networks from an ICP.

### 6.1.15. Charges for Assessment and Design

Where permitted under relevant legislation, charges for Assessment and Design may be applied. This may be by way of a standard charge based on the type, voltage and maximum required capacity of the connection, as indicated in Section 7 of this document. Where the applicant changes its requirements or requests multiple quotes in respect of the same or a similar connection to the premises, additional Assessment and Design work, not covered in the standard charge, may be required to update the original design. Where this is the case, the customer's charge in respect of Assessment and Design will be equal to the standard charge associated with the original Assessment and Design work, plus a charge in respect of the additional work applied by way of an hourly rate.

### 6.1.16. Reservation of Import Capacity

We may, on occasion, be required to pay charges for reserving capacity on another LDNO's network at the boundary between our network and theirs. On such occasions these charges will be passed through to you and will form part of the Connection Charge.

Any costs relating to the reservation of import capacity will be calculated in accordance with the upstream LDNO's own connection charging methodology and will be passed through to you as they are charged to us.

We will not make charges relating to the reservation of import capacity where the capacity being reserved relates directly to capacity available on our networks and an equivalent capacity charge has not been levied on us.

### 6.1.17. Contestable and Non-Contestable Works

A list of the works that we deem to be contestable and the works that we deem to be non-contestable can be found in Section 3.

## 7. SECTION 7. OUR CONNECTION CHARGING STATEMENT

### 7.1.1. Introduction

This section sets out our Connection Charging Statement and is prepared in accordance with Standard Condition 14 of the License.

The purpose of this statement is to enable any person to make a reasonable estimate of the charges for which they may become liable for the provision of a connection to our Distribution System.

The minimum and maximum values of charges shown in the following tables are designed to provide you with an indication of the range of charges that would normally apply to a particular activity and are therefore not absolute limits on the minimum nor the maximum value of charge that may be levied. The actual charge for each activity will be calculated based upon the project specific circumstances, which may take account of factors that will influence the value of the charge payable to you.

All indicative charges in the table below are exclusive of VAT.

All indicative charges are applicable to connections to Distribution Systems owned by Leep Electricity Networks Limited.

Connection Charges may contain some or all of the cost elements indicated in the following table. You do not need to have requested a Budget Estimate or Feasibility Study before you request a formal Connection Offer.

	Charge Element	Explanation
A	Budget Estimates	To identify the budget costs for connection to the existing Distribution System in advance of a formal application.
B	Feasibility Studies	To identify options for connection to the existing Distribution System in advance of a formal application.
C	Assessment and Design for all relevant work	To identify the most appropriate point on the existing Distribution System for connection of the Extension Assets, the design of the Extension Assets, any required Reinforcement and prepare the Connection Offer.
D	CIC Assessment and Design of the Non-Contestable Work	To identify the most appropriate point on the existing Distribution System for connection of the Extension Assets, the design of any required Reinforcement and prepare the Point of Connection Offer.
E	CIC Design Approval of the Contestable Work	For CIC the approval of an Extension Assets design produced by an ICP.
F	Construction	Electric Lines and Electrical Plant forming part of the Extension Assets and Reinforcement (both Contestable and Non-Contestable Assets).
G	CIC Final Works and Phased Energisation	<p>Final Works means the installation of the connection equipment in such a way that, subject to Energisation, the Premises are physically able to receive a supply of electricity from our Distribution System or (as the case may be) our Distribution System is physically able to receive a supply of electricity from the Premises.</p> <p>Phased Energisation, in relation to a part only of the premises, means the physical ability, subject to the completion of final works, to allow and electrical current to flow from (or to) our Distribution System to (or from) that part by means of the insertion of a fuse or as a result of a switching operations.</p>
H	CIC Inspection and Monitoring	Inspection and Monitoring by us of the Contestable Work constructed by an ICP.
I	Land Rights	The costs of securing Land Rights in respect of Extension Assets and Reinforcement
J	Other	Other miscellaneous charges associated with the provision of the connection.

The following definitions are used in this section.

<b>Single LV Service Demand Connection</b>	An LV demand connection to single Premises, involving a single- phase connection and no significant work other than the provision of a service line and the electricity distributor's fuses.
<b>Service Line</b>	A low-voltage electric line or any part of that line that will, at the time it is provided, be used only for supplying single Premises, excluding any part of the line that, at the time it is provided, is intended by the distributor to be used to enable it to provide a connection to other Premises in respect of which the distributor has received, or would reasonably expect within the following 12 months to receive, a notice under section 16A(1) of the Act.
<b>Small Project Demand Connection</b>	<p>A connection (other than of a load that could reasonably be expected to cause disruption to other customers) (via low-voltage circuits fused at 100 amperes or less per phase with whole-current metering), and where the highest voltage of the assets involved in providing such connection, and any associated works, is low voltage, to:</p> <ul style="list-style-type: none"> <li>(a) A development Scheme requiring more than one but fewer than five single-phase connections at domestic Premises and involving only the provision of a service line and the electricity distributor's fuses; or</li> <li>(b) A development Scheme requiring fewer than five single-phase or two-phase connections at domestic Premises and involving an extension of the existing low voltage network; or</li> <li>(c) A single Premises requiring a two-phase or three- phase connection and involving only the provision of a service line and the electricity distributor's fuses.</li> </ul>

### 7.1.2. Quotation Accuracy Scheme

We are required in our License to submit from time to time to the Authority for approval a Quotation Accuracy Scheme (QAS). The QAS is intended to provide information so that you can assess whether the specific Connection Charge included with our Connection Offer to you is accurate in terms of consistency with our Connection Charging Statement.

The QAS only applies to Single LV Service Demand Connections and Small Project Demand Connections. The cost tables for these projects are given in tables F1 and F2 further in this Section.

The principles of the QAS are as follows:

- The QAS is not intended to be a mechanism for you to challenge the absolute cost of the Connection Charge.
- If the information included in the Connection Offer is such that the Connection Charge is outside the bands of indicative costs then you would be eligible to challenge the accuracy of the connection offer.
- If the information included in the Connection Offer is such that the Connection Charge is outside the bands of indicative costs then you would be eligible to challenge the accuracy of the Connection Offer. You would be required to provide a statement to explain why you believed the quotation to be outside the range.
- Absence of information in the Connection Offer does not in itself mean that the Connection Charge is inaccurate but does allow you to enter the QAS. This therefore acts as an incentive to us to include additional information to you to limit the number of customers eligible to enter to QAS.
- Where we review the Connection Offer and accept that we have not provided enough information and therefore the Connection Charge is outside the bands of indicative costs, the Connection Charge will be deemed to be inaccurate, a penalty payment will be paid to you and a new Connection Offer issued. The revised Connection Charge may in fact be for the same value but with additional information provided.
- If we can demonstrate that additional information was provided in the Connection Offer in support of our Connection Charge then no penalty payment will be made.
- Where we review the Connection Offer and accept that we have made an error, for example, in estimating quantities then the Connection Charge will be deemed inaccurate. In these circumstances, a penalty payment will be paid and a new Connection Offer issued.
- If we are able to provide additional information in support of our charges then no payment would be made.
- The accuracy assessment will work both ways, i.e., any error may be an omission and a re-issued Connection Offer could be higher or lower than the original Connection Charge.
- Some tolerances for the error would apply, for example within 5% or £150 (whichever is greater). This prevents a disproportionate effect for assets such as small lengths of cable if our view and your view of the required length differ.
- The QAS is not intended to introduce standard charges for connections customers.
- The QAS will have specified time limited whereby you can challenge the Connection Charge but will not preclude you from accepting the Connection Charge.



Where you believe the Connection Offer provided by us is outside the “bandwidth” in the indicative charges table contained in this statement then you can enter the QAS.

You can enter the QAS by contacting us at the address given in Section 1.30.

## 8. PART A Feasibility Studies

Prior to making a formal Application for a Connection Offer you may request we undertake a Feasibility Study to establish the viability of making a connection to our Distribution System. We will carry out preliminary network analysis and provide an indicative connection assessment, which will include the results of the network analysis and an outline of the engineering scheme to allow the connection. We will require payment in advance of the study being made and will notify you of the relevant study charges prior to commencing work.

Our charges associated with the provision of Feasibility Studies involving design in advance of a formal Connection Application are set out in the table below. Charges for any other activities, such as excavation work, will be individually assessed and agreed with you before the work is undertaken. The Minimum Charge will always apply. Additional charges will only be applicable where the Applicant amends their connection requirements, and this necessitates us to carry out further analysis or assessment:

Category	Minimum Charge	Additional Charge
<b>Demand</b>		
Single LV Service Demand Connection <sup>A</sup>	POA	£66
2 to 4 services single phase LV, no extension to LV network <sup>B</sup>	POA	£66
1-4 Premises, single phase LV, extension to the LV network required <sup>C</sup>	POA	£66
1 three phase LV service with whole current metering to a single Premises <sup>D</sup>	POA	£66
Other LV connection(s) with a total load up to 100kVA LV	£580	£83
Other LV connection(s) with a total load greater than 100kVA and up to 250kVA LV not covered by the above	£580	£83
Connection greater than 250kVA and up to 1MVA at LV	£663	£83
Connection up to 250kVA at HV	£663	£83
Connection greater than 250kVA and up to 1MVA at HV	£696	£83
Connection greater than 1MVA and up to 3MVA at HV	£869	£86
Connection greater than 3MVA and up to 10MVA at HV	£1,684	£100
Connection greater than 3MVA and up to 10MVA at EHV	£2,526	£100
Connection greater than 10MVA and up to 50MVA	£3,768	£100
Connection greater than 50MVA	£7,535	£100
<b>Generation</b>		
Connection of a single Small Scale Embedded Generator (Note A)	£232	£79
Connection of other generation at LV up to 20kVA not covered by the above	£678	£86
Connection of other generation at LV greater than 20kVA and up to 50kVA	£904	£86
Connection of other generation at LV greater than 50kVA	£1,266	£86
Connection of generation at HV up to 250kVA	£1,447	£86
Connection of generation at HV greater than 250kVA and up to 1MVA	£1,808	£100
Connection of generation at HV greater than 1MVA	£2,948	£100
Connection of generation at EHV up to 10MVA	£4,633	£100
Connection of generation at EHV greater than 10MVA	£4,633	£100
Connection of generation greater than 50MVA	£7,535	£100

A	Refer to 7.7 above, for detailed definition	
B	Refer to Small Project Demand Connection (a) for detailed definition.	
C	Refer to 7.7 above, Small Project Demand Connection (b) for detailed definition.	
D	Refer to 7.7 above, Small Project Demand Connection (c) for detailed definition.	

**Note:** “LV”, “HV”, or “EHV” in the table above denotes the highest voltage of assets installed including any associated Reinforcement or diversionary works.

## 9. PART B Assessment and Design for all relevant work

For applications received where you require us to undertake all the works, our charges associated with the identification of the most appropriate point on the existing Distribution System for connection and the design of any Extension Assets and/or Reinforcement are set out in the table below. We may levy additional assessment and design charges where the work undertaken exceeds the costs included in the minimum charge:

Category	Minimum Charge	Additional Charge
<b>Demand</b>		
Single LV Service Demand Connection <sup>A</sup>	<b>£139</b>	<b>£0</b>
2 to 4 services single phase LV, no extension to LV network <sup>B</sup>	<b>£537</b>	<b>£0</b>
1-4 Premises, single phase LV, extension to the LV network required <sup>C</sup>	<b>£537</b>	<b>£0</b>
1 three phase LV service with whole current metering to a single Premises <sup>D</sup>	<b>£139</b>	<b>£0</b>
Other LV connection(s) with a total load up to 100kVA LV	<b>£1,727</b>	<b>£83</b>
Other LV connection(s) with a total load greater than 100kVA and up to 250kVA LV not covered by the above	<b>£2,434</b>	<b>£83</b>
Connection greater than 250kVA and up to 1MVA at LV	<b>£3,026</b>	<b>£83</b>
Connection up to 250kVA at HV	<b>£2,736</b>	<b>£83</b>
Connection greater than 250kVA and up to 1MVA at HV	<b>£5,483</b>	<b>£83</b>
Connection greater than 1MVA and up to 3MVA at HV	<b>£7,825</b>	<b>£86</b>
Connection greater than 3MVA and up to 10MVA at HV	<b>£8,926</b>	<b>£100</b>
Connection greater than 3MVA and up to 10MVA at EHV	<b>£8,926</b>	<b>£100</b>
Connection greater than 10MVA and up to 50MVA	<b>£8,695</b>	<b>£116</b>
Connection greater than 50MVA	<b>£8,695</b>	<b>£116</b>
<b>Generation</b>		

Connection of a single Small Scale Embedded Generator (Note A)	<b>£166</b>	<b>£83</b>
Connection of other generation at LV up to 20kVA not covered by the above	<b>£1,727</b>	<b>£86</b>
Connection of other generation at LV greater than 20kVA and up to 50kVA	<b>£2,307</b>	<b>£86</b>
Connection of other generation at LV greater than 50kVA	<b>£6,051</b>	<b>£86</b>
Connection of generation at HV up to 250kVA	<b>£6,631</b>	<b>£100</b>
Connection of generation at HV greater than 250kVA and up to 1MVA	<b>£8,080</b>	<b>£100</b>
Connection of generation at HV greater than 1MVA	<b>£11,291</b>	<b>£100</b>
Connection of generation at EHV up to 10MVA	<b>£10,955</b>	<b>£100</b>
Connection of generation at EHV greater than 10MVA	<b>£10,955</b>	<b>£94</b>
Connection of generation greater than 50MVA	<b>£11,593</b>	<b>£94</b>
A      Refer to 7.7 above, for detailed definition		
B      Refer to Small Project Demand Connection (a) for detailed definition.		
C      Refer to 7.7 above, Small Project Demand Connection (b) for detailed definition.		
D      Refer to 7.7 above, Small Project Demand Connection (c) for detailed definition.		

*Note: "LV", "HV", or "EHV" in the table above denotes the highest voltage of assets installed including any associated Reinforcement or diversionary works.*

## 10.PART C Budget Estimates

If you are unable to make a formal Application because certain information that we require to make a Connection Offer is not available or if you are not in a position to progress to the construction phase, we can provide an indication of the charge for making the connection by means of a Budget Estimate. Our charges associated with the provision of Budget Estimates in advance of a formal Application are set out in the table below:

Category	Charge
<b>Demand</b>	
Single LV Service Demand Connection <sup>A</sup>	£0
2 to 4 services single phase LV, no extension to LV network <sup>B</sup>	£0
1-4 Premises, single phase LV, extension to the LV network required <sup>C</sup>	£0
1 three phase LV service with whole current metering to a single Premises <sup>D</sup>	£0
Other LV connection(s) with a total load up to 100kVA LV	£166
Other LV connection(s) with a total load greater than 100kVA and up to 250kVA LV not covered by the above	£166
Connection greater than 250kVA and up to 1MVA at LV	£166
Connection up to 250kVA at HV	£166
Connection greater than 250kVA and up to 1MVA at HV	£181
Connection greater than 1MVA and up to 3MVA at HV	£211
Connection greater than 3MVA and up to 10MVA at HV	£211
Connection greater than 3MVA and up to 10MVA at EHV	£211
Connection greater than 10MVA and up to 50MVA	£211
Connection greater than 50MVA	£166
<b>Category</b>	<b>Charge</b>
<b>Generation</b>	
Connection of a single Small Scale Embedded Generator ( <b>Note A</b> )	£0
Connection of other generation at LV up to 20kVA not covered by the above	£181
Connection of other generation at LV greater than 20kVA and up to 50kVA	£181
Connection of other generation at LV greater than 50kVA	£181
Connection of generation at HV up to 250kVA	£181
Connection of generation at HV greater than 250kVA and up to 1MVA	£181
Connection of generation at HV greater than 1MVA	£211
Connection of generation at EHV up to 10MVA	£211
Connection of generation at EHV greater than 10MVA	£211
Connection of generation greater than 50MVA	£211
A Refer to 7.7 above, for detailed definition B Refer to Small Project Demand Connection (a) for detailed definition. C Refer to 7.7 above, Small Project Demand Connection (b) for detailed definition. D Refer to 7.7 above, Small Project Demand Connection (c) for detailed definition.	

## 10.1. PART D CIC Assessment and Design of the Non-Contestable Work

For applications received where you have requested an ICP to carry out the Contestable Works, our charges associated with the identification of the most appropriate point on the existing Distribution System for connection of the Extension Assets and the design of any Network Reinforcement are set out in the Table below:

Category	Minimum Charge	Additional Charge
<b>Demand</b>		
Single LV Service Demand Connection <sup>A</sup>	£290	£0
2 to 4 services single phase LV, no extension to LV network <sup>B</sup>	£290	£0
1-4 Premises, single phase LV, extension to the LV network required <sup>C</sup>	£290	£0
1 three phase LV service with whole current metering to a single Premises <sup>D</sup>	£290	£0
Other LV connection(s) with a total load up to 100kVA LV	£464	£83
Other LV connection(s) with a total load greater than 100kVA and up to 250kVA LV not covered by the above	£581	£83
Connection greater than 250kVA and up to 1MVA at LV	£1,194	£83
Connection up to 250kVA at HV	£2,017	£83
Connection greater than 250kVA and up to 1MVA at HV	£3,466	£83
Connection greater than 1MVA and up to 3MVA at HV	£4,904	£83
Connection greater than 3MVA and up to 10MVA at HV	£5,773	£100
Connection greater than 3MVA and up to 10MVA at EHV	£5,796	£100
Connection greater than 10MVA and up to 50MVA	£5,796	£94
Connection greater than 50MVA	£5,796	£116
<b>Generation</b>		
Connection of a single Small Scale Embedded Generator (Note A)	£166	£83
Connection of other generation at LV up to 20kVA not covered by the above	£417	£86
Connection of other generation at LV greater than 20kVA and up to 50kVA	£2,017	£86
Connection of other generation at LV greater than 50kVA	£5,194	£86
Connection of generation at HV up to 250kVA	£5,483	£100
Connection of generation at HV greater than 250kVA and up to 1MVA	£6,921	£100
Connection of generation at HV greater than 1MVA	£8,080	£100
Connection of generation at EHV up to 10MVA	£8,208	£100
Connection of generation at EHV greater than 10MVA	£8,208	£94
Connection of generation greater than 50MVA	£8,208	£94
A Refer to 7.7 above, for detailed definition		
B Refer to Small Project Demand Connection (a) for detailed definition.		
C Refer to 7.7 above, Small Project Demand Connection (b) for detailed definition.		
D Refer to 7.7 above, Small Project Demand Connection (c) for detailed definition.		

## 10.2. PART E CIC Design Approval of the Contestable Work

For applications received where you have elected an ICP to undertake the Contestable Work, our charges associated with the approval of an Extension Asset design produced by an ICP are set out in the Table below:

Category	Minimum Charge	Additional Charge
<b>Demand</b>		
Single LV Service Demand Connection <sup>A</sup>	£305	£0
2 to 4 services single phase LV, no extension to LV network <sup>B</sup>	£305	£0
1-4 Premises, single phase LV, extension to the LV network required <sup>C</sup>	£305	£72
1 three phase LV service with whole current metering to a single Premises <sup>D</sup>	£305	£72
Other LV connection(s) with a total load up to 100kVA LV	£696	£72
Other LV connection(s) with a total load greater than 100kVA and up to 250kVA LV not covered by the above	£754	£94
Connection greater than 250kVA and up to 1MVA at LV	£1,136	£94
Connection up to 250kVA at HV	£1,159	£94
Connection greater than 250kVA and up to 1MVA at HV	£1,507	£94
Connection greater than 1MVA and up to 3MVA at HV	£2,898	£116
Connection greater than 3MVA and up to 10MVA at HV	£5,796	£116
Connection greater than 3MVA and up to 10MVA at EHV	£1,826	£116
Connection greater than 10MVA and up to 50MVA	£2,105	£0
Connection greater than 50MVA	£2,526	£0
<b>Generation</b>		
Connection of a single Small Scale Embedded Generator (Note A)	£305	£0
Connection of other generation at LV up to 20kVA not covered by the above	£332	£0
Connection of other generation at LV greater than 20kVA and up to 50kVA	£332	£72
Connection of other generation at LV greater than 50kVA	£609	£72
Connection of generation at HV up to 250kVA	£1,159	£94
Connection of generation at HV greater than 250kVA and up to 1MVA	£2,898	£94
Connection of generation at HV greater than 1MVA	£2,898	£94
Connection of generation at EHV up to 10MVA	£1,805	£116
Connection of generation at EHV greater than 10MVA	£2,105	£116
Connection of generation greater than 50MVA	£2,947	£116
A Refer to 7.7 above, for detailed definition B Refer to Small Project Demand Connection (a) for detailed definition. C Refer to 7.7 above, Small Project Demand Connection (b) for detailed definition. D Refer to 7.7 above, Small Project Demand Connection (c) for detailed definition.		



## 10.3. PART F CONSTRUCTION

### 10.3.1. F1 Small Services covered by the Quotation Accuracy Scheme

Our charges associated with the construction of small connections as 1-4 single phase connection up to 60kVA) are set out below: -

These charges are covered by the Quotation Accuracy Scheme outlined previously.

Charges in the tables below include:

- Both the Contestable Work and Non-Contestable Work, however these will be identified as separate elements within your Connection Offer. Note that your Connection Offer will also include charges for Assessment and Design.
- Liaison with the highway authorities, submitting street works notices and/or permit applications. These charges exclude traffic management costs e.g. temporary traffic lights, road closures etc. and Traffic Management Act costs. Where these additional charges are relevant, these will be included in your connection charge.
- Providing and setting out signing, lighting, and guarding

The minimum and maximum values of charges shown in the following tables are designed to provide you with an indication of the range of charges that would normally apply to a particular activity and therefore not absolute limits on the minimum and maximum value of charge that may be levied.

Additional costs sometimes need to be included within your quotation to meet your specific connection requirements and these are excluded from the min/max range of potential connection charges set out below. Where additional costs have been included, we will provide an explanation. Examples of these additional costs can include, but are not limited to:

- Easements, wayleaves or land transfers if required, as detailed in Table I, Land Rights
- Traffic management costs, e.g. temporary traffic lights and road closures
- Lane rental charges and permit costs imposed by local authorities
- Works outside of normal business hours (including weekends, bank holidays and night working)
- Shutdowns to isolate existing sections of network to enable the works to be carried out safely, when required
- Cable routes with engineering difficulties, e.g. river and rail crossings
- Same day reinstatement of excavated grounds, where requested by yourselves or the Local Authority

What factors influence the cost:

- The size and length of cable we are required to install to facilitate your required load
- The location of the point of connection onto our existing network
- The type of footpath we are required to excavate and reinstate, e.g. a tarmac footpath would be cheaper to excavate and reinstate than a footpath made up with paving slabs which may need to be temporarily removed from site for the duration of the works
- The type of carriageway we are required to excavate and reinstate, e.g. a cul-de-sac could be cheaper to excavate and reinstate than a main road passing through a city centre
- Charges levied by third parties in association with a connection, e.g. fees requested by the Local Authority for road closure applications

How you can minimise the connection cost:

- You can carry out any excavation works required within your own land ownership boundary. We will specify the requirements such as trench depths/widths and the type of ducting to be utilised, where required.
- Ask your nominated electrician to calculate your load requirements, allowing for diversity. This will ensure you do not request a connection larger than you need.
- Consider your proposed service termination location. The greater the distance between the existing network and your required termination, the greater the connection cost could be. If you are unsure of where the existing network is located in regards to your property, please request network plans for the area.

*Range of Potential charges for Underground Connection Works*

Activity	Factors	Unit	Min	Max
<b>Single phase underground service;</b>  Inclusive of connecting new service cable onto the mains and termination of the service cable. Where surface types are specified, the cost is inclusive of excavation and reinstatement of a joint hole to expose the existing cable.  Costs are exclusive of cable installation – Please refer to ‘Cable Installation’ section below for cable provision, installation and trenching costs.	Typical tarmac footpath		<b>£1,253</b>	<b>POA</b>
	Typical unmade ground grass verge		<b>£1,090</b>	<b>POA</b>
	Typical carriageway		<b>£2,320</b>	<b>POA</b>
	Service connection requiring no excavation by DNO*		<b>£1,000</b>	<b>POA</b>

Activity	Factors	Unit	Min	Max
<b>Three phase underground service (up to 60kV A);</b>  Inclusive of connecting new service cable onto the mains and termination of the service cable. Where surface types are specified, the cost is inclusive of excavation and reinstatement of a joint hole to expose the existing cable.  Costs are exclusive of cable installation – Please refer to ‘Cable Installation’ section below for cable provision, installation and trenching costs.	Typical footpath		£1,660	POA
	Typical unmade ground grass verge		£1,660	POA
	Typical carriageway		£2,830	POA
	Service connection requiring no excavation by DNO*		£1,600	POA
<b>Low voltage underground mains cable extension;</b>  Inclusive of connecting a new mains cable onto the existing mains cable and terminating to a bottle end. Where surface types are specified, the cost is inclusive of excavation and reinstatement of a joint hole to expose the existing cable.  Costs are exclusive of cable installation – Please refer to ‘Cable Installation’ section below for cable provision, installation and trenching costs.	Typical footpath		£2,442	POA
	Typical unmade ground grass verge		£1,680	POA
	Typical carriageway		£3,300	POA
	Service connection requiring no excavation by DNO*		£1,255	POA

Activity	Surface Type / Engineering Task	Unit	Min	Max
<b>Cable Installation;</b>  For trench works beyond the joint hole, inclusive of the provision and installation of cable. Where surface types are specified, the cost is inclusive of ground excavation and reinstatement. Additional metres of LV mains cable	Typical footpath		<b>£134</b>	<b>POA</b>
	Typical unmade ground grass verge		<b>£72</b>	<b>POA</b>
	Typical carriageway		<b>£251</b>	<b>POA</b>
	Service connection requiring no excavation by DNO*		<b>£38</b>	<b>POA</b>

*\* In some circumstances, sections of excavation works will not necessarily need to be carried out by LENL (or their representative(s)). This can include excavation within your own land ownership boundaries, of which you can arrange to carry out yourself.*

## F2 Service Alterations

Our charges associated with changes of service positions for single services are set out below.

Please note that you will need to include charges for Assessment and Design, if any..

These charges are covered by the Quotation Accuracy Scheme.

Charges in the tables below include:

- Both the Contestable Work and Non-Contestable Work, however these will be identified as separate elements within your Connection offer
- Liaison with the highways authorities, submitting street works notices and / or permit applications
- Providing and setting out signing, lighting and guarding

The minimum and maximum values of charges shown in the following tables are designed to provide you with an indication of the range of charges that would normally apply to a particular activity and are therefore not absolute limits on the minimum nor the maximum value of charge that may be levied.

Additional costs sometimes need to be included within your quotation to meet your specific connection requirements and these are excluded from the min/max range of potential service alteration charges set out below. Where additional costs have been included we will provide an explanation. Examples of these additional costs can include, but are not limited to:

- Easements, wayleaves or land transfers, if required, as detailed in Table I, Land Rights
- Traffic management costs, e.g. temporary traffic lights and road closures
- Lane rental charges and permit costs imposed by local authorities
- Works outside of normal business hours (including weekends, bank holidays and night working)
- Shutdowns to isolate existing sections of network to enable the works to be carried out safely, if required
- Cable routes with engineering difficulties, e.g. river and rail crossings
- Same day reinstatement of excavated grounds, where requested by yourself or the Local Authority.

What factors influence the cost:

- The size and length of cable we are required to install to facilitate your required load.
- The location of the point of connection onto our existing network.
- The type of footpath we are required to excavate and reinstate, e.g. a tarmac footpath could be cheaper to excavate and reinstate than a footpath made up with paving slabs which may need to be temporarily removed from site for the duration of the works.
- The type of carriageway we are required to excavate and reinstate, e.g. a cul-de-sac could be cheaper to excavate and reinstate than a main road passing through a city centre Charges levied by third parties in association with a service alteration, e.g. fees requested by the Local Authority for road closure applications.

How you can minimise the service alteration cost: You can carry out any excavation works required within your own land ownership boundary. We will specify the requirements such as trench depths / widths and the type of ducting to be utilised, where required. Consider your proposed new service termination location. The greater the distance between the existing network and your required new termination position, the greater the service alteration cost could be.

Further information can be found on our website: [www.leeputilities.co.uk](http://www.leeputilities.co.uk)

*Range of Potential Charges for Underground Service Alteration Works*

Activity	Factors	Unit	Min	Max
<b>Single phase underground service alteration;</b>  Inclusive of connecting new service cable onto the mains and termination of the service cable. Where surface types are specified, the cost is inclusive of excavation and reinstatement of a joint hole to expose the existing cable.  Costs are exclusive of cable installation – Please refer to ‘Cable Installation’ section below for cable provision, installation and trenching costs	Typical footpath		£1,300	£2,104
	Typical unmade ground grass verge		£1,040	£1,428
	Typical carriageway		£2,970	£4,015
	Service connection requiring no excavation by DNO*		£1,300	£1,950
<b>Three phase underground service alteration (up to 60kVA);</b>  Inclusive of connecting new service cable onto the mains and termination of the service cable. Where surface types are specified, the cost is inclusive of excavation and reinstatement of a joint hole to expose the existing cable.  Costs are exclusive of cable installation – Please refer to ‘Cable Installation’ section below for cable provision, installation and trenching costs	Typical footpath		£1,389	POA
	Typical unmade ground grass verge		£1,175	POA
	Typical carriageway		£3,140	POA
	Service connection requiring no excavation by DNO*		£1,424	POA



<b>Overhead service alteration;</b>  Including removal of existing service, connection of replacement service with up to 10 metres of overhead cable and termination of the service. Assumes no additional pole required.	Single Phase		<b>£1,110</b>	<b>POA</b>
	Three Phase		<b>£1,340</b>	<b>POA</b>
<b>Overhead to underground service alteration;</b> Including removal of the existing overhead service and installation of new underground service with connection to a pole, up to 10 metres of cable up the pole and termination of the service cable. No costs are included for any replacement or additional poles.  Costs are exclusive of underground cable installation – Please refer to ‘Cable Installation’ section below for underground cable provision, installation and trenching.	Single Phase		<b>£1,150</b>	<b>POA</b>
	Three Phase		<b>£1,220</b>	<b>POA</b>
<b>Cable Installation;</b> For trench works beyond the joint hole, inclusive of the provision and installation of cable. Where surface types are specified, the cost is inclusive of ground excavation and reinstatement. Additional metres of LV mains cable	Typical footpath		<b>£160</b>	<b>POA</b>
	Typical unmade ground grass verge		<b>£80</b>	<b>POA</b>
	Typical carriageway		<b>£456</b>	<b>POA</b>
	Service connection requiring no excavation by DNO*		<b>£20</b>	<b>POA</b>

### F3 Other Services not covered by the QAS

Our charges associated with construction of services to the Entry/Exit Point that are not covered by the Quotation Accuracy Scheme are given in the table below. These charges are for the connection of service cable only.

Charges below cover both the Contestable Work and Non-Contestable Work, however these will be identified separately on your Connection Offer or Point of Connection Offer. Note that your Connection Offer will also include charges for Assessment and Design as outlined in paragraph 7.16 and may include other charges.

The charges in the table below are inclusive of liaison with highway authorities, sending street works notices and signing, lighting and guarding. These charges exclude Traffic Management Act costs. Where these are additional charges that are relevant, these will be included in your Connection Charge.

These charges exclude charges for any easement, wayleaves or land transfers that are required and these are detailed in Table I, Land Rights.

Activity	Description	Unit	Min	Max
Single phase service, up to 100A (20kVA)	One single phase service, from a passing or extended main, including service cable, mains service joint, and termination. Service cable length up to 5 metres per service. Duct installation, excavation and backfill joint hole undertaken by third party		£970	POA
	Multiple single phase service, from an extended main, including service cable. Mains service joints and termination. Service cable length up to 5 metres per service. Duct installation, excavation and backfill joint hole undertaken by third party		POA	POA
	Excavation and backfill of joint hole		£530	POA
	Additional metres of service cable		£13	POA
Three phase service up to 100A per phase (60kVA)	A single three phase service, from a passing main, including service cable, mains service joint, and termination. Service cable length up to 5 metres per service. Duct installation, excavation and backfill joint hole undertaken by third party		£1,580	POA
	Excavation and backfill of joint hole		£707	POA
	Additional metres of three phase service cable		£26	POA

Three phase service up to 200A per phase (120kVA)	A single three phase service, from a passing main, including service cable, mains service joint, and termination. Service cable length up to 5 metres per service. Duct installation, excavation and backfill joint hole undertaken by third party		<b>£3,800</b>	<b>POA</b>
	Excavation and backfill of joint hole		<b>£707</b>	<b>POA</b>
	Additional metres of three phase service cable		<b>£24</b>	<b>POA</b>
Three phase service up to 300A per phase (180kVA)	A single three phase service, from a passing main, including service cable, mains service joint, and termination. Service cable length up to 5 metres per service. Duct installation, excavation and backfill joint hole undertaken by third party		<b>£3,800</b>	<b>POA</b>
	Excavation and backfill of joint hole		<b>£707</b>	<b>POA</b>
	Additional metres of three phase service cable		<b>£37</b>	<b>POA</b>

**Note 1:** Excavation & Reinstatement costs for cobbles; granite setts, large or specialist flagstones etc. will be higher and will be reflected in the Connection Charge

Activity	Description	Unit	Min	Max
Three phase service up to 300A per phase (240kVA)	A single three phase service, from a passing main, including service cable, mains service joint, and termination. Service cable length up to 5 metres per service. Duct installation, excavation and backfill joint hole undertaken by third party		<b>£3,800</b>	<b>POA</b>
	Excavation and backfill of joint hole		<b>£707</b>	<b>POA</b>
	Additional metres of three phase service cable		<b>£37</b>	<b>POA</b>
Three phase service over 240kVA	A single three phase service, from a passing main, including service cable, mains service joint, and termination. Service cable length up to 5 metres per service. Duct installation, excavation and backfill joint hole undertaken by third party		<b>£3,800</b>	<b>POA</b>
	Excavation and backfill of joint hole		<b>£707</b>	<b>POA</b>
	Additional metres of three phase service cable		<b>£41</b>	<b>POA</b>
Services to Multi-occupied Premises	Installation of a multi-way cut-out up to 10 way from a passing or extended main, including cables for adjacent communal metering, mains service joint, and termination. Service cable length up to 5 metres per service. Duct installation, excavation and backfill joint hole undertaken by third party		<b>£3,229</b>	<b>POA</b>
	Installation of a multi-way cut-out of greater than 10 way from a passing or extended main, including cables for adjacent communal metering, mains service joint, and termination. Service cable length up to 5 metres per service. Duct installation, excavation and backfill joint hole undertaken by third party		<b>£3,229</b>	<b>POA</b>
	Installation of rising mains and laterals excluding civils and containment work		<b>POA</b>	<b>POA</b>
	Excavation and backfill of joint hole		<b>£707</b>	<b>POA</b>
	Additional metres of three phase service cable		<b>£60</b>	<b>POA</b>

**Note 1:** Excavation & Reinstatement costs for cobbles; granite setts, large or specialist flagstones etc. will be higher and will be reflected in the Connection Charge

### 10.3.2. F4 Unmetered Supplies

Our Charges associated with construction activities in respect of unmetered supplies.

Charges below cover both the Contestable and Non-Contestable Work; however, these will be identified separately on your Connection Offer or Point of Connection Offer. Note that your Connection Offer may also include charges for Assessment and Design and may include other charges.

The charges in the table below are inclusive of liaison with highway authorities, sending street works notices and signing, lighting and guarding. These charges exclude Traffic Management Act costs. Where these charges are relevant, these will be included in your Connection Charge. These charges exclude charges for any easement, wayleave or land transfers that are required and these are detailed in Table I, Land Rights.

Activity	Description	Unit	Min	Max
Unmetered Supplies	New connection up to 5 metres excluding excavation and reinstatement	1	£520	POA
	Disconnection excluding excavation and reinstatement	1	£470	POA
	Transfer or reconnection up to 5 metres excluding excavation and reinstatement	1	£350	POA
	Additional metres of service cable including excavation and reinstatement	m	£19	POA
Unmetered Supplies	New connection on same side of road including excavation and reinstatement	1	£1,480	POA
	New connection up to 10 metres on other side of road including excavation and reinstatement	1	£3,994	POA
	Disconnection excluding excavation and reinstatement	1	£760	POA
	Transfer or reconnection up to 5 metres including excavation and reinstatement	1	£1,300	POA
	Additional metres of service cable including excavation and reinstatement	m	£187	POA
Unmetered Supplies	Rent-a-Jointer team (excluding materials)	Per day	POA	POA
Unmetered Supplies	Administrative charge for ICP work	Per lamp	POA	POA

**Note 1:** Excavation & Reinstatement costs for cobbles; granite setts, large or specialist flagstones etc. will be higher and will be reflected in the Connection Charge

### 10.3.3. F5 Mains Cables

Our charges associated with cables are set out in the table below:

Charges below cover both the Contestable and Non-Contestable Work; however, these will be identified separately on your Connection Offer or Point of Connection Offer. Note that your Connection Offer will also include other charges for Assessment and Design and may include other charges.

The charges in the table below are inclusive of liaison with highway authorities, sending street works notices and signing, lighting and guarding. These charges exclude traffic management e.g. temporary traffic lights, road closures etc. and Traffic Management Act costs. Where these additional charges are relevant, these will be included in your connection charge.

These charges exclude charges for any easement, wayleaves, or land transfers that are required and these are detailed in Table I, Land Rights.

Where the cable charges are associated with the connection there may be an additional charge for the Final Connection to our existing Distribution System.

Activity	Description	Unit	Min	Max
Extension of LV mains cable of 95mm <sup>2</sup> or less	Lay 10m cable or less including jointing onto existing main in prepared trench or pulling through duct installed by others. All backfill and reinstatement by others	1	£1,445	POA
	Additional metres of mains cable	m	£30	POA
	Lay 10m cable or less in typical footpath or carriageway, including excavation and reinstate to match the existing surface	1	£2,620	POA
	Additional metres of mains cable	m	£140	POA
	Lay 10m cable or less in unmade ground, including excavation and reinstate to match the existing service	1	£1,720	POA
	Additional metres of mains cable	m	£60	POA
Extension of LV mains cable of between 95mm <sup>2</sup> and 185mm <sup>2</sup>	Lay 10m cable or less including jointing onto existing main in prepared trench or pulling through duct installed by others. All backfill and reinstatement by others	1	£1,555	POA
	Additional metres of mains cable	m	£37	POA
	Lay 10m cable or less in typical footpath or carriageway, including excavation and reinstate to match the existing surface	1	£2,576	POA
	Additional metres of mains cable	m	£140	POA
	Lay 10m cable or less in unmade ground, including excavation and reinstate to match the existing service	1	£1,750	POA
	Additional metres of mains cable	m	£68	POA



Activity	Description	Unit	Min	Max
Extension of LV mains cable of greater than 185mm <sup>2</sup>	Lay 10m cable or less including jointing onto existing main in prepared trench or pulling through duct installed by others. All backfill and reinstatement by others	1	£3,788	POA
	Additional metres of mains cable	M	£51	POA
	Lay 10m cable or less in typical footpath or carriageway, including excavation and reinstate to match the existing surface	1	£2,808	POA
	Additional metres of mains cable	M	£165	POA
	Lay 10m cable or less in unmade ground, including excavation and reinstate to match the existing service	1	£1,890	POA
	Additional metres of mains cable	M	£72	POA
Extension of HV mains cable	Lay 20 metres cable or less in prepared trench by pulling through duct installed by others. All backfill and reinstatement by others including jointing onto existing main	1	£4,190	POA
	Additional metres of mains cable	M	£48	POA
	Lay 20m cable or less in typical footpath or carriageway, including excavation and reinstate to match the existing surface	1	£6,080	POA
	Additional metres of mains cable	M	£200	POA
	Lay 20m cable or less in unmade ground, including excavation and reinstate to match the existing surface	1	£4,730	POA
	Additional metres of mains cable	M	£80	POA
Extension of 33kV mains cable	Lay 30m cable or less in prepared trench or pulling through duct installed by others. All backfill reinstatement by others including jointing onto existing main	1	POA	POA
	Additional metres of mains cable	M	POA	POA
	Lay 30m cable or less in typical footpath or carriageway, including excavation and reinstate to match the existing surface	1	POA	POA
	Additional metres of mains cable	M	POA	POA

Activity	Description	Unit	Min	Max
	Lay 30m cable or less in unmade ground, including excavation and reinstate to match the existing surface		POA	POA
	Additional metres of mains cable		POA	POA
Extension of 66kV mains cable	Lay 30m cable or less in prepared trench or pulling through duct installed by others. All backfill and reinstatement by others including jointing onto existing main		POA	POA
	Additional metres of mains cable		POA	POA
	Lay 30m cable or less in typical footpath or carriageway, including excavation and reinstate to match the existing surface		POA	POA
	Additional metres of mains cable		POA	POA
	Lay 30m cable or less in unmade ground, including excavation and reinstate to match the existing surface		POA	POA
	Additional metres of mains cable		POA	POA
Extension of 132kV mains cable	Lay 40m cable or less in prepared trench or pulling through duct installed by others. All backfill and reinstatement by others including jointing onto existing main		POA	POA
	Additional metres of mains cable		POA	POA
	Lay 40m cable or less in typical footpath or carriageway, including excavation and reinstate to match the existing surface		POA	POA
	Additional metres of mains cable		POA	POA
	Lay 40m cable or less in unmade ground, including excavation and reinstate to match the existing surface		POA	POA
	Additional metres of mains cable		POA	POA

**Note 1:** Excavation & Reinstatement costs for cobbles; granite setts, large or specialist flagstones etc. will be higher and will be reflected in the Connection Charge

### 10.3.4. F7 Substations

Our charges associated with substations are set out in the table below.

Charges below cover both the Contestable and Non-Contestable Work, however these will be identified separately on your Connection Offer or Point of Connection Offer. Note that your Connection Offer will also include charges for Assessment and Design and may include other charges.

The charges in the table below are inclusive of liaison with highway authorities, sending street works notices and signing, lighting and guarding. These charges exclude Traffic Management Act costs. Where these additional charges are relevant, these will be included in your connection charge.

These charges exclude charges for any easement, wayleaves or land transfers that are required and these are detailed in Table I, Land Rights.

Activity	Description	Unit	Min	Max
HV/LV substation pole or pad mounted transformer	Install pole mounted transformer up to and 100kVA including pole and stays.		£14,523	POA
	Install pole mounted transformer greater than 100kVA including pole and stays.		£17,686	POA
	Install a pad mounted transformer		£22,500	POA
	Transformer change.		£7,949	POA
HV/LV substation ground mounted transformer	Install ground mounted transformer up to and including 315kVA including RMU and LV fuse board or circuit breaker.		£40,000	POA
	Install ground mounted transformer greater than 315kVA and up to and including 500kVA including RMU and LV fuse board/cabinet or circuit breaker.		£70,000	POA
	Install ground mounted transformer greater than 500kVA and up to and including 800kVA including RMU and LV fuse board/cabinet or circuit breaker.		£80,000	POA

	Install ground mounted transformer greater than 800kVA and up to 1000kVA including RMU and LV fuse board/cabinet or circuit breaker.		<b>£85,000</b>	<b>POA</b>
	Install ground mounted transformer greater than 1000kVA including RUM and LV fuse board/cabinet or circuit breaker		<b>£140,000</b>	<b>POA</b>
	Transformer change.		<b>£70,000</b>	<b>POA</b>
HV only substation (customer owned HV/LV transformer)	Install an internal HV switchgear (e.g. RMU) and metered circuit breaker		<b>£50,000</b>	<b>POA</b>
	Install an external HV switchgear (e.g. RMU) and metered circuit breaker		<b>£37,000</b>	<b>POA</b>
EHV/HV primary substation	New indoor single transformer substation		<b>£3,000,000</b>	<b>POA</b>
	New indoor double transformer substation		<b>£4,000,000</b>	<b>POA</b>
	New outdoor single transformer substation		<b>£4,000,000</b>	<b>POA</b>
	New outdoor double transformer substation		<b>£4,500,000</b>	<b>POA</b>
	Add an additional transformer at existing indoor substation		<b>£1,500,000</b>	<b>POA</b>
	Add an additional transformer at existing outdoor substation		<b>£1,500,000</b>	<b>POA</b>
	Change transformer		<b>£2,000,000</b>	<b>POA</b>
	Change HV switchgear		<b>£2,000,000</b>	<b>POA</b>
132kV/EHV substation	New indoor single transformer substation		<b>£5,000,000</b>	<b>POA</b>
	New indoor double transformer substation		<b>£7,000,000</b>	<b>POA</b>
	New outdoor single transformer substation		<b>£7,000,000</b>	<b>POA</b>
	New outdoor double transformer substation		<b>£8,500,000</b>	<b>POA</b>
	Add an additional transformer at existing indoor substation		<b>£4,500,000</b>	<b>POA</b>
	Add an additional transformer at existing outdoor substation		<b>£3,500,000</b>	<b>POA</b>
	Change transformer		<b>£2,500,000</b>	<b>POA</b>
	Change HV switchgear		<b>£3,500,000</b>	<b>POA</b>

#### 10.4. PART G CIC Final Works and Phased Energisation

The charges set out in the table below set out the final connections to our network.

Charges below cover Non-Contestable Work or where we are asked to under- take live jointing on Contestable Assets and will be identified separately on your Connection Offer. Note that your Connection Offer will also include charges for Assessment and Design and may include other charges.

These charges exclude charges for any easement, wayleaves or land transfers that are required, and these are detailed in Table I, Land Rights.

The charges below are exclusive of all cable laying or substation installation costs and all joint hold excavation and reinstatement. These will have been covered by separate charges or have been carried out by your ICP.

Activity	Description	Unit	Min	Max
Service Connections	Low voltage service joint to all sizes of low voltage main inclusive of service polarity and earth loop impedance test at the service position.		POA	POA
LV Mains Energisation	Low voltage mains Energisation of all sizes by a mains joint to an existing cable of any size.		POA	POA
	Low voltage bottle end to mains cable, any size.		POA	POA
	Low voltage mains Energisation of all sizes by terminating to an existing piece of low voltage switchgear, including all associated operating costs.		POA	POA
	Low voltage mains Energisation of all sizes by a connection to an overhead line.		POA	POA
HV Mains Energisation	High voltage cable Energisation of all sizes by a joint to an existing cable of any size including all associated operational costs.		POA	POA
	High voltage cable Energisation of all sizes by connection to existing overhead line including all associated operational costs.		POA	POA
	High voltage cable Energisation of all sizes by termination to an existing piece of switchgear including all associated operational costs.		POA	POA
Operational Work	LV operation work including identification of cables requiring LV operations only.		POA	POA
	LV commissioning work including switching to commission LV assets installed by ICPs.		POA	POA
	HV operational work including for identification of cables requiring HV operations.		POA	POA
	HV commissioning work including all operational work required to isolate network and commission HV assets installed and jointed by ICPs.		POA	POA

## PART H CIC Inspections and Monitoring of Contestable Works

Our charges associated with site visits to inspect and monitor the construction of the Extension Asset by ICPs are set out in the table below.

Category	Unit	Charge
LV Network	per site visit	<b>POA</b>
HV Network	per site visit	<b>POA</b>
EHV Network	per site visit	<b>POA</b>
132kV Network	per site visit	<b>POA</b>
HV/LV Substation	per site visit	<b>POA</b>
EHV/HV Substation	per site visit	<b>POA</b>
HV/LV Civils	per site visit	<b>POA</b>
EHV/HV Civils	per site visit	<b>POA</b>

## 10.5. PART I Land Rights

Our charges associated with Land rights are set out in the table below. These charges exclude the cost of any compensation or consideration payable to third parties.

Where your ICP chooses to negotiate Land Rights on our behalf the charges shown below will be reduced to cover our costs to process the documentation for forwarding to our solicitors.

Category	Min	Max
Residential Development substation site from developer (including easements from developer)	£1,700	POA
Commercial/industrial development substation from developer (including easements from developer)	£1,700	POA
Residential /commercial/industrial development substation site from third party owner(s) (including easements from same third-party owner(s))	£2,388	POA
Wayleave(s)/easements(s) only on a residential site from Developer	£1,700	POA
Wayleave(s)/easements(s) only on a commercial/industrial site from Developer	£1,700	POA
Wayleave(s)/easement(s) from third party owner(s)	£1,900	POA
Acquisition of Consents specifically associated with overhead lines e.g. Section 37 of the Electricity Act approval to erect overhead lines etc.	£1,200	POA
Survey associated with overhead lines e.g. determination of pole positions, tree clearance etc.	£1,200	POA
Route marking prior to construction e.g. pegging of overhead line route and pole positions etc.	£600	POA
Acquisition of specific Environmental Consents i.e.. Conservation Area, Listed Buildings etc.	£572	POA
Negotiations with individuals or organisations concerning nationally recommended compensation payments e.g. crop loss or land damage. This excludes any third-party commercial compensation payment charges which will have to be negotiated separately by the Customer or their Agent.	£286	POA
Traffic Management Act Costs e.g. permits, lane rental	£500	POA

## 10.6. PART J Other

Our miscellaneous charges associated with the provision of the connection are set out in the table below.

Category	Charge
Negotiation of special terms	POA
Meetings not covered by other charges	POA
Abortive Visit	POA
Planning approval	POA
Traffic management costs e.g., temporary traffic lights, road closures, etc.	POA



## 11. SECTION 8. GLOSSARY OF TERMS

Act	The Electricity Act 1989 (as amended).
Adoption Agreement	Is the agreement for us to adopt the Contestable Work, subject to the satisfaction of certain conditions.
Affected Parties	Are all customers whose Connection Offer(s)/ Point of Connection Offer(s) has been identified by us as being interactive.
Application Date	Is the date upon which we have received all the information we require in respect of an application. A list of the information required can be found in Section 2.
Bilateral Connection Agreement	An agreement between us and another LDNO setting out the terms and conditions under which an embedded network shall be entitled to be and remain connected to the Distribution System.
Budget Estimate	Is an indication of the charge for providing a connection to our Distribution System. This will not include detailed design work and will be a result of preliminary assessment only. A Budget Estimate does not constitute a formal Connection Offer and the price may differ considerably between any Budget Estimate and a formal Connection Offer.
Building Network Operator (BNO)	Is the operator of a private wires network within a building or buildings.
Business Day	Any day other than a Saturday, a Sunday, Christmas Day, Good Friday or a day which is a bank holiday within the meaning of the Banking and Financial Dealings Act 1971 and will be from 9:00am to 5:00pm (GMT or BST as applicable).
Committed Network	Means assets that are not yet installed and commissioned on our Distribution System, but which are planned to be so as a result of other Connection Offer(s)/ Point of Connection Offer(s) which have been made by us and accepted by other applicant(s).
Common Connection Charging Methodology	Means the Connection Charging Methodology set out in Schedule 22 of the DCUSA, as amended from time to time, and the required by all Distribution Services Providers to form part of their Connection Charging Methodology.
Competition in Connections (CIC)	Is the term attributed to the opening up of the market for the design, procurement and installation of new assets necessary to accommodate a new or modified electricity connection.
CIC Charges	Are the charges detailed in parts D, E, G, H, I, and J of Section 7.
Connection Agreement	Is an agreement between you and us which sets out the terms you will be, and remain, connected to our Distribution System.

Connection Charge	The payment to be made by the applicant to us for the provision of the connection.
Connection Offer	Is our formal written offer to you to provide a connection to our Distribution System.
Contestable Work	Is work that may be carried on, or in connection to, our Distribution System by an accredited ICP. A list of work considered to be contestable can be located in Section 3.
CUSC	The Connection and Use of System Code which constitutes the contractual framework for connection to, and use of, the GB Transmission System.
Customer	The person requesting the connection.
DCUSA	The Distribution Connection and Use of System Agreement designated as such by the Authority under condition 22 of the License.
De-energise	To deliberately prevent the flow of electricity to or from an Exit/Entry Point for any purpose other than a system outage on our Distribution System (and cognate expressions shall be construed accordingly).
Development Phase	The three-year period, unless otherwise agreed with us, commencing on the date of Energisation of an embedded network over which the development is constructed.
Disconnect	Means to permanently De-energise an Exit/ Entry Point by the removal of all or part of our equipment (and cognate expressions shall be construed accordingly).
Distributed Generation Connections Guide	The guide produced by us as required by our License which provides guidance on the connection process for distributed generation.
Distribution Code	Is a code that covers material technical aspects relating to the connection to, and operation of, our Distribution System in place in accordance with Section 21 of our license.
Distribution Services Area	Shall have the meaning given to it in the License.
Distribution Services Provider	Shall have the meaning given to it in the License.
Distribution System	The system (as defined in the License) consisting (wholly or mainly) of electric lines owned or operated by us and used for the distribution of electricity. Electricity meters and meter boxes do not form part of our Distribution System.
ECCR	The Electricity (Connection Charges) Regulations 2002 (SI 2002/93) as amended from time to time or the Electricity (Connection Charges) Regulations 2017 (SI 2017/106) as amended from time to time, as applicable.
ECCR Prescribed Period	The relevant period from the data on which a connection is made as prescribed by the ECCR, being either (a) five years, for connections made prior to 6 April 2017: or (b) ten years, for connections made on or after 6 April 2017

EHV	More than 22kV but not more than 72kV.
Electric Lines	Means any line which is used for carrying electricity to or from An Exit/Entry Point and includes, unless the context otherwise requires; (a) Any support for such line, that is to say, any structure, pole or other thing in, on, by or from which any such line is or may be supported, carried or suspended; (b) Any apparatus connected to such line for the purpose of carrying electricity; and (c) Any wire, cable, tube, pipe or other similar thing (including its casing or coating) which surrounds or supports, or is surrounded or supported by, or is installed in close proximity to, or is supported, carried or suspended in association with, any such line.
Electric Plant	Means any plant, equipment, apparatus or appliance used for or for purposes connected with the distribution of electricity (including any metering equipment) other than an Electric Line.
Energise	To deliberately allow the flow of electricity to or from an Exit/ Entry Point where such a flow of electricity has never previously existed (and cognate expressions shall be construed accordingly).
Enhanced Scheme	Is a scheme which has been designed to include one of more of the following; a) Additional assets not required as part of the minimum scheme; b) Assets of a larger capacity than required by the Minimum Scheme; c) Assets of a different specification than required by the Minimum Scheme.
Entry/ Exit Point	A point at which electricity, whether metered or unmetered, enter or exit our Distribution System.
Existing Capacity	Is, for existing customers; a) The Maximum Capacity used in the calculation of their use of system charges; or b) For customers who are not charged for use of system on the basis of their Maximum Capacity the lower of; i. No. of phases x nominal phase neutral voltage (kV) x fuse rating (A); and ii. The rating of the service equipment.
Existing Network	Means our currently installed and commissioned Distribution System.
Extension Assets	Are assets installed to connect a party or parties to the existing distribution network but which exclude Reinforcement assets.
Fault Level	The maximum prospective current or power that will flow into a short circuit at a point on the network, usually expressed in MVA or kVA.

Fault Level Contribution from Connection	Is the assessment of the fault level contribution from the equipment to be connected taking account of its impact at the appropriate point on the Distribution System. Where an existing Customer requests a change to a connection then the Fault Level Contribution from Connection is defined as the incremental increase in Fault Level caused by the Customer.
Feasibility Study	Is a study to consider a number of different options for providing your connection and will provide estimated costs for each option as appropriate. A Feasibility Study will not constitute a formal connection offer.
GB Transmission System	The system consisting (wholly or mainly) of high voltage electric wires owned or operated by transmission licensees within Great Britain.
Guaranteed Standards of Performance	Standards of service backed by a guarantee and set out in the Electricity (Standards of Performance) Regulations 2005 (as amended).
HV	More than 1kV but not more than 22kV.
Independent Connections Provider (ICP)	A person with sufficient accreditation to carry out all or part of the Contestable Work.
Interactive Connection Applications	Arise when we receive two or more applications for a connection, which could individually make use of the same part of the Distribution System, but where there is insufficient spare capacity or other network constraints on our Distribution System that will prevent both/all being connected.
Interactive Connection Offers	Are Connection Offers / Point of Connection Offers made in respect of Interactive Connection Applications.
Interactive Queue	Is the queue into which Affected Parties' interactive Connection Applications will be placed according to the Application Date.
Interruptions Incentive Scheme	The scheme, which provides incentives on us to deliver a good level of performance in respect of customer interruptions and customer minutes, lost.
Land Rights	All such rights in, under or over Land as are necessary for the construction, installation, operation, repair, maintenance, renewal or use of the Contestable Work or Non-Contestable Work.
License Exempt System	Is a distribution system operated by a person or persons who has been granted an exemption (including class exemptions) from the requirement to hold a distribution license by the Secretary of State
Licensed Distribution Network Operator (LDNO)	The holder of a License to distribute electricity.
LV	Not more than 1kV.
Maximum Capacity	Means in relation to any connection the maximum amount of electricity, as agreed with us and expressed in kW or kVA, that can be imported from or exported onto our Distribution System.

Meter Point Administration Number (MPAN)	Is a 21 digit reference to uniquely identify Exit/ Entry Point, such as individual domestic residences.
Minimum Scheme	Is the Scheme with the lowest overall capital cost (as estimated by us), solely to provide the Required Capacity. The Minimum Scheme is subject to engineering policy and standards as described in Section 4.
National Electricity Registration Scheme	Is a national registration system for accrediting ICPs to enable them to carry out contestable work.
NGET	National Grid Electricity Transmission plc.
Non-Contestable Work	Is work on, or in relation to a connection to, our distribution system that cannot be undertaken by an ICP and must be carried out by our appointed agents or us? A list of Non-Contestable work can be found in Section 3.
Notice of Interactivity	Is a notice provided by us, in writing, that your connection application is interactive with another application that we have received. The validity period of any current Connection Offer will be reduced to thirty days from the date of the notification where more than thirty days were still outstanding.
Point of Connection Offer	Is the offer that we make to you to carry out the Non- Contestable work only to allow connection to our Distribution System which will, if accepted by you, create a legally binding contract between you and us.
Point of Connection (POC)	Is the point (or points) of physical connection to our existing Distribution System.
Premises	Means any land, building or structure.
Reinforcement	Is defined as assets that add capacity (network or fault level) to the existing shared use Distribution System.
Relevant Section of Network	<p>Is the part or parts of the Distribution System which require(s) Reinforcement. Normally this will comprise:</p> <ul style="list-style-type: none"> <li>a) The existing assets, at the voltage level that is being reinforced, that would have been used to supply you (so far as they have not been replaced) has sufficient capacity been available to connect you without reinforcement; and/or</li> <li>b) The new assets, at the same voltage level, that are to be provided by way of Reinforcement.</li> </ul> <p>Where it is unclear what assets would have supplied the Customer in the event that sufficient capacity had been available, the existing individual assets with the closest rating to the new assets will be used. There may be more than one RSN.</p>

Rent-a-Jointer Services	The service relating to hiring of resource from us to facilitate the provision of unmetered connections.
Required Capacity	Is the Maximum Capacity agreed with the Customer. In the case of multiples connections (e.g. a housing development) it may be adjusted after consideration of the effects of diversity. Where an existing Customer requests an increase in capacity then it is the increase above their Existing Capacity.
Scheme	Our network design to provide the connection.
Service Line	A low-voltage electric line or any part of that line that will, at time it is provided, be used only for supplying single premises, excluding any part of the line that, at the time it is provided, is intended by the distributor to be used to enable it to provide a connection to other premises in respect of which the distributor has received, or would reasonable expect within the following 12 months to receive, a notice under section 16A(1) of the Act.
Single LV Service Demand Connection	Is an LV demand connection to single Premises, involving a single-phase connection and no significant work other than the provision of a service line and the electricity distributor's fuses.
Small Project Demand Connection	<p>Is a connection (other than a load that could be reasonably expected to cause disruption to other customers, via low- voltage circuits fused at 100 amperes or less per phase with whole current metering), and where the highest voltage of the assets involved in providing such connection and any associated works, is low voltage, to:</p> <ul style="list-style-type: none"> <li>a) A development scheme requiring more than one but fewer than five single-phase connections at domestic premises and involving only the provision of a service line and the electricity distributor's fuses; or</li> <li>b) A development scheme requiring fewer than five single- phase or two-phase connections at domestic premises and involving an extension of the existing low voltage network; or</li> <li>c) A single premises requiring a two-phase or three-phase connection and involving only the provision of a service line and the electricity distributor's fuses.</li> </ul>
Speculative Developments	Are developments which have one or more of the characteristics set out in Section 4.
SSEG (Small Scale Embedded Generation)	Is a source of electrical energy rated up to and including 16 Amperes per phase, single or multi-phase, LV and designed to operate in parallel with our Distribution System.
Supplier	A person who holds a Supply License.
Supply License	A license granted under section 6(1)(d) of the Act.

Supply Number	A unique identifier of those Entry/Exit Points on the Distribution System which are used for the purposes of either taking a supply of electricity or for the connection of a distributed generator, and which forms the basis of the metering point record on the Company's registration system.
Temporary Connections	Are connections that are only required for a period of up to five years, but exclude connections to provide the initial connection to a development, where the Reinforcement will subsequently be required for the permanent connection.
Validity Period	The period for which a connection Offer or Point of Connection Offer is open for acceptance.
Voltage of Connection	Is the voltage at the Point of Connection between the existing distribution network and the assets used to provide the connection. For clarity, this is not necessarily the voltage of supply to the Customer.
Working Day	Any day other than a Saturday, a Sunday, Christmas Day, Good Friday or a day which is a bank holiday within the meaning of the Banking and Financial Dealings Act 1971.